


# CS-series B7A Interface Unit

# CS1W-B7A

CSM\_CS1W-B7A\_DS\_E\_3\_2

**It transmits 16 points of I/O signals per word with a pair of cables.**  
**Easy and minimized wiring effort,**

- The B7A Interface Unit and B7A Link Terminal can be used in the same way as a standard Basic I/O Unit and I/O Terminal without any need to worry about communications. This characteristic reduces the wiring when using more than one relatively remote sensor or actuator.

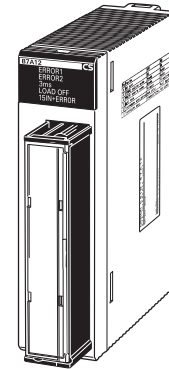


CS1W-B7A12

## Features

- A CS1W-B7A unit can transmit 64 points of I/O signals.
- The slim body can downsize machines to which CS1W-B7A is connected.
- It is a basic I/O unit. No complicated setting and programs are required.

## System Configuration

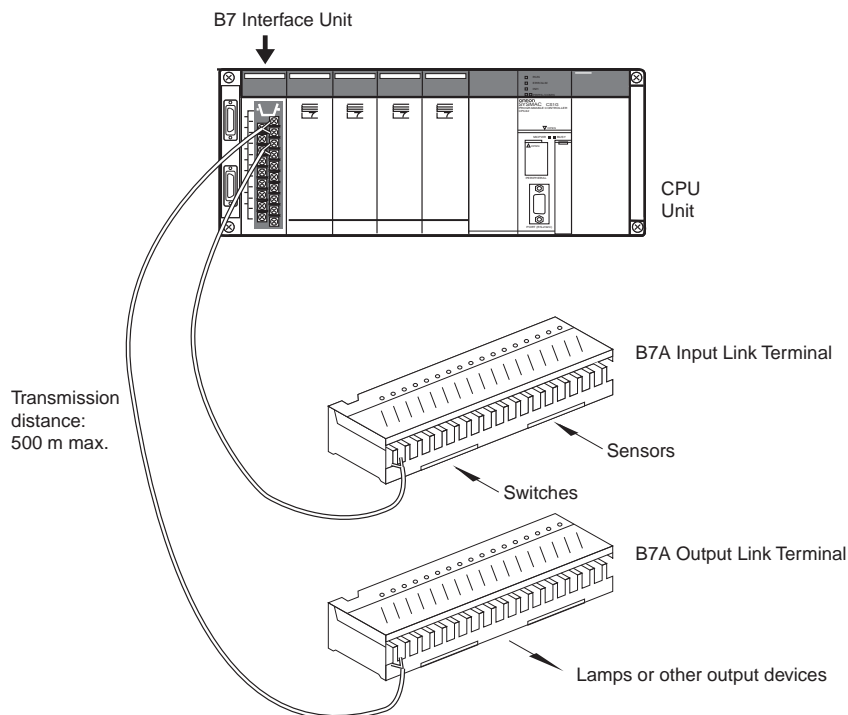

## B7A Communications Specifications

Item	Specifications		
Transmission method	One-way time-sharing multiplex transmissions		
Transmission delay (communications delay on transmission path)	High-speed	3 ms typical, 5 ms max.	
	Standard	19.2 ms typical, 31 ms max.	
Transmission points	CS1W-B7A12	32 inputs (2 ports)	
	CS1W-B7A02	32 outputs (2 ports)	
	CS1W-B7A21	16 inputs (1 port), 16 outputs (1 port)	
	CS1W-B7A22	32 inputs (2 ports), 32 outputs (2 ports)	
External power supply voltage *1	12 to 24 V DC (allowable voltage range: 10.8 to 26.4 V)		
External supply current *2	CS1W-B7A12	20 mA min.	
	CS1W-B7A02	60 mA min.	
	CS1W-B7A21	30 mA min.	
	CS1W-B7A22	60 mA min.	
Minimum input time *3	High-speed	16 ms	
	Standard	2.4 ms	
Transmission distance	High-speed	Power supply on one side (common power supply)	10 m max. 50 m max. (with shielded cable)
		Power supply on both sides (separate power supplies)	10 m max. 100 m max. (with shielded cable)
	Standard	Power supply on one side (common power supply)	100 m max.
		Power supply on both sides (separate power supplies)	500 m max.
Cables	VCTF, 0.75 mm <sup>2</sup> , 3 conductors (power supply on one side (common power supply)) VCTF, 0.75 mm <sup>2</sup> , 2 conductors (power supply on both sides (separate power supplies)) Shielded cable, 0.75 mm <sup>2</sup> , 3 conductors (power supply on one side (common power supply)) Shielded cable, 0.75 mm <sup>2</sup> , 2 conductors (power supply on both sides (separate power supplies))		


\*1. Use a SELV power supply with overcurrent protection. A SELV power supply refers to a power supply with double or reinforced insulation between input and output and with an output voltage of 30 V rms with a 42.4-V peak or an output voltage of 60 VDC max. We recommend OMRON S8□□-series Power Supply Units for the external power supplies.

\*2. The capacity of the external supply current does not include the capacity required by the B7A Link Terminal.

\*3. The minimum input time is the minimum time required by the B7A Interface Unit to read the input signals from the CPU Unit.

**Note:** 1. When separate power supplies are used, the B7A Interface Unit and B7A Link Terminal are supplied by separate external power supplies.  
2. When a common power supply is used, the B7A Interface Unit and B7A Link Terminal are supplied by the same external power supply.

## Ordering Information

Unit type	Name	Specifications		No. of words allocated	Current consumption (A)		Model	Standards
		I/O points	External connection		5 V	26 V		
CS Series Basic I/O Units	<b>B7A Interface Units</b> 	32 inputs	Removable terminal block	2 words	0.09	–	CS1W-B7A12	UC1, CE
		32 outputs		2 words	0.09	–	CS1W-B7A02	
		16 inputs/outputs		2 words	0.09	–	CS1W-B7A21	
		32 inputs/outputs		4 words	0.09	–	CS1W-B7A22	

### International Standards

- The standards indicated in the "Standards" column are those current for UL, CSA, cULus, cUL, NK, and Lloyd standards and EC Directives as of the end of October 2008. (The standards are abbreviated as follows: U: UL, U1: UL Class I Division 2 Products for Hazardous Locations, C: CSA, US: cULus Class I Division 2 Products for Hazardous Locations, CU: cUL, N: NK, L: Lloyd, and CE: EC Directives.)
- Ask your OMRON representatives for the conditions under which the standards were met.


## Specifications

Model	CS1W-B7A12	CS1W-B7A02	CS1W-B7A21	CS1W-B7A22	
Applicable PLC	CS-series PLCs				
Unit type	CS1 Basic I/O Unit				
I/O points	Input	32 inputs	–	16 inputs	32 inputs
	Output	–	32 outputs	16 outputs	32 outputs
Transmission distance	Normal: 500m max. when the interface unit and the link terminal units have separate external power supplies, Normal: 100m max. when the interface unit and the link terminal units use a common external power supply, High speed: 100m max. with shielded cables, 10m max. with unshielded cables, when the interface unit and the link terminal units have separate external power supplies, High speed: 50m max. with shielded cables, 10m max. with unshielded cables, when the interface unit and the link terminal units use a common external power supply,				
Transmission delay	Normal: 19.2ms (typ.), 31ms max. Short 3ms (typ.), 5ms max. *1				
Weight	230g max.		240g max.		
Power supply voltage from external source *2	12 to 24VDC ±10%, 20mA min.	12 to 24VDC ±10%, 60mA min.	12 to 24VDC ±10%, 30mA min.	12 to 24VDC ±10%, 60mA min.	
I/O memory allocation	Each Unit is allocated 4 words in the I/O Area (which starts at CIO 0000). The words are allocated according to the mounting position of the Unit.				
	2 words (32 points).			4 words (64 points).	
Current consumption	5 V DC: 90 mA max. (supplied from Power Supply Unit)				

\*1. The I/O delay time is selectable by the selector switch between normal and short.

\*2. The value does not include the power supplied to B7A link terminal units.

## Parts and Names

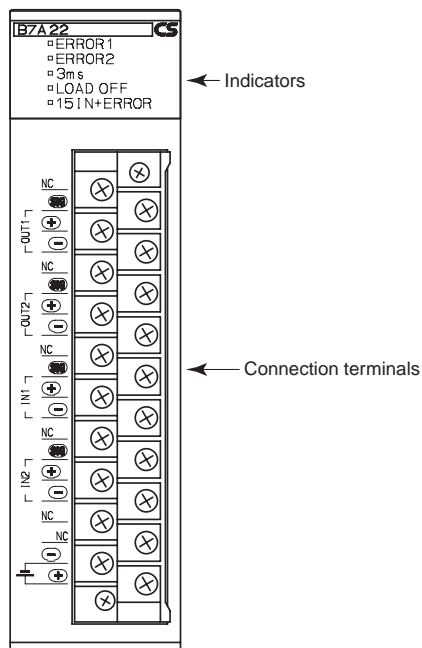

## Terminal Names and Allocations

### CS1W-B7A12

Terminal	Name	Function	Word	Appearance
B0	SIG IN1	Connect to SIG terminal on Input B7A Link Terminal.	n	
A1	+V	Connect to + terminal on external power supply.		
B1	⊖IN1	Connect to – power supply terminal on Input B7A Link Terminal.		
B4	SIG IN2	Connect to SIG terminal on Input B7A Link Terminal.	n+1	
A5	+V	Connect to + terminal on external power supply.		
B5	⊖IN2	Connect to – power supply terminal on Input B7A Link Terminal.		
A0, A2 to A4, A6 to A8, B2, B3, B6 to B8	NC	Not used.	-	
A9	–V	Connect to – terminal on external power supply.		
B9	+V	Connect to + terminal on external power supply.		

### CS1W-B7A02

Terminal	Name	Function	Word	Appearance
B0	SIG OUT1	Connect to SIG terminal on Output B7A Link Terminal.	n	
A1	+V	Connect to + terminal on external power supply.		
B1	⊖OUT1	Connect to – power supply terminal on Output B7A Link Terminal.		
B4	SIG OUT2	Connect to SIG terminal on Output B7A Link Terminal.	n+1	
A5	+V	Connect to + terminal on external power supply.		
B5	⊖OUT2	Connect to – power supply terminal on Output B7A Link Terminal.		
A0, A2 to A4, A6 to A8, B2, B3, B6 to B8	NC	Not used.	-	
A9	–V	Connect to – terminal on external power supply.		
B9	+V	Connect to + terminal on external power supply.		

**CS1W-B7A21**

Terminal	Name	Function	Word	Appearance
B0	SIG OUT1	Connect to SIG terminal on Output B7A Link Terminal.	n	
A1	+V	Connect to + terminal on external power supply.		
B1	⊖OUT1	Connect to – power supply terminal on Output B7A Link Terminal.		
B4	SIG IN1	Connect to SIG terminal on Input B7A Link Terminal.	n+1	
A5	+V	Connect to + terminal on external power supply.		
B5	⊖IN1	Connect to – power supply terminal on Input B7A Link Terminal.		
A0, A2 to A4, A6 to A8, B2, B3, B6 to B8	NC	Not used.	-	
A9	-V	Connect to – terminal on external power supply.		
B9	+V	Connect to + terminal on external power supply.		

**CS1W-B7A22**


Terminal	Name	Function	Word	Appearance
B0	SIG OUT1	Connect to SIG terminal on Output B7A Link Terminal.	n	
A1	+V	Connect to + terminal on external power supply.		
B1	⊖OUT1	Connect to – power supply terminal on Output B7A Link Terminal.		
B2	SIG OUT2	Connect to SIG terminal on Output B7A Link Terminal.	n+1	
A3	+V	Connect to + terminal on external power supply.		
B3	⊖OUT2	Connect to – power supply terminal on Output B7A Link Terminal.		
B4	SIG IN1	Connect to SIG terminal on Input B7A Link Terminal.	n+2	
A5	+V	Connect to + terminal on external power supply.		
B5	⊖IN1	Connect to – power supply terminal on Input B7A Link Terminal.		
B6	SIG IN2	Connect to SIG terminal on Input B7A Link Terminal.	n+3	
A7	+V	Connect to + terminal on external power supply.		
B7	⊖IN2	Connect to – power supply terminal on Input B7A Link Terminal.		
A0, A2, A4, A6, A8, B8	NC	Not used.	-	
A9	-V	Connect to – terminal on external power supply.		
B9	+V	Connect to + terminal on external power supply.		

# Wiring Methods


- Note:**
1. Confirm that terminals are connected correctly. If connections are incorrect, the internal components of the B7A Interface Unit and B7A Link Terminal may be damaged.
  2. Route the signal lines in separate ducts both inside and outside the control panel to isolate them from power lines.
  3. Connect cables at a distance that is within the range given in the specifications.
  4. Always turn OFF the power to the CPU Unit and all other Units before connecting the communications cables.
  5. Always lay communications cables within ducts.

## Standard Mode

### Common Power Supply

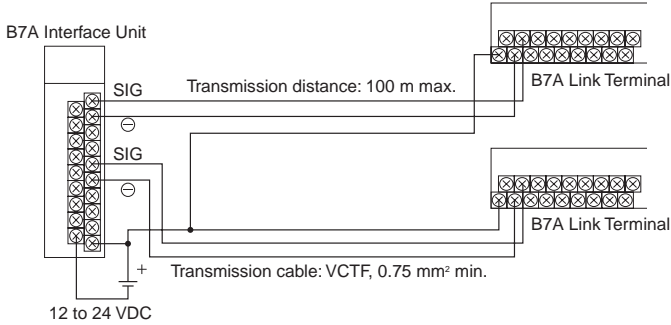


### Separate Power Supplies

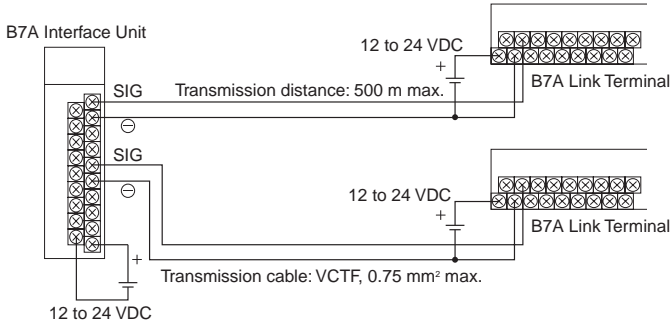


## High-speed Mode

**Note:** If shielded cable is not used, the maximum transmission distance is 10 m regardless of whether a common or separate power supplies are used. (Use VCTF cable of 0.75 mm<sup>2</sup> or higher.)

### Common Power Supply

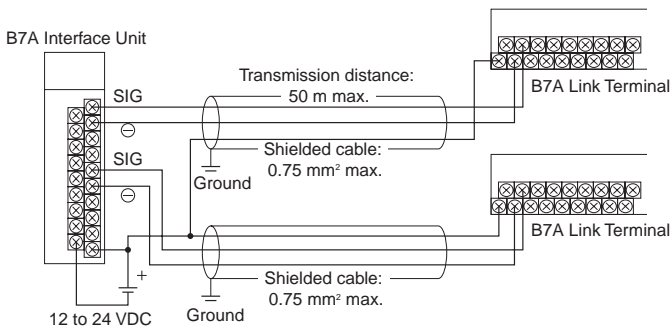




### Separate Power Supplies

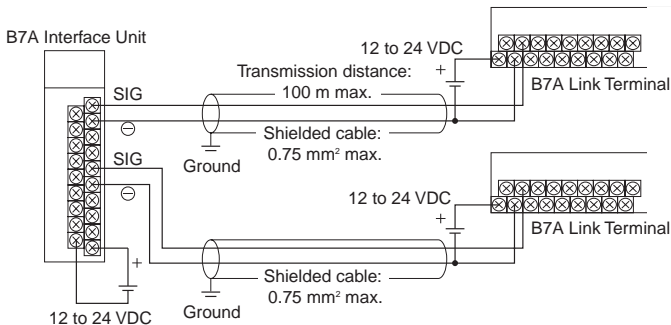

Dimensions

(Unit: mm)

CS1W-B7A12/02/21/22

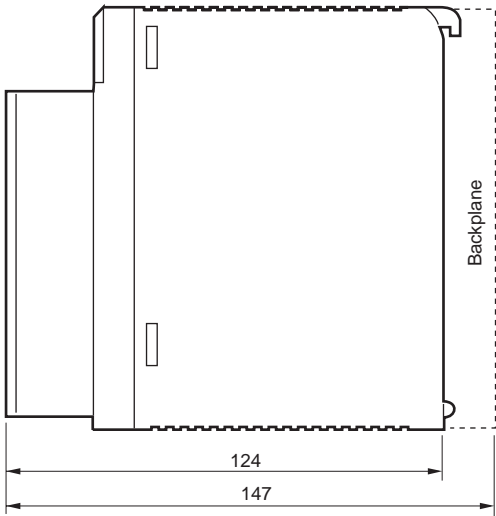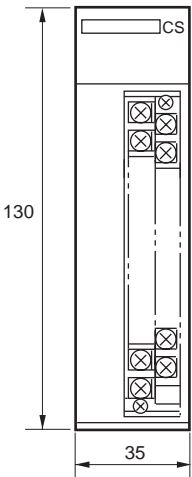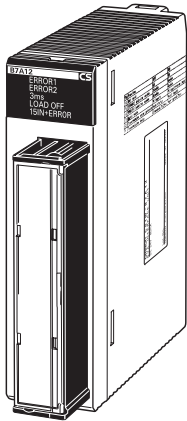

Related Manual

Cat.No.	Name	Contents
W339	SYSMAC CS Series CS1G/H-CPU□□H, CS1G/H-CPU□□-EV1 Programmable Controllers OPERATION MANUAL	Provides an outlines of and describes the design, installation, maintenance, and other basic operations for the CS-series PLCs.

## Terms and Conditions Agreement

### Read and understand this catalog.

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

### Warranties.

(a) Exclusive Warranty. Omron's exclusive warranty is that the Products will be free from defects in materials and workmanship for a period of twelve months from the date of sale by Omron (or such other period expressed in writing by Omron). Omron disclaims all other warranties, express or implied.

(b) Limitations. OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, ABOUT NON-INFRINGEMENT, MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OF THE PRODUCTS. BUYER ACKNOWLEDGES THAT IT ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE.

Omron further disclaims all warranties and responsibility of any type for claims or expenses based on infringement by the Products or otherwise of any intellectual property right. (c) Buyer Remedy. Omron's sole obligation hereunder shall be, at Omron's election, to (i) replace (in the form originally shipped with Buyer responsible for labor charges for removal or replacement thereof) the non-complying Product, (ii) repair the non-complying Product, or (iii) repay or credit Buyer an amount equal to the purchase price of the non-complying Product; provided that in no event shall Omron be responsible for warranty, repair, indemnity or any other claims or expenses regarding the Products unless Omron's analysis confirms that the Products were properly handled, stored, installed and maintained and not subject to contamination, abuse, misuse or inappropriate modification. Return of any Products by Buyer must be approved in writing by Omron before shipment. Omron Companies shall not be liable for the suitability or unsuitability or the results from the use of Products in combination with any electrical or electronic components, circuits, system assemblies or any other materials or substances or environments. Any advice, recommendations or information given orally or in writing, are not to be construed as an amendment or addition to the above warranty.

See <http://www.omron.com/global/> or contact your Omron representative for published information.

### Limitation on Liability; Etc.

OMRON COMPANIES SHALL NOT BE LIABLE FOR SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR PRODUCTION OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED IN CONTRACT, WARRANTY, NEGLIGENCE OR STRICT LIABILITY.

Further, in no event shall liability of Omron Companies exceed the individual price of the Product on which liability is asserted.

### Suitability of Use.

Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

### Programmable Products.

Omron Companies shall not be responsible for the user's programming of a programmable Product, or any consequence thereof.

### Performance Data.

Data presented in Omron Company websites, catalogs and other materials is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of Omron's test conditions, and the user must correlate it to actual application requirements. Actual performance is subject to the Omron's Warranty and Limitations of Liability.

### Change in Specifications.

Product specifications and accessories may be changed at any time based on improvements and other reasons. It is our practice to change part numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the Product may be changed without any notice. When in doubt, special part numbers may be assigned to fix or establish key specifications for your application. Please consult with your Omron's representative at any time to confirm actual specifications of purchased Product.

### Errors and Omissions.

Information presented by Omron Companies has been checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical or proofreading errors or omissions.

2014.1

In the interest of product improvement, specifications are subject to change without notice.

**OMRON Corporation**  
Industrial Automation Company

<http://www.ia.omron.com/>

(c)Copyright OMRON Corporation 2014 All Right Reserved.