OMRON

Machine Automation Controller Industrial PC Platform

NX/NY-series

Artificial Intelligence Machine Automation Controller

User's Manual

NX701-Z□□□

NY532-Z□□□

NY512-Z□□□

CPU Unit





NOTE -

- All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form, or by any means, mechanical, electronic, photocopying, recording, or otherwise, without the prior written permission of OMRON.
- No patent liability is assumed with respect to the use of the information contained herein.
 Moreover, because OMRON is constantly striving to improve its high-quality products, the information contained in this manual is subject to change without notice.
- Every precaution has been taken in the preparation of this manual. Nevertheless, OMRON assumes no responsibility for errors or omissions.

Neither is any liability assumed for damages resulting from the use of the information contained in this publication.

Trademarks -

- Sysmac and SYSMAC are trademarks or registered trademarks of OMRON Corporation in Japan and other countries for OMRON factory automation products.
- Microsoft, Windows, Excel, and Visual Basic are either registered trademarks or trademarks of Microsoft Corporation in the United States and other countries.
- EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.
- ODVA, CIP, CompoNet, DeviceNet, and EtherNet/IP are trademarks of ODVA.
- The SD and SDHC logos are trademarks of SD-3C, LLC.



Other company names and product names in this document are the trademarks or registered trademarks of their respective companies.

Copyrights

- Microsoft product screen shots reprinted with permission from Microsoft Corporation.
- This product incorporates certain third party software. The license and copyright information associated with this software is available at http://www.fa.omron.co.jp/nj info e/.

Introduction

Thank you for purchasing an NX/NY-series Artificial Intelligence Machine Automation Controller.

This manual contains information that is necessary to use the NX/NY-series Artificial Intelligence Machine Automation Controller. Please read this manual and make sure you understand the functionality and performance before you attempt to use it in a control system.

Keep this manual in a safe place where it will be available for reference during operation.

This manual only describes functions that are added to NX701-Z□□□, NY532-Z□□□, and NY512-Z□□□.

When you use NX701-Z□□□, also consult manuals for the NX-series listed in *Related Manuals* on page 24 for functions common to the NX-series CPU Units.

When you use NY532-Z□□□ or NY512-Z□□□, also consult manuals for the NY-series listed in *Related Manuals* on page 24 for functions common to the NY-series Industrial PC.

Intended Audience

This manual is intended for the following personnel, who must also have knowledge of electrical systems (an electrical engineer or the equivalent).

- Personnel in charge of introducing FA systems.
- · Personnel in charge of designing FA systems.
- Personnel in charge of installing and maintaining FA systems.
- · Personnel in charge of managing FA systems and facilities.

For programming, this manual is intended for personnel who understand the programming language specifications in international standard IEC 61131-3 or Japanese standard JIS B 3503 and those who have expertise in AI technology.

Applicable Products

This manual covers the following products.

- · NX-series Artificial Intelligence CPU Unit
 - a) NX701-Z700
 - b) NX701-Z600
- · NY-series Artificial Intelligence Industrial PC
 - a) NY532-Z500
 - b) NY532-Z400
 - c) NY532-Z300
 - d) NY512-Z500
 - e) NY512-Z400
 - f) NY512-Z300

Relevant Manuals

The following table provides the relevant manuals for the NX/NY-series Controllers. Read all of the manuals that are relevant to your system configuration and application before you use the NX/NY-series Controllers.

Most operations are performed from the Sysmac Studio Automation Software. Refer to the *Sysmac Studio Version 1 Operation Manual (Cat. No. W504)* for information on the Sysmac Studio.

Relevant Manuals for NX Series

						Manual					
		c informa	ition								
Purpose of use	NX-series CPU Unit Hardware User's Manual	NJ/NX-series CPU Unit Software User's Manual	NJ/NX-series Instructions Reference Manual	NJ/NX-series CPU Unit Motion Control User's Manual	NJ/NX-series Motion Control Instructions Reference Manual	NJ/NX-series CPU Unit Built-in EtherCAT Port User's Manual	NJ/NX-series CPU Unit Built-in EtherNet/IP Port User's Manual	NX-series CPU Unit FINS Functions User's Manual	NJ/NX-series Database Connection CPU Units User's Manual	NX/NY-series Artificial Intelligence Machine Automation Controller User's Manual	NJ/NX-series Troubleshooting Manual
Introduction to NX701 CPU Units	0										
Setting devices and hardware											
Using motion control				0							
Using EtherCAT						0					
Using EtherNet/IP	0						0				
Using the database connection service									0		
Using AI functions										0	
Software settings											
Using motion control				0							
Using EtherCAT						0					
Using EtherNet/IP		0					0				
Using FINS								0			
Using the database connection service									0		
Using AI functions										0	

	Manual											
		c informa	ation									
Purpose of use	NX-series CPU Unit Hardware User's Manual	NJ/NX-series CPU Unit Software User's Manual	NJ/NX-series Instructions Reference Manual	NJ/NX-series CPU Unit Motion Control User's Manual	NJ/NX-series Motion Control Instructions Reference Manual	NJ/NX-series CPU Unit Built-in EtherCAT Port User's Manual	NJ/NX-series CPU Unit Built-in EtherNet/IP Port User's Manual	NX-series CPU Unit FINS Functions User's Manual	NJ/NX-series Database Connection CPU Units User's Manual	NX/NY-series Artificial Intelligence Machine Automation Controller User's Manual	NJ/NA-series Troubleshooting Manual	
Writing the user program												
Using motion control				0	0							
Using EtherCAT						0						
Using EtherNet/IP							0					
Using FINS		0	0					0				
Using the database connection service									0			
Using AI functions										0		
Programming error processing											0	
Testing operation and debugging												
Using motion control				0								
Using EtherCAT						0						
Using EtherNet/IP		0					0					
Using FINS								0				
Using the database connection service									0			
Using AI functions										0		
Learning about error management and corrections*1								Δ	Δ	Δ	0	
Maintenance												
Using motion control				0								
Using EtherCAT	0					0						
Using EtherNet/IP							0					

^{*1.} Refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)* for the error management concepts and an overview of the error items. However, refer to the manuals that are indicated with triangles (\triangle) for details on errors corresponding to the products with the manuals that are indicated with triangles (\triangle).

Relevant Manuals for NY Series

						i	Manual			1			
		1	c inform										
Purpose of use	NY-series IPC Machine Controller Industrial Panel PC Hardware User's Manual	NY-series IPC Machine Controller Industrial Box PC Hardware User's Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Setup User's Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Software User's Manual	NY-series Instructions Reference Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Motion Control User's Manual	NY-series Motion Control Instructions Reference Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Built-in EtherCAT Port User's Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Built-in EtherNet/IP Port User's Manual	NJ/NY-series NC Integrated Controller User's Manual	NJ/NY-series G code Instructions Reference Manual	NX/NY-series Artificial Intelligence Machine Automation Controller User's Manual	NY-series Troubleshooting Manual
Introduction to NY-series Panel PCs	0											5	
Introduction to NY-series Box		0											
PCs													
Setting devices and hardware													
Using motion control					0								
Using EtherCAT	0	0					0						
Using EtherNet/IP								0					
Using AI functions												0	
Making setup*1													
Making initial settings			0	0									
Preparing to use Control- lers													
Software settings													
Using motion control] [0							
Using EtherCAT								0					
Using EtherNet/IP									0				
Using numerical control										0			
Using AI functions												0	
Writing the user program]									
Using motion control]		0	0						
Using EtherCAT								0					
Using EtherNet/IP					0				0				
Using numerical control					-					0	0		
Using AI functions												0	
Programming error proc- essing													0

							Manual						
		Basi	c inform	ation									
Purpose of use	NY-series IPC Machine Controller Industrial Panel PC Hardware User's Manual	NY-series IPC Machine Controller Industrial Box PC Hardware User's Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Setup User's Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Software User's Manual	NY-series Instructions Reference Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Motion Control User's Manual	NY-series Motion Control Instructions Reference Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Built-in EtherCAT Port User's Manual	NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Built-in EtherNet/IP Port User's Manual	NJ/NY-series NC Integrated Controller User's Manual	NJ/NY-series G code Instructions Reference Manual	NX/NY-series Artificial Intelligence Machine Automation Controller User's Manual	NY-series Troubleshooting Manual
Testing operation and debug-													
ging													
Using motion control						0							
Using EtherCAT				0				0					
Using EtherNet/IP									0				
Using numerical control										0			
Using AI functions												0	
Learning about error management and corrections*2									Δ	Δ		Δ	0
Maintenance													
Using motion control					0								
Using EtherCAT	0	0					0						
Using EtherNet/IP								0					


^{*1.} Refer to the NY-series Industrial Panel PC / Industrial Box PC Setup User's Manual (Cat.No. W568) for how to set up and how to use the utilities on Windows.

^{*2.} Refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)* for the error management concepts and an overview of the error items. However, refer to the manuals that are indicated with triangles (\triangle) for details on errors corresponding to the products with the manuals that are indicated with triangles (\triangle).

Manual Structure

Page Structure

The following page structure is used in this manual.

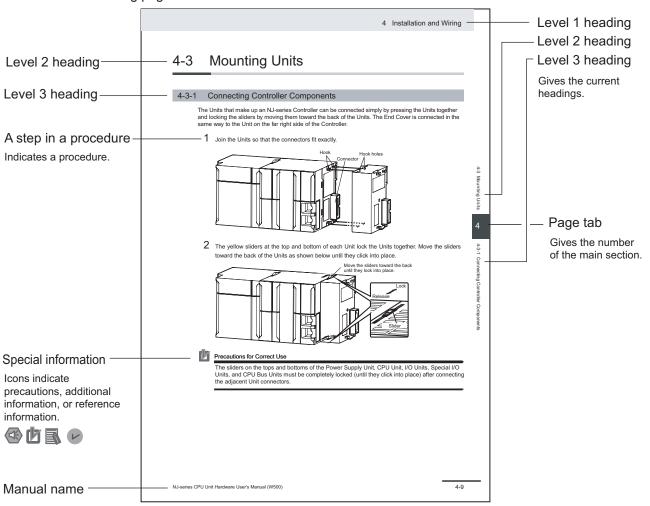

This illustration is provided only as a sample. It may not literally appear in this manual.

Special Information

Special information in this manual is classified as follows:



Precautions for Safe Use

Precautions on what to do and what not to do to ensure safe usage of the product.



Precautions for Correct Use

Precautions on what to do and what not to do to ensure proper operation and performance.



Additional Information

Additional information to read as required.

This information is provided to increase understanding or make operation easier.



Version Information


Information on differences in specifications and functionality for Controller with different unit versions and for different versions of the Sysmac Studio is given.

Precaution on Terminology

- In this manual, download refers to transferring data from the Sysmac Studio to the physical Controller, and upload refers to transferring data from the physical Controller to the Sysmac Studio.
 For the Sysmac Studio, synchronization is used to both upload and download data. Here, synchronize means to automatically compare the data for the Sysmac Studio on the computer with the data in the physical Controller and transfer the data in the direction that is specified by the user.
- Some of the instructions described in this manual apply to both the NX and NY-series Controllers. Therefore, note the following conditions.
 - a) NX-series enables you to connect a computer that runs the Support Software directly to the CPU Unit with a USB connection. However, NY-series has no peripheral USB port. For details, refer to the NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501) or the NY-series Industrial Panel PC / Industrial Box PC Software User's Manual (Cat. No. W558).
 - b) In this manual, the *SD Memory Card* refers to storage used by Al functions. Note that SD Memory Cards inserted to the SD Memory Card slots of NY-series Controllers are for use by Windows and do not use for Al functions. For details on SD Memory Cards of NY-series Controllers, refer to the *NY-series Industrial Box PC Hardware User's Manual (Cat. No. W556)* or the *NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557)*.

Manual Structure

Sections in this Manual

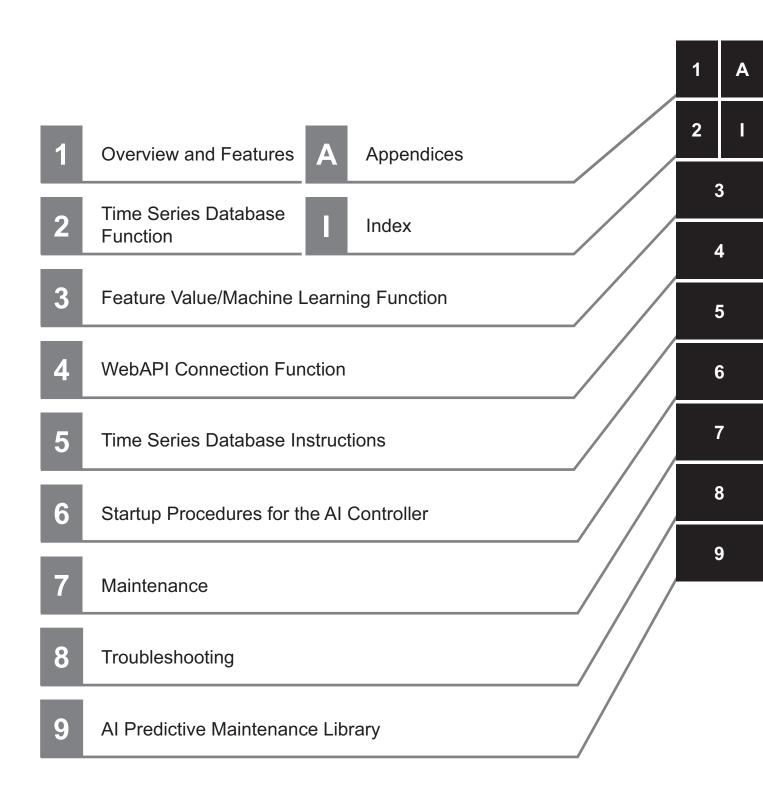

CONTENTS

	Introduction	
	Intended Audience	1
	Applicable Products	1
	Relevant Manuals	2
	Relevant Manuals for NX Series	
	Relevant Manuals for NY Series	
	Tolorant manager of the concession	
	Manual Structure	6
	Page Structure	6
	Special Information	
	Precaution on Terminology	7
	Sections in this Manual	9
	Terms and Conditions Agreement	14
	Warranty, Limitations of Liability	
	Application Considerations	
	Disclaimers	15
	Cofety Drescutions	47
	Safety Precautions	
	Definition of Precautionary Information	
	WARNING	
	Precautions for Safe Use	19
	Precautions for Correct Use	20
	Regulations and Standards	
	Software Licenses and Copyrights	21
	Versions	າາ
	Checking Versions	22
	Related Manuals	24
	Notated mandatements.	
	Terminology	27
	10111111010gy	
	Revision History	29
Sec	ction 1 Overview and Features	
	1-1 Overview	1-2
	1-2 Features	1-3
	1-3 System Configuration	
	1-4 Functional Configurations Related to the Al Controller	
	1-4-1 AI Controller Function	
	1-4-3 Types of Data	
	1-5 Overview of Operating Procedures	
	i o overview or operating i rocedures	

		1-5-1 1-5-2	Data Collection/Data Analysis/Data Utilization	
		1-5-2 1-5-3	Relationship between Al Controller Software and Phases	
1	I-6	List of	Models	1-13
Sectio	n	2 T	ime Series Database Function	
	2-1	Functi	on Overview	2-2
2	2-2	Collec	ted Data	2-4
		2-2-1 2-2-2	Types of Collected Data	2-4
2	2-3		Service Status	
		2-3-1 2-3-2	Status	
		2-3-2	Change Method	
2	2-4	How to	Start and Stop Sampling and Export	2-7
2	2-5	List of	Settings	2-8
2	2-6	Statist	ical Information	2-9
2	2-7	Restri	ctions	2-10
Sectio	n	3 F	eature Value/Machine Learning Function	
3	3-1	Functi	on Overview	3-2
		3-1-1	Frames and Subframes	
		3-1-2 3-1-3	Input Data for the Feature Value/Machine Learning Function Output Data for the Feature Value/Machine Learning Function	
		3-1-3	Al Machine Learning Model	
3	3-2	Details	s on Function	3-5
		3-2-1	I/O Data	
		3-2-2 3-2-3	I/O data Timing Data Structures	
			of the Feature Value/Machine Learning Function	
`	3-3	3-3-1	Status	
		3-3-2	Checking Method	
		3-3-3	Change Method	3-12
3	3-4	Gener	al Specifications	3-14
3	3-5	Calcul	ation Timing	3-15
3	3-6	Restri	ctions	3-16
Sectio	n	4 V	VebAPI Connection Function	
	1-1		on Overview	4-2
4	1-2		of the WebAPI Connection Service	
	_	4-2-1	Status	
		4-2-2	Checking Method	
		4-2-3	Change Method	
	1-3		ansfer Execution Method	
4	1-4		Import Certificates	
4	1-5		erver Connection Check Function	
		4-5-1 4-5-2	Function Specifications	
				T /

	4-6	Operation Processing of the WebAPI Connection Service	4-8
	4-7	File Transfer Results	4-9
	4	-7-1 Transfer Results	
	4	-7-2 Statistical Information	4-9
	4-8	List of Settings	4-11
	4-9	Restrictions	4-13
Sect	ion 5	Time Series Database Instructions	
	Time	Series_ControlService	5-2
		/ariables	
		function	
		Precautions for Correct Use	
		Additional Information	
		Sample Programming	
	Time	Series_ControlSampling	5-6
		ariables	
		unction	
		Related System-defined Variables	
		Precautions for Correct Use	
		Series_ControlExport	
		/ariables	
		function	
		Precautions for Correct Use	
Soct	ion 6	Startup Procedures for the Al Centreller	
Sect	ion 6 - ₆₋₁	•	6-2
Sect	6-1	Overview of Startup Procedures	
Sect		Overview of Startup Procedures	6-6
Sect	6-1 6-2 6-3	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase	6-6 6-8
Sect	6-1 6-2	Overview of Startup Procedures	6-6 6-8 6-14
Sect	6-1 6-2 6-3 6-4 6-5	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase	6-6 6-8 6-14
Sect	6-1 6-2 6-3 6-4 6-5 6-6	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase Using Extension Function	6-6 6-8 6-14 6-15
Sect	6-1 6-2 6-3 6-4 6-5 6-6	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase	6-66-146-156-25
Sect	6-1 6-2 6-3 6-4 6-5 6-6	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection	6-66-146-156-256-28
	6-1 6-2 6-3 6-4 6-5 6-6	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection	6-66-146-156-256-28
	6-1 6-2 6-3 6-4 6-5 6-6	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection	6-66-146-156-256-28
	6-1 6-2 6-3 6-4 6-5 6-6 6-7	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection Maintenance Introduction Data That Is Backed Up and Compatibility Between the Models -2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00)	6-66-146-156-256-287-27-3
	6-1 6-2 6-3 6-4 6-5 6-6 7-1 7-2	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Using Extension Function 6-1 WebAPI Connection Function 6-2 Variable Data Collection Maintenance Introduction Data That Is Backed Up and Compatibility Between the Models 2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00) -2-2 Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00)	6-66-146-156-256-287-27-37-3
	6-1 6-2 6-3 6-4 6-5 6-6 7-1 7-2	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection Maintenance Introduction Data That Is Backed Up and Compatibility Between the Models -2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00) -2-2 Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00) -2-3 Compatibility between the Unit Versions (NX701-Z□00 and NY5□2-Z□00)	6-66-86-156-256-287-27-37-47-4
	6-1 6-2 6-3 6-4 6-5 6-6 7-1 7-2	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection Maintenance Introduction Data That Is Backed Up and Compatibility Between the Models -2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00) -2-2 Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00) -2-3 Compatibility between the Unit Versions (NX701-Z□00 and NY5□2-Z□00) Storage Replacement	6-66-86-156-256-287-27-37-47-5
	6-1 6-2 6-3 6-4 6-5 6-6 6-7 7-1 7-2 7-3	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection Maintenance Introduction Data That Is Backed Up and Compatibility Between the Models -2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00) -2-2 Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00) -2-3 Compatibility between the Unit Versions (NX701-Z□00 and NY5□2-Z□00) Storage Replacement -3-1 Storage Replacement Timing	6-66-86-156-256-287-27-37-47-5
	6-1 6-2 6-3 6-4 6-5 6-6 6-7 7-1 7-2 7-3	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Data Utilization Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection Maintenance Introduction Data That Is Backed Up and Compatibility Between the Models -2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00) -2-2 Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00) -2-3 Compatibility between the Unit Versions (NX701-Z□00 and NY5□2-Z□00) Storage Replacement -3-1 Storage Replacement Timing -3-2 Data Saved in the Storage	6-66-86-156-256-287-27-37-47-57-5
	6-1 6-2 6-3 6-4 6-5 6-6 7-1 7-2 7-3	Overview of Startup Procedures Preliminary Preparation Phase Data Collection Phase Data Analysis Phase Using Extension Function -6-1 WebAPI Connection Function -6-2 Variable Data Collection Maintenance Introduction Data That Is Backed Up and Compatibility Between the Models -2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00) -2-2 Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00) -2-3 Compatibility between the Unit Versions (NX701-Z□00 and NY5□2-Z□00) Storage Replacement -3-1 Storage Replacement Timing	6-66-86-156-256-287-27-37-47-47-57-57-6

Section 8 Troubleshooting

	8-1 Over	view of Errors	8-2
	8-1-1	How to Check for Errors	8-2
	8-1-2	Errors Related to the AI Functions	8-4
	8-2 Trou	bleshooting	8-7
	8-2-1	Error Table	
	8-2-2	Error Description	8-15
Se	ction 9	Al Predictive Maintenance Library	
	9-1 Over	view of Al Predictive Maintenance Library	9-2
	9-2 Featu	ures of Al Predictive Maintenance Library	9-3
	0 = 1 0 0 0		
۸ ۵	nandiaaa		
Aþ	pendices		
	A-1 Spec	ifications	A-2
	A-1-1	Specifications Unique to the AI Controllers	
	A-1-2	Common Specifications with Standard Models	A-5
	A-2 List of	of System-defined Variables	A-6
	A-2-1	Common Variables	A-6
	A-2-2	Time Series Database Function	A-8
	A-2-3	Feature Value/Machine Learning Function	
	A-2-4	WebAPI Function	A-13
	A-3 Spec	ifications for Individual System-defined Variables	A-14
	A-3-1	System-defined Variables for the Overall Al Controller (No Category)	A-14
	A-3-2	AI Function Modules, Category Name: _AIC	
	A-3-3	Al Function Modules, Category Name: _TSDB	
	A-3-4	Al Function Modules, Category Name: _FE	
	A-3-5 A-3-6	AI Function Modules, Category Name: _MLEAI Function Modules, Category Name: _WAC	
		essing in the Data Collection, Data Analysis, and Data Utilization Phases	
	A-4-1	Data Collection Phase	
	A-4-2 A-4-3	Data Analysis Phase	
		Data Utilization Phase	
		File Format	
	A-5-1	Variable Data File (RAW-***.csv)	
	A-5-2 A-5-3	Analysis Data File (ANL-***.csv)	
	A-5-3 A-5-4	Equipment Event Monitoring Result File (AIS-***.csv)	
		on Information	
	A-6-1	Version Information for NX-series AI Controllers	
	A-6-2 A-6-3	Specifications When Not Using the Sysmac Studio Version That Corresponds to the	A-38
	A-0-3	Unit Version of the Al Contoller	A-38

Index

Terms and Conditions Agreement

Warranty, Limitations of Liability

Warranties

Exclusive Warranty

Omron's exclusive warranty is that the Products will be free from defects in materials and work-manship for a period of twelve months from the date of sale by Omron (or such other period expressed in writing by Omron). Omron disclaims all other warranties, express or implied.

Limitations

OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, ABOUT NON-INFRINGEMENT, MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OF THE PRODUCTS. BUYER ACKNOWLEDGES THAT IT ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE.

Omron further disclaims all warranties and responsibility of any type for claims or expenses based on infringement by the Products or otherwise of any intellectual property right.

Buyer Remedy

Omron's sole obligation hereunder shall be, at Omron's election, to (i) replace (in the form originally shipped with Buyer responsible for labor charges for removal or replacement thereof) the non-complying Product, (ii) repair the non-complying Product, or (iii) repay or credit Buyer an amount equal to the purchase price of the non-complying Product; provided that in no event shall Omron be responsible for warranty, repair, indemnity or any other claims or expenses regarding the Products unless Omron's analysis confirms that the Products were properly handled, stored, installed and maintained and not subject to contamination, abuse, misuse or inappropriate modification. Return of any Products by Buyer must be approved in writing by Omron before shipment. Omron Companies shall not be liable for the suitability or unsuitability or the results from the use of Products in combination with any electrical or electronic components, circuits, system assemblies or any other materials or substances or environments. Any advice, recommendations or information given orally or in writing, are not to be construed as an amendment or addition to the above warranty.

See http://www.omron.com/global/ or contact your Omron representative for published information.

Limitation on Liability; Etc

OMRON COMPANIES SHALL NOT BE LIABLE FOR SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR PRODUCTION OR COMMERCIAL LOSS IN ANY

WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED IN CONTRACT, WARRANTY, NEGLIGENCE OR STRICT LIABILITY.

Further, in no event shall liability of Omron Companies exceed the individual price of the Product on which liability is asserted.

Application Considerations

Suitability of Use

Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

Programmable Products

Omron Companies shall not be responsible for the user's programming of a programmable Product, or any consequence thereof.

Disclaimers

Performance Data

Data presented in Omron Company websites, catalogs and other materials is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of Omron's test conditions, and the user must correlate it to actual application requirements. Actual performance is subject to the Omron's Warranty and Limitations of Liability.

Change in Specifications

Product specifications and accessories may be changed at any time based on improvements and other reasons. It is our practice to change part numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the Product may

be changed without any notice. When in doubt, special part numbers may be assigned to fix or establish key specifications for your application. Please consult with your Omron's representative at any time to confirm actual specifications of purchased Product.

Errors and Omissions

Information presented by Omron Companies has been checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical or proofreading errors or omissions.

Safety Precautions

Definition of Precautionary Information

The following notation is used in this manual to provide precautions required to ensure safe usage of the AI Controller.

The safety precautions that are provided are extremely important to safety. Always read and heed the information provided in all safety precautions.

The following notation is used.



Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury. Additionally, there may be severe property damage.

Symbols



The circle and slash symbol indicates operations that you must not do.

The specific operation is shown in the circle and explained in text.

This example indicates prohibiting disassembly.



The triangle symbol indicates precautions (including warnings).

The specific operation is shown in the triangle and explained in text.

This example indicates a precaution against electric shock.



The triangle symbol indicates precautions (including warnings).

The specific operation is shown in the triangle and explained in text.

This example indicates a general precaution.



The filled circle symbol indicates operations that you must do.

The specific operation is shown in the circle and explained in text.

This example shows a general precaution for something that you must do.

WARNING



Check the created parameters for proper execution before you use them for actual operation.



Before you set the parameters, make sure to confirm that no adverse effects will be caused by deviations in the timing of I/O. If you enable multiple data collections and monitoring settings, the task execution time may exceed the task period, I/O may not be refreshed with external devices, input signals may not be read, and output timing may change.



Before you restore backup data, make sure to confirm safety.



Refer to the following manuals for other safety precautions.

• NX-series CPU Unit Hardware User's Manual (Cat. No. W535)

- NY-series Industrial Box PC Hardware User's Manual (Cat. No. W556)
- NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557)

Precautions for Safe Use

- To ensure that equipment events are detected correctly, run the system to perform system evaluation. Depending on the Al Controller settings, equipment events may not be detected as you expected.
- · Check the created parameters for proper execution and then use them for actual operation.

For any other precautions for safe use, refer to the following manuals.

- NX-series CPU Unit Hardware User's Manual (Cat. No. W535)
- NY-series Industrial Box PC Hardware User's Manual (Cat. No. W556)
- NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557)

Precautions for Correct Use

- Do not remove the SD Memory Card (for NX-series) or the SSD (for NY-series) from Drive Bay A
 while you are using the Time Series Database Function. Doing so will prevent these devices from
 saving TimeSeries data normally.
- Before you perform error determination, make sure that both the Feature Extraction Function and the Machine Learning Function are running.
- Before the power is interrupted, make sure to change the TSDB service status to Shutdown.
 If the power is interrupted without stopping the time series database, it could cause your valuable equipment data to be lost and cause the time series database to generate an error at the next power-on.
 - If an error occurs with the time series database, perform necessary actions as specified in the troubleshooting procedures.
- To prevent a loss of data from the unexpected power interruption or momentary power interruption, take appropriate measures for the interruption with the uninterruptible power supply (UPS).
- Data is recorded in a ring buffer of the TimeSeries. Data in the TimeSeries may be overwritten according to the sampling period and the export period. The storage usage volume of the TimeSeries can be checked from the Al Operator. Make sure to adjust the export period when you use the Time Series Database Function.
- When the TimeSeries Record Addition Failed event occurs, replace the TimeSeries storage.
- If you insert a new storage into a wrong drive bay when you replace the storage, the Al Controller may not start up. Make sure to insert an expansion storage into Drive Bay A.
- Do not replace the main storage inserted into the Al Controller to another main storage of a different model. If you do so, it could prevent the Al Controller from starting up.
- If you use an OMRON SD Memory Card, the life expiration of the SD Memory Card can be detected in the following methods.
 - When the life expiration is detected, replace the SD Memory Card.
 - a) _Card1Deteriorated (SD Memory Card Life Warning Flag) system-defined variable
 - b) SD Memory Card Life Exceeded event

For any other precautions for correct use, refer to the following manuals.

- NX-series CPU Unit Hardware User's Manual (Cat. No. W535)
- NY-series Industrial Box PC Hardware User's Manual (Cat. No. W556)
- NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557)

Regulations and Standards

For details on using this product overseas, conformance to EU Directives, KC Certification, and the shipbuilding standards, refer to the following manuals.

- NX-series CPU Unit Hardware User's Manual (Cat. No. W535)
- NY-series Industrial Box PC Hardware User's Manual (Cat. No. W556)
- NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557)

Software Licenses and Copyrights

This product incorporates certain third party software. The license and copyright information associated with this software is available at http://www.fa.omron.co.jp/nj_info_e/.

OpenSSL

This product includes software developed by the OpenSSL Project for use in the OpenSSL Toolkit (http://www.openssl.org/).

Copyright (C) 1995-1998 Eric Young (eay@cryptsoft.com) All rights reserved.

This product includes cryptographic software written by Eric Young (eay@cryptsoft.com)

This Windows version of this product includes software written by Tim Hudson (tjh@cryptsoft.com)

Versions

Hardware revisions and unit versions are used to manage the hardware and software in NX/NY-series Units and EtherCAT slaves. The hardware revision or unit version is updated each time there is a change in hardware or software specifications. Even when two Units or EtherCAT slaves have the same model number, they will have functional or performance differences if they have different hardware revisions or unit versions.

Checking Versions


You can check versions on the ID information indications or with the Sysmac Studio.

Checking Unit Versions on ID Information Indications

The unit version is given on the ID information indication on the side of the product.


Checking the Unit Version of an NX-series CPU Unit

The ID information on an NX-series NX701-Z CPU Unit is shown below.

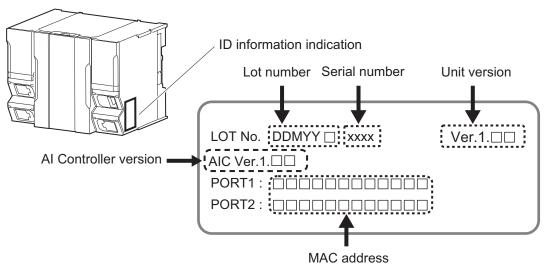

Checking the Unit Version of an NY-series Controller

The ID information on an NY-series NY5 2-Z Controller is shown below.

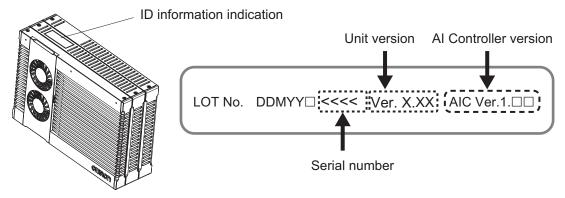

Checking Unit Versions with the Sysmac Studio

You can use the Sysmac Studio to check unit versions. The procedure is different for Units and for EtherCAT slaves.

Checking the Unit Version of an NX-series CPU Unit

You can use the **Production Information** while the Sysmac Studio is online to check the unit version of a Unit. You can do this for the following Unit.

Model	Unit for which version can be checked
NX701-□□□□	CPU Unit

1 Right-click CPU Rack under Configurations and Setup - CPU/Expansion Racks in the Multiview Explorer and select Display Production Information.

The Production Information Dialog Box is displayed.

Checking the Unit Version of an NY-series Controller


You can use the **Production Information** while the Sysmac Studio is online to check the unit version of a Unit. You can only do this for the Controller.


1 Right-click CPU Rack under Configurations and Setup - CPU/Expansion Racks in the Multiview Explorer and select Display Production Information.
The Production Information Dialog Box is displayed.

Changing Information Displayed in Production Information Dialog Box

1 Click the Show Outline or Show Detail Button at the lower right of the Production Information Dialog Box.

The view will change between the Production Information details and outline.





Outline View

Detail View

The information displayed is different for the Outline View and the Detail View. The Detail View displays both the unit version and the Al Controller version. The Outline View displays only the unit versions.

Note The hardware revision is separated by "/" and is displayed on the right of the hardware version. The hardware revision is not displayed for the Unit that the hardware revision is in blank.

Related Manuals

The followings are the manuals related to this manual. Use these manuals for reference.

Manual name	Cat. No.	Model numbers	Application	Description
NX-series CPU Unit	W535	NX701-□□□□	Learning the basic	An introduction to the entire NX701 system
Hardware User's Manual			specifications of the	is provided along with the following infor-
			NX701 CPU Units,	mation on the CPU Unit.
			including introductory	Features and system configuration
			information, design-	Introduction
			ing, installation, and	Part names and functions
			maintenance.	General specifications
			Mainly hardware in-	Installation and wiring
			formation is provided.	Maintenance and inspection
NJ/NX-series CPU Unit	W501	NX701-□□□□	Learning how to pro-	The following information is provided on a
Software User's Manual		NX102-□□□□	gram and set up an	Controller built with an NJ/NX-series CPU
		NX1P2-□□□□	NJ/NX-series CPU	Unit.
		NJ501-□□□□	Unit.	CPU Unit operation
		NJ301-□□□□	Mainly software infor-	CPU Unit features
		NJ101-□□□□	mation is provided.	Initial settings
				Programming based on IEC 61131-3
				language specifications
NJ/NX-series Instructions	W502	NX701-□□□□	Learning detailed	The instructions in the instruction set (IEC
Reference Manual		NX102-□□□□	specifications on the	61131-3 specifications) are described.
		NX1P2-□□□□	basic instructions of	
		NJ501-□□□□	an NJ/NX-series	
		NJ301-□□□□	CPU Unit.	
		NJ101-□□□□		
NJ/NX-series CPU Unit	W507	NX701-□□□□	Learning about mo-	The settings and operation of the CPU Unit
Motion Control User's Man-		NX102-□□□□	tion control settings	and programming concepts for motion con-
ual		NX1P2-□□□□	and programming	trol are described.
		NJ501-□□□□	concepts.	
		NJ301-□□□□		
		NJ101-□□□□		
NJ/NX-series	W508	NX701-□□□□	Learning about the	The motion control instructions are descri-
Motion Control Instructions		NX102-□□□	specifications of the	bed.
Reference Manual		NX1P2-□□□□	motion control in-	
		NJ501-□□□□	structions.	
		NJ301-□□□□		
		NJ101-□□□□		
NJ/NX-series	W505	NX701-□□□□	Using the built-in	Information on the built-in EtherCAT port is
CPU Unit		NX102-□□□□	EtherCAT port on an	provided.
Built-in EtherCAT® Port		NX1P2-□□□□	NJ/NX-series CPU	This manual provides an introduction and
User's Manual		NJ501-□□□□	Unit.	provides information on the configuration,
		NJ301-□□□□ NJ101-□□□□		features, and setup.
NI I/NIV agrica	14/500	+	I laine the built in	Information on the built in EthanNot/ID mont
NJ/NX-series CPU Unit	W506	NX701-□□□□	Using the built-in EtherNet/IP port on	Information on the built-in EtherNet/IP port
		NX102-□□□□ NX1P2-□□□□	an NJ/NX-series	is provided. Information is provided on the basic setup,
Built-in EtherNet/IP [™] Port		NJ501-□□□□	CPU Unit.	tag data links, and other features.
User's Manual		NJ301-□□□□	or o onit.	tag data iiriks, arid otrici icatules.
		NJ101-□□□□		
NX-series	W596	NX701-□□20	Using the FINS func-	Describes the FINS function of an NX-ser-
CPU Unit	VV390	NX102-□□□□	tion of an NX-series	ies CPU Unit.
FINS Function		14/10/2-111111	CPU Unit.	ico oi o oiit.
User's Manual			or o offic.	
OGGI 3 IVIGITUGI		1		

Manual name	Cat. No.	Model numbers	Application	Description
NX/NY-series Artificial Intelligence Machine Automation Controller User's Manual	W594	NX701-Z□□□ NY532-Z□□□ NY512-Z□□□	Learning about the NX/NY-series Artificial Intelligence Machine Automation Controller.	Describes the NX/NY-series Artificial Intelligence Machine Automation Controller overview, AI function specifications, system start-up, maintenance, and error details.
Al Controller Standard Software Operation Manual	W611	SYSMAC-AICSTE□ □L	Learning an introduc- tion of the AI Control- ler standard software and how to use it.	An introduction of the AI Controller standard software (AI Operator, AI Viewer), installation procedures, basic operations, connection operations, and operating procedures for main functions are described.
Sysmac Library Al Predictive Maintenance Li- brary User's Manual	W610	SYSMAC-ZPA□□ □000W	Learning about AI predictive mainte- nance library and FB specifications.	Information necessary to use AI predictive maintenance library is provided.
NJ/NX-series Troubleshooting Manual	W503	NX701-□□□□ NX102-□□□□ NX1P2-□□□□ NJ501-□□□□ NJ301-□□□□ NJ101-□□□□	Learning about the errors that may be detected in an NJ/NX-series Controller.	Concepts on managing errors that may be detected in an NJ/NX-series Controller and information on individual errors are described.
Sysmac Studio Version 1 Operation Manual	W504	SYSMAC -SE2□□□	Learning about the operating procedures and functions of the Sysmac Studio.	Describes the operating procedures of the Sysmac Studio.
NY-series IPC Machine Controller Industrial Panel PC Hardware User's Manual	W557	NY532-□□□□	Learning the basic specifications of the NY-series Industrial Panel PCs, including introductory information, designing, installation, and maintenance. Mainly hardware information is provided.	An introduction to the entire NY-series system is provided along with the following information on the Industrial Panel PC. • Features and system configuration • Introduction • Part names and functions • General specifications • Installation and wiring • Maintenance and inspection
NY-series IPC Machine Controller Industrial Box PC Hardware User's Manual	W556	NY512-□□□□	Learning the basic specifications of the NY-series Industrial Box PCs, including introductory information, designing, installation, and maintenance. Mainly hardware information is provided.	An introduction to the entire NY-series system is provided along with the following information on the Industrial Box PC. Features and system configuration Introduction Part names and functions General specifications Installation and wiring Maintenance and inspection
NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Setup User's Manual	W568	NY532-□□□□ NY512-□□□□	Learning about initial setting of the NY-series Industrial PCs and preparations to use Controllers.	The following information is provided on an introduction to the entire NY-series system. Two OS systems Initial settings Industrial PC Support Utility NYCompolet Industrial PC API Backup and recovery

Manual name	Cat. No.	Model numbers	Application	Description
NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Software User's Manual	W558	NY532-□□□□	Learning how to program and set up the Controller functions of an NY-series Industrial PC.	The following information is provided on the NY-series Controller functions. Controller operation Controller features Controller settings Programming based on IEC 61131-3 language specifications
NY-series Instructions Reference Man- ual	W560	NY532-□□□□ NY512-□□□□	Learning detailed specifications on the basic instructions of an NY-series Indus- trial PC.	The instructions in the instruction set (IEC 61131-3 specifications) are described.
NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Motion Control User's Manual	W559	NY532-□□□□ NY512-□□□□	Learning about motion control settings and programming concepts of an NY-series Industrial PC.	The settings and operation of the Controller and programming concepts for motion control are described.
NY-series Motion Control Instructions Reference Manual	W561	NY532-□□□□ NY512-□□□□	Learning about the specifications of the motion control instructions of an NY-series Industrial PC.	The motion control instructions are described.
NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Built-in EtherCAT® Port User's Manual	W562	NY532-□□□□ NY512-□□□□	Using the built-in EtherCAT port in an NY-series Industrial PC.	Information on the built-in EtherCAT port is provided. This manual provides an introduction and provides information on the configuration, features, and setup.
NY-series IPC Machine Controller Industrial Panel PC / Industrial Box PC Built-in EtherNet/IP [™] Port User's Manual	W563	NY532-□□□□ NY512-□□□□	Using the built-in EtherNet/IP port in an NY-series Indus- trial PC.	Information on the built-in EtherNet/IP port is provided. Information is provided on the basic setup, tag data links, and other features.
NY-series Troubleshooting Manual	W564	NY532-□□□□ NY512-□□□□	Learning about the errors that may be detected in an NY-series Industrial PC.	Concepts on managing errors that may be detected in an NY-series Controller and information on individual errors are described.

Terminology

Term	Description
AIC	It is a package name indicating the Al Controller.
Al Operator	It is a tool to configure the AI function settings of the AI Controller as well as to monitor the status.
Al machine learning model	It is the data to monitor existence of equipment events by the Al Controller.
Al Viewer	It is a tool to visualize feature values and results of equipment events that are output by the Feature Value/Machine Learning Function. The AI Operator reads out data transferred from the AI Controller and displays it on a computer for the users to view.
Al Predictive Mainte- nance Library	It is one of the function components of the Sysmac Library in order to use the Al functions of the Al Controller.
Isolation Forest	It is an algorithm used for quantifying the degree of deviation from the normal range. For the Al Controllers, it is used for calculating equipment event monitoring scores.
TimeSeries	It is a unit of databases that are used in the Time Series Database Function. It is the database used for storing values of the variables in chronological order before generating an CSV file.
TSDB	It is a package name meaning TimeSeries DataBase.
WAC	It is a package name meaning WebAPI Connection.
WebAPI Connection Function	It is a function designed to transfer files from the AI Controller to the web server periodically.
machine learning output frame variables	It is a variable that is used to link an equipment event monitoring result with a frame. When an equipment event is output, a value of the corresponding frame variable is also output to this variable.
server certificate	It is an X.509 electronic certificate that certifies a web server. A web server generates and manages this certificate along with the secret key of the certificate.
subframe	It is a more detailed time range that is targeted for calculation within a frame.
Time Series Data- base Function	It is a function designed to collect variables and calculation result data of the Feature Value/ Machine Learning Function in chronological order.
equipment event	It refers to a certain event that occurs on the equipment. It includes equipment events that will lead to quality problems and productivity problems (e.g. minor stops).
equipment event monitoring result	It is the judgment result indicating if an equipment event is present. It consists of the level (Normal, Alarm Level 1, Alarm Level 2) and the equipment event monitoring score.
Equipment event monitoring result file	It is a file containing the equipment event monitoring results that were calculated by the Feature Value/Machine Learning Function. The file name is AIS-****.csv (**** is time data).
equipment event monitoring score	It quantifies the degree of the existence of an equipment event. The larger value indicates that an equipment event is present.
feature extraction output frame variables	It is a variable that is used to link a feature value with a frame. When a feature value is output, a value of the corresponding frame variable is also output to this variable.
feature value	It is the data indicating the feature of variable data.
feature value calcu- lation method	It is a conversion method for obtaining a feature value from variable data. The examples of methods include averaging and standard deviation.
Feature Value/ Machine Learning Function	It is a function that extracts features and patterns from the running equipment and determines whether equipment events occur based on the extracted results and the AI machine learning model.

Term	Description
Feature value file	It is a file containing feature values that are calculated by the Feature Value/Machine Learning
	Function.
	The file name is FTR-****.csv (**** is time data).
frame	It is a range in which feature values are calculated by the Feature Value/Machine Learning Func-
	tion.
Analysis data file	It is a file containing data used for generating an AI machine learning model.
	The file name is ANL-****.csv (**** is time data).
Variable data file	It is a file containing values of the variables.
	The file name is RAW-****.csv (**** is time data).
root certificate	It is the certificate installed in the client and used for checking if the server certificate retrieved from
	a web server is trusted. Only the server certificates that are trusted by the root certificate are con-
	sidered as trusted certificates.

Revision History

A manual revision code appears as a suffix to the catalog number on the front and back covers of the manual.

Cat. No. W594-E1-02

Revision code

Revision code	Date	Revised content	
01	October 2018	Original production	
02	July 2019	Made changes accompanying release of unit version 1.21 of the NX-series CPU Units and NY-series Controllers.	

Revision History



Overview and Features

This section describes the overview and features of the Al Machine Automation Controller.

1-1	Over	view	1-2
1-2	Featu	ıres	1-3
1-3	Syste	em Configuration	1-5
1-4	Func	tional Configurations Related to the Al Controller	1-6
	1-4-1	Al Controller Function	
	1-4-2	Al Controller Software	
	1-4-3	Types of Data	
1-5	Overv	view of Operating Procedures	1-11
	1-5-1	Data Collection/Data Analysis/Data Utilization	
	1-5-2	Relationship between AI Functions and Phases	
	1-5-3	Relationship between Al Controller Software and Phases	
1-6	List o	of Models	1-13

1-1 Overview

The Al Machine Automation Controllers (Abbreviation: Al Controllers) refer to NX-series Machine Automation Controllers and Industrial PC Platform NY-series Controllers with Al functions.

The AI functions are designed to improve the equipment's utilization rate as they detect equipment events (events that occur in the equipment, e.g. errors that cause quality issues) including equipment errors and the end of service life, as well as behaviors that are the signs of such events. In addition, the AI Controller software (AI Operator and AI Viewer) allows you to monitor equipment events easily without the special knowledge of mathematics or statistics.

When you use the Al Controller in all three phases of data collection, analysis, and utilization, you can expect the equipment's utilization rate to rise. An engineer of OMRON supports your needs in all phases.

The NX-series Machine Automation Controllers and the Industrial PC Platform NY-series Controllers are the basis of the Al Controller and have the following features.

The NX-series Machine Automation Controllers and the Industrial PC Platform NY-series Controllers are the next-generation controllers that provide the functionality and high-speed performance that are required for machine control, as well as the safety, reliability, and serviceability that are required for industrial controllers.

They provide the functionality of previous OMRON PLCs and the functionality required for motion control. Synchronized control of I/O devices on high-speed EtherCAT can be applied to safety devices, vision systems, motion equipment, discrete I/O, and more.

OMRON offers the new Sysmac Series of control devices designed with unified communications specifications and user interface specifications. The NX-series Machine Automation Controllers and the Industrial PC Platform NY-series Controllers are part of the Sysmac Series. You can use them together with EtherCAT slaves, other Sysmac products, and the Sysmac Studio Automation Software to achieve optimum functionality and ease of operation.

With a system that is created from Sysmac products, you can connect components and operate the system through unified concepts and usability.

1-2 Features

The AI Controller has the following features.

Inherited NX-series and NY-series Controller Functions

The AI Controller has inherited the PLC function of the conventional NX-series or NY-series Controllers. In addition to the conventional PLC function, it also has the AI function that allows you to monitor equipment events. This allow you to control the Controller by PLC function and monitor the equipment events by the AI function.

Data Collection by the Time Series Database Function

The Al Controller has the Time Series Database Function designed for data collection in the storage^{*1} mounted to the NX-series and NY-series Controllers. The data collection intervals are synchronized with the PLC function module's scheduling. Using the synchronized data allows you to use the data for improving and recording the equipment.

*1. An SD Memory Card is provided with the NX-series Al Controller.

Feature Value/Machine Learning Function

- The Feature Value/Machine Learning Function is loaded on the NX-series Controllers and the NY-series Controllers.
- By downloading the AI machine learning model to the Feature Value/Machine Learning Function loaded on the AI Controller, the AI Controller can monitor the equipment events. The AI machine learning model refers to data acquired through machine learning and statistics technologies.

Function to Upload Files to Web Server Securely

The NX-series and NY-series Controllers have a function that periodically upload files that are stored in them to a web server with the HTTPS protocol. This function is useful for transferring equipment status data including calculation results of the AI function to a Web server and for analyzing the data.

Sysmac Library - AI Predictive Maintenance Library

The AI Predictive Maintenance Library is one of the function components of the Sysmac Library software to use the AI functions of the AI Controller. The AI predictive maintenance library makes the programming for using AI functions easier.

Visualization by NA-series Programmable Terminals

With NA-series Programmable Terminals, you can monitor the results that the AI Controller determined on site. You can also monitor the operating status of the AI functions that operate in the AI Controller.


You can easily create the NA-series programmable terminal screen because the screen data for the Al Controllers is provided.

1-3 System Configuration

The system configuration of the AI Controller is described below.


The NX-series and NY-series Controllers have the three AI functions: "Time Series Database Function", "Feature Value/Machine Learning Function", and "WebAPI Connection Function". In addition, the two types of support software for the AI Controller, "AI Operator" and "AI Viewer", are available

Install a web server if you want to transfer files of the results calculated by the Al Controller to a web server.

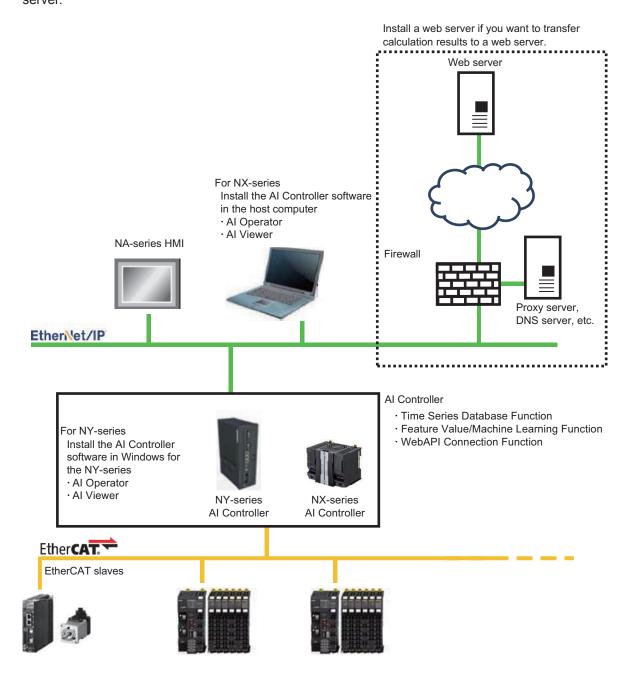

1-4 Functional Configurations Related to the Al Controller

This section describes the function blocks related to the Al Controller.

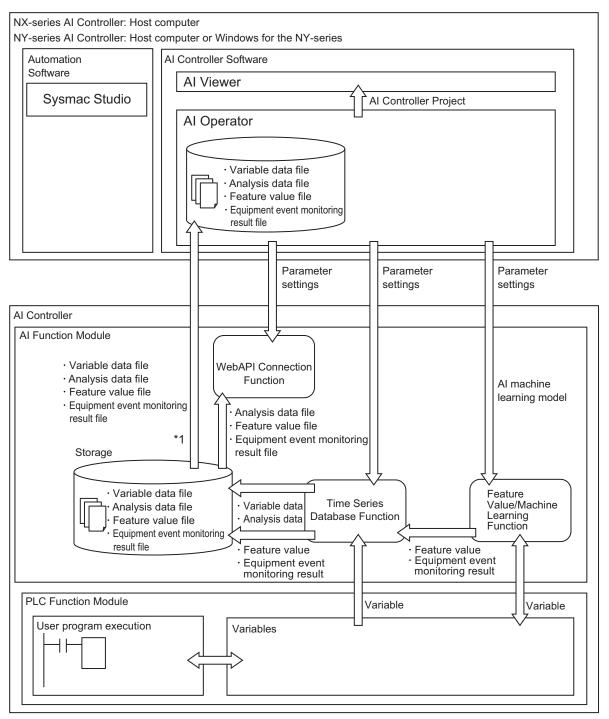

^{*1.} The FTP protocol is used for transferring files from the Al Controller to the Al Operator. When you use Al Operator, you can use three FTP server connections on the Al Controller.

1-4-1 Al Controller Function

Time Series Database Function

The Time Series Database Function collects values of user-specified variables and calculation results of the Feature Value/Machine Learning Function into the storage for each sampling interval. This function allows you to collect data such as variable values to the storage without program. The collected data can be checked on the Al Viewer. In addition, the data can be transferred to a web server by the WebAPI Connection Function.

Feature Value/Machine Learning Function

The Feature Value/Machine Learning Function determines whether equipment events occur from the collected data and AI machine learning model. It consists of the Feature Extraction Function and the Machine Learning Function. The Feature Extraction Function calculates feature values from data. The Machine Learning Function on the other hand determines whether equipment events occur from feature values and AI machine learning model.

WebAPI Connection Function

The WebAPI Connection Function transmits data (CSV files) that is collected by the Time Series Database Function in the AI Controller to a web server periodically. This function can be used to transfer data (CSV files) that are collected by the Time Series Database Function to a web server and to save and analyze data.

Considering that data will be transmitted via Internet, data is encrypted in the transmission path to the web server.


1-4-2 Al Controller Software

"Al Operator" and "Al Viewer" are the software exclusively designed for the Al Controller. The functions of each software are described below.

Al Operator

The Al Operator is a tool to configure Al function (Time Series Database Function, Feature Value/ Machine Learning Function, WebAPI Connection Function) settings of the Al Controller as well as to monitor the status. It works on Windows.


The Al Operator also provides a function for transferring results of calculation performed by the Feature Value/Machine Learning Function from the Al Controller to a computer.

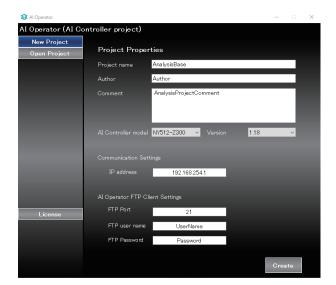

Al Viewer

The Al Viewer is a tool to visualize feature values and results of equipment events that are output by the Feature Value/Machine Learning Function. It works on Windows.

The Al Operator reads out data transferred from the Al Controller and displays it on a computer for the users to view.

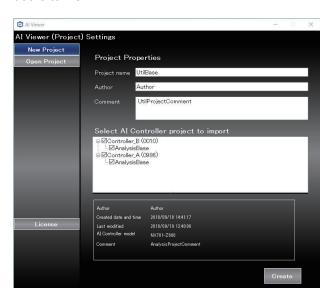

1-4-3 Types of Data

This section describes data that is exchanged between function blocks.

Data name	Description		
Variable data	Variable data refers to the Al Controller variable values necessary to monitor equipment events.		
Analysis data	Analysis data refers to variable data with the frame variables and sub-frame variables added. Refer to Section 2 Time Series Database Function on page 2-1 for details and forms variables.		
Feature value	tails on frame variables and subframe variables. It is a numeric value indicating the feature of analysis data. The feature values are calculated by the Feature Value/Machine Learning Function.		
Equipment event monitoring results	They are the monitoring results of equipment events. The results are calculated by the Feature Value/Machine Learning Function and collected in the storage by the Time Series Database Function.		
Al machine learning model	It refers to data (calculation method of feature value, threshold values, etc.) necessary to monitor equipment events. An engineer of OMRON generates the model from analysis data. The data needs to be downloaded from the Al Operator to the Al Controller in advance. The Al Controller calculates results based on the data and monitors the equipment events.		
Al Controller project	They are the Al Viewer setting file including equipment event names and feature values, which is generated by the Al Operator. The Al Viewer uses this file to display the equipment event monitoring results.		

1-5 Overview of Operating Procedures

This section describes the operating procedure for the Al Controller. There are three phases in the operating procedure: *Data Collection*, *Data Analysis*, and *Data Utilization*. You can use the Al Controller by following the steps in order.

1-5-1 Data Collection/Data Analysis/Data Utilization

The operation details performed in each phase of data collection, data analysis, and data utilization are described below.

Phase	Description		
Data Collection	Run the equipment and collect data on the equipment's operation status. You need to decide variables to collect and specify them to the Al Controller with the Al Operator. You will then run the equipment and collect analysis data. The analysis data are collected in the storage of the Al Controller.		
Data Analysis	An AI machine learning model is generated from the analysis data that was collected in the Data Collection Phase. The AI machine learning model is downloaded to the AI Controller. The AI machine learning model is generated by an engineer of OMRON.		
Data Utilization	The AI Controller determines whether an equipment event is present. An equipment event is determined from data that was collected while the AI machine learning model and the equipment were actually running. The determination results of equipment events are recorded in the storage and output to the AI Viewer. Make sure to check that equipment events can be detected in this phase. If the events can not be detected, perform the Data Collection Phase or Data Analysis Phase again.		

1-5-2 Relationship between Al Functions and Phases

The AI functions used for each phase are described below.

	Al functions		
Phase	Time Series Database Function	Feature Value/Machine Learning Function	WebAPI Connection Function
Data Collection	Collects data during equipment operation and generates a file (CSV file) of the variable data and analysis data in the storage of the Al Controller.	This function is not used.	This function is not used.
Data Analysis	This function is not used.	This function is not used.	This function is not used.
Data Utiliza- tion	Collects feature values and determination results of equipment events calculated by the Feature Value/Machine Learning Function in the storage. Analysis data can also be collected.	Calculates the feature values from variable data and performs the determination of the equipment events from the calculated feature values and the AI machine learning model. The determined results can be checked on the AI Viewer.	Transfers data (CSV files) that are generated by the Time Series Database Function, to a web server periodically.

1-5-3 Relationship between Al Controller Software and Phases

The AI Controller software used for each phase are described below.

Phase	Al Controller Software		
Filase	Al Operator	Al Viewer	
Data Collection	Configure the Time Series Database Function.	This software is not used.	
Data Analysis	Download the AI machine learning model to the AI Controller. The AI machine learning model is generated by an engineer of OMRON.	This software is not used.	
Data Utiliza- tion	Check the operating status of the AI functions (Time Series Database Function, Feature Value/Machine Learning Function, WebAPI Connection Function).	Load the eature values and determination results of equipment events collected in the storage of the AI Controller on a computer to visualize them.	

1-6 List of Models

The following table describes the AI Controller models and software that you use. Refer to A-6-1 Version Information for NX-series AI Controllers on page A-38 or A-6-2 Version Information for NY-series AI Controllers on page A-38 for information on the unit version of the AI Controller and each software version.

Series name	Model	Software that you use
NX-series AI Controller	NX701-Z600 NX701-Z700	Sysmac Studio*1 Al Operator
		Al Viewer
NY-series AI Controller	NY512-Z300 NY512-Z400 NY512-Z500 NY532-Z300 NY532-Z400 NY532-Z500	 Sysmac Studio*1*2 Al Operator Al Viewer Industrial PC Support Utility*3 Rescue Disk Creator*3

^{*1.} Before you perform the Al Controller programming on the Sysmac Studio, the license registration is required. For details on the procedures of the license registration, refer to *Displaying and Registering Licenses* in the *Sysmac Studio Version1 Operation Manual (Cat. No. W504)*.

- *2. Refer to the file below for the NY-series AI Controllers.

 D:\OMRON-NY\Installers\AI_Controller_Standard_Software\README.txt
- *3. It is pre-installed in the NY-series Al Controller. The latest version is available from the download page of the OMRON website (http://www.omron-cxone.com/ipc-platform/index_en.html).

1 Overview and Features




Time Series Database Function

This section describes the Time Series Database Function that is included in the Al Controller.

2-1	Func	tion Overview	2-2
2-2	Colle	cted Data	2-4
	2-2-1 2-2-2	Types of Collected Data	2-4 2-4
2-3	TSDE	3 Service Status	2-5
_	2-3-1	Status	
	2-3-2	Checking Method	2-5
	2-3-3	Change Method	2-6
2-4	How	to Start and Stop Sampling and Export	2-7
2-5	List	of Settings	2-8
2-6	Statis	stical Information	2-9
2-7	Resti	rictions	2-10

2-1 Function Overview

The Time Series Database Function allows you to save user-specified variables and calculation results of the Feature Value/Machine Learning Function into the storage of the Al Controller. Collected data is first saved in a database called TimeSeries and then saved in the storage. High-speed data recording was made possible by installing a database functionality inside the Al Controller. The operation of saving data into TimeSeries is referred to as "sampling", and the operation of saving data from TimeSeries to the storage is referred to as "export".

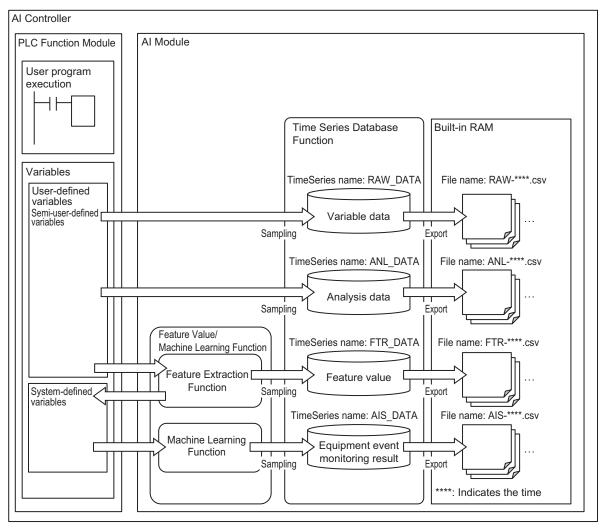

• TimeSeries and the storage type vary for the NX-series and the NY-series as described below. When you use the AI Controller, insert the SD Memory Card or the SSD into Drive Bay A.

Series name	Storage location of TimeSeries	Storage location of CSV file
NX-series	SD Memory Card	Built-in RAM
NY-series	SSD in drive bay A	Built-in RAM

• The general specifications are as follows:

TimeSeries	Item	Specifications
TimeSeries common	Method	Time-series database (It uses a circular queue where the oldest data is deleted if it reaches the maximum number of data.)
	Number of TimeSeries	4
	Sampling start/stop method	It can be executed in any of the following methods: • Al Operator • System-defined variables • Instructions
	Export start/stop method	It can be executed in any of the following methods: • Al Operator • System-defined variables • Instructions
	Number of used variables with a Retain attribute	2*1
Variable data (RAW_DATA)	Size of the TimeSeries	NX-series: 900 MB NY-series: 41 GB
	Number of variables [variables/ record]*2	1024
	Category of variable	Global variable
	Variable type	 The following variables can be specified: Basic data types Specifying a whole array or elements of an array Specifying a whole structure or union, or members of a structure or a union
Analysis data (ANL_DATA)	Size of the TimeSeries database	NX-series: 1 GB NY-series: 30 GB
	Number of variables [variables/ record]*2	2048 (including variable data, frame variables, subframe variables, and label variables)
	Category of variable	Global variable
	Variable type	The following variables can be specified:Basic data typesSpecifying array elements:Specifying members of a structure or a union

^{*1.} The Time Series Database Function uses two variables with a Retain attribute in the system. The maximum number of available variables with a Retain attribute is 39,998.

^{*2.} A record refers to a set of data saved in the TimeSeries in a sampling task. It corresponds to a row in the exported CSV file.

2-2 Collected Data

2-2-1 Types of Collected Data

This section describes data that is collected in the storage by the Time Series Database Function. The collected data (CSV files) can be visualized and checked on the AI Viewer.

Name of the collected file	TimeSeries	Description	Phase in which collected data is used
RAW-***.csv*1	RAW_DATA	Variable data are collected.	Data Collection
		Variable data to collect can be configured on the Al Operator.	
ANL-***.csv*1	ANL_DATA	Variable data, frame variables*2, and subframe varia-	Data Analysis
		bles ^{*2} are collected. This data is used in the Data Analysis Phase.	
FTR-***.csv*1	FTR_DATA	Feature values calculated by the Feature Extraction Function are collected.	Data Utilization
AIS-***.csv*1	AIS_DATA	Monitoring results of the equipment events calculated by the Machine Learning Function are collected.	Data Utilization

^{*1. *****} indicates the time (in the format of YYYYMMddHHMMSSsss) when a file was created. For example, when a file was created on January 2, 2018, at 12:15 and 30 seconds 333 milliseconds, it shows 20180102121530333.

2-2-2 Collection Timing

Variable Data (RAW_DATA)/Analysis Data (ANL_DATA)

The TSDB service, which realizes the Time Series Database Function, collects values of all the specified variables by *system common processing 2* of the primary periodic task.

For details on the system common processing 2, refer to the NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501).

Feature Values (FTR_DATA)/Equipment Event Monitoring Results (AIS_DATA)

They are collected at the operation timing of the Feature Value/Machine Learning Function. This timing cannot be changed.

^{*2.} Refer to Section 3 Feature Value/Machine Learning Function on page 3-1 for details on frame variables and subframe variables.

2-3 TSDB Service Status

TSDB service is a service that realizes the Time Series Database Function. TSDB is an abbreviation for Time Series Data Base.

2-3-1 Status

The TSDB service has the following status.

The status is changed regardless of the operating mode (PROGRAM or RUN mode) of the Al Controller.

Status	Description	Conditions for status transition	
Idle	It indicates that the TSDB service is stopped except for the cases of errors.	 Instructions or commands by the AI Operator*1 Downloading by the Sysmac Studio Clear all memory Restore execution of the Sysmac Studio Controller Backups 	
Running	The TSDB service is running. Sampling and export are ready to be executed. Refer to 2-4 How to Start and Stop Sampling and Export on page 2-7 for details on the execution method.	 When there is no error after powering on the AI Controller When there is no error after the controller reset for the AI Controller Instructions or commands by the AI Operator*1 	
Error	The service cannot be started due to errors (corruption of the setting file, etc.) of the TSDB service. When there is an error in the service		
Shutdown	The TSDB service has been shut down. The AI Controller power is ready to be turned off. Once the service has entered in this state, you can no longer set the TSDB service to running status again.	 Instructions or commands by the AI Operator*1 Instruction by system variables*2 Shutdown of the NY-series AI Controller When a major fault level error occurs 	

^{*1.} The instruction used here is the TimeSeries_ControlService instruction.

2-3-2 Checking Method

You can check the TSDB service status from the *_TSDB_Status* system defined variable. While the status transition is in progress, the members of the *_TSDB_Status* system defined variable changes to FALSE.

Status	Members of	the _TSDB_S	tatus system	defined variable
Status	.ldle	.Run	.Error	.Shutdown
Idle	TRUE	FALSE	FALSE	FALSE
Running	FALSE	TRUE	FALSE	FALSE
Error	FALSE	FALSE	TRUE	FALSE
Shutdown	FALSE	FALSE	FALSE	TRUE

^{*2.} The system-defined variable used here is _TSDB_ShutdownCmd. The shutdown processing is executed when this variable changes to TRUE.

2-3-3 Change Method

You can send a command to start, stop, or shutdown the service with an instruction or the Al Operator.



Precautions for Correct Use

- Before the power is interrupted, make sure to change the TSDB service status to *Shutdown*. If the power is interrupted without stopping the time series database, it could cause your valuable equipment data to be lost and cause the time series database to generate an error at the next power- on.
 - If an error occurs with the time series database, perform necessary actions as specified in the troubleshooting procedures.
- To prevent a loss of data from the unexpected power interruption or momentary power interruption, take appropriate measures for the interruption with the uninterruptible power supply (UPS).

Instructions

The status can be changed with the TimeSeries_ControlService instruction. Refer to *TimeSeries_ControlService* on page 5-2 for details on how to use the instruction.

Al Operator

To modify the status, go to the **Monitor/Operation** - **TSDB Function** screen on the Al Operator, and click the **Start**, **Stop**, or **Shutdown** Button for the TSDS service.

2-4 How to Start and Stop Sampling and Export

The following describes the procedure to start and stop sampling and export.

Transfer type	TimeSeries	Start and stop method
Sampling	RAW_DATA ANL_DATA	When you use a start or stop command in any of the following methods while the TSDB service is running, you can start or stop the sampling. • Al Operator • System-defined variables*1
		• Instructions ^{*2} Refer to Section 5 Time Series Database Instructions on page 5-1 for details on how to use the instructions.
	FTR_DATA AIS_DATA	Sampling is executed while the TSDB service and the Feature Value/Machine Learning Function are running. The start or stop command by a user cannot be accepted.
Export	RAW_DATA ANL_DATA FTR_DATA AIS_DATA	When you use a start or stop command in any of the following methods while the TSDB service is running, you can start or stop the export. • Al Operator • System-defined variables*3 • Instructions*4 Refer to Section 5 Time Series Database Instructions on page 5-1 for details on how to use the instructions.

^{*1.} The system-defined variables here refer to _TSDB_SmplStartCmd (Sampling Start Command) and _TSDB_SmplStopCmd (Sampling Stop Command). The start processing and stop processing are executed when these variables are loaded.

- *2. The instruction used here is the TimeSeries_ControlSampling instruction.
- *3. The system-defined variables here refer to _TSDB_ExptStartCmd (Export Start Command) and _TSDB_ExptStopCmd (Export Stop Command). The start processing and stop processing are executed when these variables are loaded.
- *4. The instruction used here is the TimeSeries_ControlExport instruction.

2-5 List of Settings

The settings for the Time Series Database Function are described below. These settings can be set from the Al Operator.

Al Operator screen	Setting	Description	Corre- spond- ing TimeS- eries	Set value	Default
Equipment Event Settings	Linked Variables	Specify variable data to collect in analysis data (ANL-****.csv).	ANL_D ATA		None
	Frame Variable (ANY_INT)	Specify a frame variable to collect in analysis data (ANL-***.csv).			None
	Sub-frame Varia- ble (BOOL)	Specify a subframe variable to collect in analysis data (ANL-***.csv).			None
	Label Variable (ANY_INT)	Specify a label variable to collect in analysis data (ANL-***.csv).			None
Extension Func. Variable Data Collection	Registered varia- ble name	Specify variable data to collect in variable data (RAW-****.csv) as the extension function.	RAW_D ATA		None
Extension Func. Detailed Settings	Number of export- ed records	When the number of records accumulated in the TimeSeries reaches the	RAW_D ATA	Always 10,000	
		number of export records specified here, export is executed.	ANL_D ATA		
			FTR_D ATA	10,000 to 1	10,000
			AIS_DA TA		10,000
	Export execution cycle	Even when the number of records accumulated in the TimeSeries does not	RAW_D ATA	Always 1s	
		reach the number of export records, export is executed after the export exe-	ANL_D ATA		
		cution period specified here.	FTR_D ATA	100 to 1	10
			AIS_DA TA		10

2-6 Statistical Information

Statistical information of the Time Series Database Function can be verified on **Statistics** - **TSDB Function** screen on the Al Operator.

The Al Operato	or's statistical information display	Description
TimeSeries in-	Storage usage (Byte)	It specifies the usage volume of the TimeSeries.
formation	Number of records stored	It specifies the number of records stored in TimeSer-
		ies.
	Time of the latest record	It specifies the time of the latest record stored in TimeSeries.
	Time of the oldest record	It specifies the time of the oldest record stored in TimeSeries.
Sampling proc- essing	Number of executed samplings	It specifies the number of sampling processes executed for TimeSeries.
	Sampling execution failure count	It specifies the number of sampling failed for data in TimeSeries.
	Maximum sampling time [ms]	It specifies the maximum sampling time per record in TimeSeries.
	Average sampling time [ms]	It specifies the average sampling time per record in TimeSeries.
Internal buffer status	Maximum number of records accumulated in the internal buffer	This field is used by an engineer of OMRON.
	Number of records discarded by internal buffer	This field is used by an engineer of OMRON.
	Number of records currently accumulated in internal buffer	This field is used by an engineer of OMRON.
Export process-	Maximum export time [ms]	It specifies the maximum value of export time.
ing	Average export time [ms]	It specifies the average value of export time.
	Export execution count	It specifies the number of export executed.

2-7 Restrictions

The following restrictions apply to the Time Series Database Function.

- When the AI Controller power was turned off with the TSDB service status set to other than "Shutdown", the contents of the TimeSeries and CSV files cannot be guaranteed. Make sure to turn off or reset the AI Controller after you shut down the TSDB service.
- Data is recorded in a ring buffer of the TimeSeries. Data in the TimeSeries may be overwritten according to the sampling period and the export period. The storage usage volume of the TimeSeries can be checked from the Al Operator. Make sure to adjust the export period when you use the Time Series Database Function.
- In some cases, values of variables in all the periods are not retrieved in an CSV file. You can check
 the index*1 field of the CSV file to check if all the data has been retrieved. If all the data was not
 retrieved, perform the following:
 - a) Reduce the volume of variables (size and number of variables) to collect.
 - b) Increase the task period of the primary periodic task.
 - c) Decrease the export period.
 - d) Secure the execution time for the system services.
- *1. For details on the index in the CSV file, refer to Appendices on page A-1.
- Since the storage to output files is in the RAM area, files are deleted when you turn OFF the AI Controller power or reset the controller. Before you turn OFF the AI Controller or reset the controller, make sure to read out the data on the AI Operator or transfer the data with the WebAPI function.
- If you are using an NX-series AI Controller, the 8 GB memory out of the 16 GB SD Memory Card is
 used for the AI functions. Therefore, the remaining 8 GB is available for the users. Refer to
 A-1-1 Specifications Unique to the AI Controllers on page A-2 for the specifications of an SD
 Memory Card.
- The task processing period becomes longer when the TSDB function is activated. After you run the TSDB function, make sure to perform the system evaluation. Note that *Execution Time Estimation Mode* of the Simulator on the Sysmac Studio is not supported.



Feature Value/Machine Learning Function

This section describes the Feature Value/Machine Learning Function that is included in the AI Controller.


3-1	Funct	tion Overview	3-2
	3-1-1	Frames and Subframes	
	3-1-2	Input Data for the Feature Value/Machine Learning Function	
	3-1-3	Output Data for the Feature Value/Machine Learning Function	
	3-1-4	Al Machine Learning Model	3-4
3-2	Detai	ls on Function	3-5
	3-2-1	I/O Data	
	3-2-2	I/O data Timing	
	3-2-3	Data Structures	
3-3	Statu	s of the Feature Value/Machine Learning Function	3-11
	3-3-1	Status	
	3-3-2	Checking Method	3-12
	3-3-3	Change Method	3-12
3-4	Gene	ral Specifications	3-14
3-5	Calcu	ılation Timing	3-15
3-6	Restr	ictions	3-16

3-1 Function Overview

The Feature Value/Machine Learning Function determines whether equipment events occur in the running status data (frame variables, variable data, and subframe variables) of the equipment in the Data Utilization Phase. It consists of the Feature Extraction Function and the Machine Learning Function.

The Feature Extraction Function calculates feature values^{*1} from data. Meanwhile, the Machine Learning Function determines whether equipment events occur from the calculated feature values.

The equipment event determination results are output to the Time Series Database Function and to the system-defined variables.

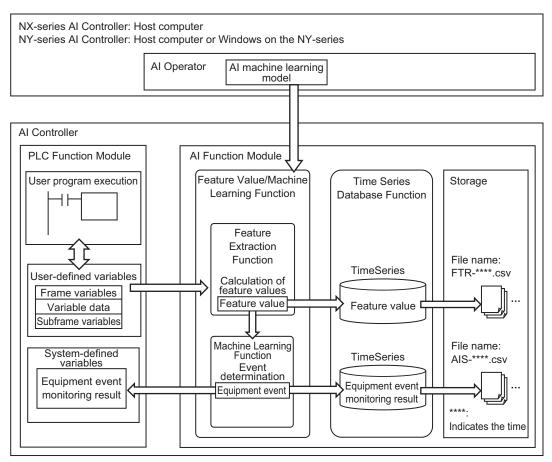


*1. The feature values refer to the quantified features and patterns that are generated from variable data within a certain time range based on the statistics.

3-1-1 Frames and Subframes

A frame is the range in which feature values are calculated by the Feature Extraction Function. It is also possible to identify a time range in which values are calculated within a frame, which is referred to as a subframe. The subframe setting is optional.

When the frame changes, the Feature Extraction Function calculates feature values from the variable data in the time frame specified with a subframe (or by a frame when subframe is not specified). Feature values are calculated for each variable data.

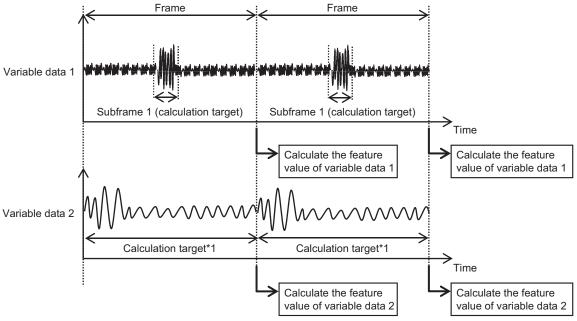

*1. Subframes are not set, so calculations will be performed on the frames.

Specify a single movement of the equipment to fit within one frame. For a press machine that repeats the same movement, set a single press operation to one frame.

To clarify the features, you need to specify an interval for the subframe within a frame. In the case of a press machine, for example, the subframe variable is used to specify the pressing interval if you determine the event at press operation.

3-1-2 Input Data for the Feature Value/Machine Learning Function

Input frame variables, variable data, and subframe variables to the Feature Value/Machine Learning Function.

Input data	Description
Frame variables	You can include a frame variable to the user program and write a value from the user program to specify a frame. The Feature Value/Machine Learning Function calculates a feature value when the value of the frame variable changes.
Variable data	Variables that are necessary for monitoring equipment events are specified as variable data. The Feature Value/Machine Learning Function identifies the characteristics of the variable data and monitors equipment events.
Subframe variables	You can include a frame variable to the user program and write a value from the user program to specify a subframe. The Feature Value/Machine Learning Function calculates feature values based on the variable data while the subframe variable (BOOL) is TRUE.

3-1-3 Output Data for the Feature Value/Machine Learning Function

The equipment event monitoring result, which was calculated by the Feature Value/Machine Learning Function, is output to the Time Series Database Function and to the system-defined variables. The name of a file generated by the Time Series Database Function is *AIS-***.csv* (*** specifies the time) and the data can be visualized on the AI Viewer. In addition, the system-defined variables are output to the *Equipment Event Monitoring Result* (MLE Result).

3-1-4 Al Machine Learning Model

The Al machine learning model is required for the Feature Value/Machine Learning Function to perform calculation.

An engineer of OMRON generates the AI machine learning model in the Data Analysis Phase from the analysis data collected in the Data Collection Phase. In the Data Utilization Phase, you need to download the AI machine learning model to the AI Controller. This model is used for the Feature Value/Machine Learning Function to perform calculation of feature values and to determine equipment events.

Refer to A-4 Processing in the Data Collection, Data Analysis, and Data Utilization Phases on page A-28 for details on the Al machine learning model.


3-2 Details on Function

This section describes the function details of the Feature Value/Machine Learning Function. The Feature Value/Machine Learning Function executes processing in the following order from (1) through (4).

- 1. The Feature Extraction Function reads out variable data, frame variables, and subframe variables from the running equipment.
- 2. The feature value is calculated from the read data and Al machine learning model and is then written to the Time Series Database Function and to the system-defined variables.
- 3. The Machine Learning Function reads out the feature value.
- 4. Based on the read data and the AI machine learning model, the Machine Learning Function determines whether equipment events occur and writes them to the system-defined variables and to the Time Series Database Function as the equipment event monitoring results.

The equipment event monitoring results are comprised of the following:

- · Equipment event monitoring score that shows the degree of the equipment event occurrence
- Judgment results of the equipment event level (Normal, Alarm Level 1, Alarm Level 2)

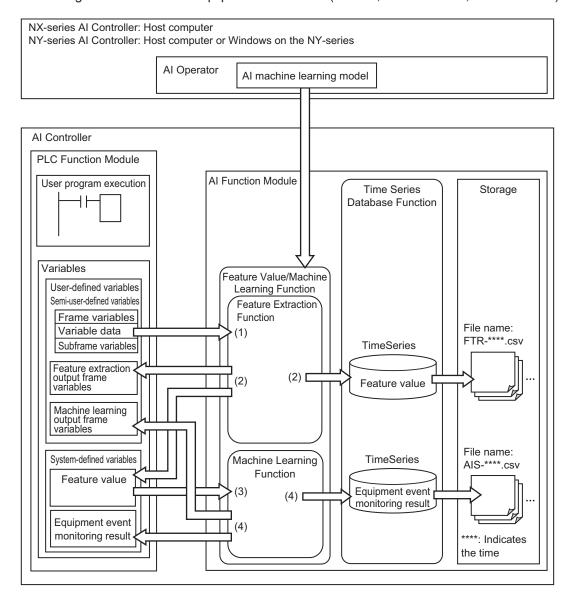

3-2-1 I/O Data

This section describes I/O data for the Feature Extraction Function and the Machine Learning Function.

Interfaces with the Al Operator

Function	Data name	Format	Description
Feature Value/ Machine Learn- ing	Al machine learning model	File	This is the data required for determining if any equipment events occur in the running status data (frame variables, variable data, and subframe variables) of the equipment in the Data Utilization Phase. An engineer of OMRON generates an AI machine learning model from the analysis data collected in the Data Collection Phase. Download the provided model to your AI Controller.

Interfaces with the PLC Function Modules

Function	Data name	Type of variable	Data type	Variable type	Description
Feature Ex- traction	Frame variables	User-de- fined varia- bles/Semi- user-de- fined varia- bles/ System-de- fined varia- bles	SINT, INT, DINT, LINT, USINT, UINT, UDINT, ULINT	Global variable	The time interval (frame) that the Feature Extraction Function uses to calculate the feature value from variable data is specified by this variable. Feature values are calculated for each frame. A single frame is a time interval between the value change of this valuable and the next value change.
	Variable da- ta	User-de- fined varia- bles/Semi- user-de- fined varia- bles/ System-de- fined varia- bles	LREAL, BOOL*1	Global variable	This variable is collected for determining if any equipment event occur. Specify a variable used for determining an equipment event. For example, enter a sensor value or a servo speed here.
	Subframe variables*2	User-de- fined varia- bles/Semi- user-de- fined varia- bles/ System-de- fined varia- bles	BOOL	Global variable	Use this variable to specify an interval (subframe) in the frame where the feature value is actually calculated. An interval in which this variable is TRUE is where the feature value is calculated. Create a user program for manipulating values of the subframe variables.
	Feature ex- traction out- put frame variables	User-de- fined varia- bles*3	Same variable type that is set to the frame variables.	Global variable	The Feature Extraction Function outputs a value of the frame variable to this variable when the feature value is output. This allows users to check which frame the feature value belongs to.
Feature Value/ Machine Learning	Feature value	System-de- fined varia- ble (_FE_Re- sult)	ARRAY [0127, 015] OF_LREAL		This is a feature value calculated by the Feature Extraction Function. The Machine Learning Function uses the value of this variable. The first element of the array is an equipment event ID displayed on the Status Monitoring screen of the Al Viewer. The second element of the array is a feature value ID displayed on the Trend Graph screen of the Al Viewer.

Function	Data name	Type of variable	Data type	Variable type	Description
Machine Learning	Machine learning output frame varia- bles	User-de- fined varia- bles*4	Same variable type that is set to the frame variables.	Global variable	The Machine Learning Function outputs a value of the frame variable to this variable when the equipment event monitoring result is output. This allows users to check which frame the equipment event monitoring result belongs to.
	Equipment event moni- toring result	System-de- fined varia- ble (_MLE_Re- sult)	ARRAY [0127] OF_sMLE_ RESULT*5		The Machine Learning Function outputs the determination result whether or not an equipment event occur. The array element correspond to the IDs of the equipment event list on the Al Operator.

^{*1.} When you set a non-LREAL or non-BOOL variable to the variable data, convert the variable to the LREAL data in the user program.

- *2. The settings of subframe variables are optional. It is also possible to skip the subframe variable settings from the AI Operator. In addition, subframe variables can be used for LREAL variable data. (Subframe variables cannot be used for the BOOL variable data.)
- *3. For the feature extraction output frame variables, specify variables that are different from *frame variables*, machine learning output frame variables, or feature extraction output frame variables for another equipment event.
- *4. For the machine learning output frame variables, specify variables that are different from *frame variables*, *feature extraction output frame variables*, or *machine learning output frame variables* for another equipment event.
- *5. For details on _MLE_Result, refer to *A-3 Specifications for Individual System-defined Variables* on page A-14 and *A-2 List of System-defined Variables* on page A-6.

Interfaces with the Time Series Database Function

Function	Data name	Description of data
Feature Extrac-	Feature value	Calculates the feature value and outputs the value to the Time Series Da-
tion		tabase Function.
Machine learn-	Equipment	Determines if there is any equipment event and outputs the event results
ing	event monitoring	to the Time Series Database Function.
	result	


3-2-2 I/O data Timing

The following timing chart shows the timing of I/O data from the Feature Value/Machine Learning Function.

The feature value is calculated based on the task period of primary periodic task that is the same timing when the frame variable is switched. The calculated value is then output to the system-defined variables (feature value).

Subsequently, determine if any equipment event occur after the next primary periodic task period, and then the value is output to the system-defined variables (equipment event monitoring result). The value of the frame variable specified in the user program is output to the feature value output frame variable and to the machine learning output frame variable.

Data shown in the figure such as "AAAA" is a value example used for description purposes.

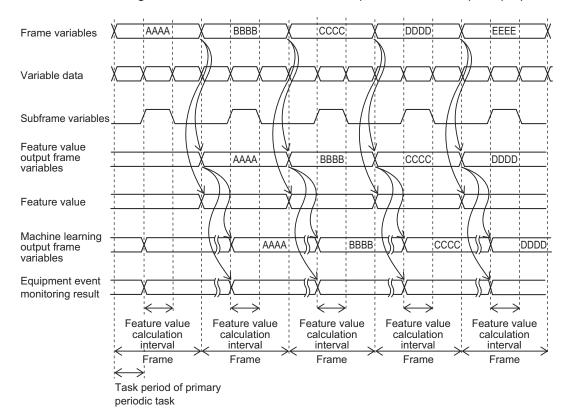


3-2-3 Data Structures

The structures of data that is input or output by the Feature Value/Machine Learning Function are as shown below.

Up to 128 equipment events can be registered.

For each equipment event, up to 16 feature values (up to 16 variable data and six subframe variables) can be specified.

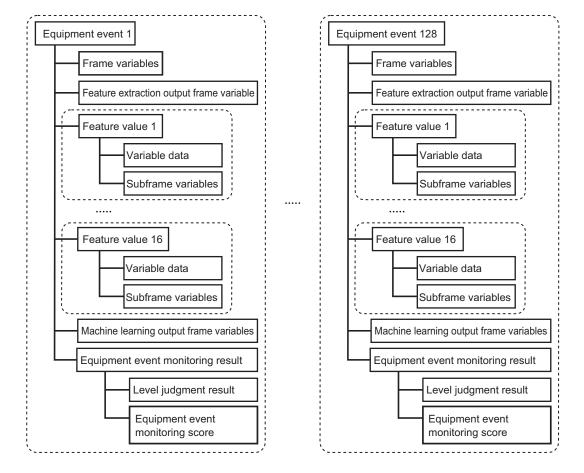

3-3 Status of the Feature Value/Machine Learning Function

3-3-1 Status

The Feature Extraction Function and the Machine Learning Function have the status described below.

Feature Extraction Function

Status	Description	Conditions for status transition
Initializing	The Feature Extraction Function is running after the Al Controller power is turned on.	During the AI Controller power-on or at the Controller reset time until the status changes to <i>Loading</i> status
Loading	The settings of the Feature Extraction Function are being loaded.	 During the AI Controller power-on or at the Controller reset time until the status changes to <i>Idle</i> or <i>Error</i> status Settings are downloaded from Sysmac Studio or the AI Operator time until the status changes to <i>Idle</i> or <i>Error</i> status The restore for the backup functions is executed*1 time until the status changes to <i>Idle</i> or <i>Error</i> status
Idle	The Feature Extraction Function is stopped.	 System-defined variables or instructions by the AI Operator The operating mode of the AI Controller is PROGRAM mode When a major fault level error occurs
Running	The Feature Extraction Function is running.	System-defined variables or instructions by the Al Operator*2
Error	The operation cannot be performed due to an error in the setting parameters of the Feature Extraction Function.	When an error occurs with the Feature Extraction Function

^{*1.} The backup functions refer to the SD Memory Card backup function, the automatic transfer from SD Memory Card function, and the Sysmac Studio Controller Backups.

Machine Learning Function

Status	Description	Conditions for status transition
Initializing	The Machine Learning Function is running after the Al Controller power is turned on.	During the Al Controller power-on or at the Controller reset time until the status changes
	·	to Loading status

^{*2.} The AI Controller must be in the RUN mode.

Status	Description	Conditions for status transition
Loading	The settings of the Machine Learning Function are being loaded.	 During the AI Controller power-on or at the Controller reset time until the status changes to <i>Idle</i> or <i>Error</i> status Settings are downloaded from Sysmac Studio or the AI Operator time until the status changes to <i>Idle</i> or <i>Error</i> status The restore for the backup functions is executed*1 time until the status changes to <i>Idle</i> or <i>Error</i> status
Idle	The Machine Learning Function is stopped.	 System-defined variables or instructions by the Al Operator The operating mode of the Al Controller is PROGRAM mode When a major fault level error occurs
Running	The Machine Learning Function is running.	System-defined variables or instructions by the Al Operator*2
Error	The operation cannot be performed due to an error in the setting parameters of the Machine Learning Function.	When an error occurs with the Machine Learning Function

^{*1.} The backup functions refer to the SD Memory Card backup function, the automatic transfer from SD Memory Card function, and the Sysmac Studio Controller Backups.

3-3-2 Checking Method

You can check the status of the Feature Extraction Function and the Machine Learning Function from the system-defined variables.

Status	Feature Extraction Function Value of the _FE_Status system-de- fined variable	Machine Learning Function Value of the _MLE_Status system-defined variable
Running	_FE_STATUS_RUN	_MLE_STATUS_RUN
Idle	_FE_STATUS_IDLE	_MLE_STATUS_IDLE
Initializing	_FE_STATUS_INITIALIZE	_MLE_STATUS_INITIALIZE
Loading	_FE_STATUS_LOAD	_MLE_STATUS_LOAD
Error	_FE_STATUS_PARAMETER_ERROR	_MLE_STATUS_PARAMETER_ERROR

3-3-3 Change Method

The status of the Feature Extraction Function and the Machine Learning Function can be changed with the system-defined variables or on the Al Operator.

System-defined Variables

You can change the status to Running or Idle by assigning a value to the system-defined variables.

Status to Be Changed	Feature Extraction Function	Machine Learning Function	
Running	_FE_Enable := TRUE;	_MLE_Enable := TRUE;	

^{*2.} The AI Controller must be in the RUN mode.

Status to Be Changed	Feature Extraction Function	Machine Learning Function	
Idle	_FE_Enable := FALSE;	_MLE_Enable := FALSE;	

Al Operator

The status can be changed by opening **Monitor/Operation** - **F.E./M.L. Function** screen on the Al Operator and selecting the **Enable** or **Disable** Button.

3-4 General Specifications

The general specifications of the Feature Value/Machine Learning Function are described below.

	Ite	Specifications		
lumber of equipn	nent events	128 max.		
In each equip- ment event	Frame variables		Number of variables that can be registered	1
			Supported da- ta type	SINT, INT, DINT, LINT, USINT, UINT, UDINT, ULINT
	Feature extraction output frame variables		Number of variables that can be registered	1
			Supported da- ta type	Same types as the frame variables
	Feature value		Number of variables that can be registered	16 max.
	Per feature value	Variable data	Number of variables that can be registered	1
			Supported da- ta type	LREAL, BOOL
		Subframe variables	Number of variables that can be registered	1*1
			Supported da- ta type	BOOL
	Machine learning output frame variables		Number of variables that can be registered	1
			Supported da- ta type	Same types as the frame variables
	Number of classifications for equipment event monitoring		ipment event	3 (Normal, Alarm Level 1, Alarm Level 2)
quipment event	detection algorith	isolation forest		

^{*1.} Up to six subframe variables can be registered to an equipment event.

3-5 Calculation Timing

The Feature Extraction Function is executed in *system common processing 2* of the primary periodic task.

The Machine Learning Function is executed in system service.

For details on system common processing 2 and system service, refer to the NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501).

3-6 Restrictions

The following restrictions apply to the Feature Value/Machine Learning Function.

- When the AI functions are added, the task execution time becomes longer because of the calculation performed by the Feature Value/Machine Learning Function. After you add the AI functions, make sure to perform the system evaluation. Note that *Execution Time Estimation Mode* of the Simulator on the Sysmac Studio is not supported.
- Use the AI machine learning model provided by an engineer of OMRON. If you change the file contents, it will not only prevent equipment events from being detected but also cause the AI Controller to generate an error.
- Equipment events are monitored based on past data. This means that equipment event monitoring results may differ according to physical changes in the equipment or changes in the environment.
- To ensure that equipment events are detected correctly, run the system to perform system evaluation. Depending on the Al Controller settings, equipment events may not be detected as you expected.
- To ensure that equipment events are detected correctly, when you reuse the AI machine learning model, run the system to perform system evaluation. Depending on differences between equipment, etc., equipment events may not be detected as you expected.
- Because the Machine Learning Function needs the calculation period, the equipment event determination result is not output in the same task period as the frame switching interval. Consider this aspect and perform the system evaluation.
- Data is recorded in a ring buffer of TimeSeries of the Time Series Database Function. Depending on the export period setting, feature values that were output to the TimeSeries and the old equipment event monitoring results may be overwritten.



Precautions for Correct Use

If you determine equipment events, make sure that both the Feature Extraction Function and the Machine Learning Function are *Running*.



WebAPI Connection Function


This section describes the WebAPI Connection Function that is installed in the AI Controller.

4-1	Funct	tion Overview	4-2
4-2	Statu : 4-2-1 4-2-2 4-2-3	S of the WebAPI Connection Service Status Checking Method Change Method	4-4 4-4
4-3	File T	ransfer Execution Method	4-5
4-4	How t	to Import Certificates	4-6
4-5	Web \$ 4-5-1 4-5-2	Server Connection Check Function Function Specifications Application Method	4-7
4-6	Opera	ation Processing of the WebAPI Connection Service	4-8
4-7	File T 4-7-1 4-7-2	ransfer Results Transfer Results Statistical Information	4-9
4-8	List o	f Settings	4-11
4-9	Restr	ictions	4-13

4-1 Function Overview

The WebAPI Connection Function transfers data (CSV files) collected by the Time Series Database Function from the AI Controller to the Web server periodically. You will use this function when you transfer data (CSV files) collected by the Time Series Database Function to the Web server and save and analyze the data.

Since the WebAPI Connection Function works by configuring the settings on the Al Operator, you do not prepare a user program to transfer files.

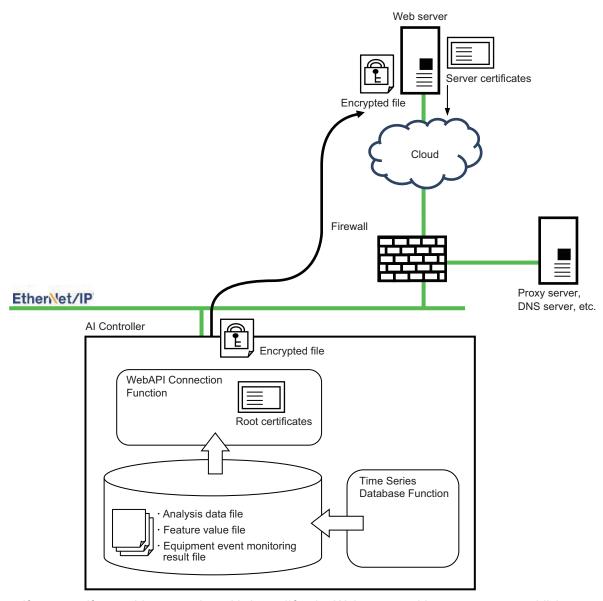

• If you specify an address starting with https:// for the Web server address, you can establish SSL/TSL communications.

(You need to import the root certificate of the Web server to the Al Controller.)

- You can access the Web server via a proxy server.
- You can use a DNS server and specify the Web server address as a host name.



Precautions for Correct Use

To use the WebAPI Connection Function, you need to install or build a Web server.

The general specifications are as follows.

	Item		Specifications
Function specifi-	Execution trigger		File transfer can be executed in the period specified by a user on the Al Operator.
cations	Destination specificat	ion	Specify a URL of the server to which files are transferred. Specify a URL starting with http:// or https://. When you specify https://, SSL/TLS communications are established.
	File deletion after tran	nsfer	Once the file has been transferred to the Web server successfully, the WebAPI Connection Function deletes the file in the AI Controller.
	Connection check fur	action	To check the connection with the Web server, a file transfer can be triggered by the Al Operator at a given timing. Refer to 4-5 Web Server Connection Check Function on page 4-7 for details.
	Transfer specification	S	If there is more than one file to transfer at the transfer timing, all the files are transferred. If the last file transfer is in progress and the next file transfer timing arrives, the execution of the last file transfer continues.
	Transfer protocol		The file transfer executes in accordance with the RFC1867 procedures. The multipart/form-data in the form is used. The tag name "datafile" is used for the transfer.
Commu-	HTTP/HTTPS client	Supported versions	1.1
nication		DNS	Supported
specifi-		Proxy	Supported
cations		Basic authentication	Supported (Basic authentication for the proxy server and Web server connection is supported.)
		Number of files that can be transferred simultaneously	3
	Security (when	TLS version	1.0, 1.1, 1.2
	https://is specified for the address)	Server certificates	Import the certificates to the AI Controller with the AI Operator. Up to 32 certificates can be set
		Revocation check for the certificates	Revocation is checked by OSCP stapling.

4-2 Status of the WebAPI Connection Service

4-2-1 Status

The WebAPI connection service has the following status.

Status	Description	Conditions for status transition
Initializing	The WebAPI connection service was started but has not entered the idle state after the AI Controller is started.	During the Al Controller pow- er-on or at the Controller re- set time until the status changes to <i>Idle</i> status
Idle	The WebAPI connection service is stopped.	 Commands by the Al Operator Shutdown of the Al Controller (NY-series) Controller reset of the Al Controller Downloading by Sysmac Studio Clear all memory Restore execution of the backup function *1
Running	The WebAPI connection service is running. (The file transfer is being executed.)	 Commands by the Al Operator Setting the automatic activation of the WebAPI service to Yes
Error	The service cannot run due to errors (corruption of the volatile memory, etc.) of the WebAPI connection service.	When there is an error with the WebAPI connection serv- ice

^{*1.} The backup functions refer to the SD Memory Card backup function, the automatic transfer from SD Memory Card function, and the Sysmac Studio Controller Backups.

4-2-2 Checking Method

You can check the status of the WebAPI connection service on the AI Operator.

The status can be checked by opening the **Monitor/Operation** - **WebAPI Connection Function** screen on the AI Operator and selecting **Status** for WebAPI connection service.

4-2-3 Change Method

You can change the status of the WebAPI connection service on the AI Operator.

The status can be modified by opening **Monitor/Operation** - **WebAPI Connection Function** screen on the AI Operator and selecting **Start** or **Stop** button.

4-3 File Transfer Execution Method

You can start and stop the file transfer in the following methods.

Item	Method	Use cases	Description
Start	Commands by the AI Operator	When file transfer is executed by a user instruction only for a certain period	When you open Monitor/Operation and the WebAPI Connection Function screen and click Start, the WebAPI connection service enters in the running state and executes file transfer in the specified period.
	Turning the Al Controller power on, resetting the Controller, or enabling automatic start after settings are changed	When file transfer is executed at all times while the AI Controller power is turned on	When you open WebAPI Connection - Basics - Service Settings and set the Automatic activation of Service set- ting to Yes the WebAPI connection serv- ice enters in the running state and exe- cutes file transfer in the specified period when the AI Controller power is turned on or after the Controller is reset.
Stop	Commands by the AI Operator	When file transfer is executed by a user instruction only for a certain period	When you open Monitor/Operation and the WebAPI Connection Function screen and click Stop , the WebAPI connection service enters in the idle state and stops the file transfer.

4-4 How to Import Certificates

When you specify *https://* to the server where you transfer files, you need to import the root certificate of the web server to the Al Controller so that the Controller can authenticate the web server. You can import the certificate to the Al Controller by selecting **WebAPI Connection** - **Certificate** screen on the Al Operator.

4-5 Web Server Connection Check Function

4-5-1 Function Specifications

This function is triggered from the AI Operator and executes a file transfer in a given timing in order to check connection between the WebAPI Connection Function of the AI Controller and the Web server. The function specifications are described below.

Item	Function specifications
Destination	The file is transferred to the destination URL that is set on the Al Operator.
Transfer file name	The file name format of a file to be transferred is as follows:
	WebAPI_UploadTest_ <connection no.="">*1_<yyyymmddhhmmss>*2.csv</yyyymmddhhmmss></connection>
	(The file to be transferred is prepared by the system. Users do not need to create this file.)
Executable state	When the WebAPI connection service is in the idle or running state, the file transfer by this function can be executed.
Retry	The set value of connection retry is not used. A file transfer is executed once only.
Timeout	It runs in accordance with the set value of transfer timeout period.
Execution results	The execution results can be checked on the Al Operator.
	Refer to 4-8 List of Settings on page 4-11 for details.
Operation after execution	When the file transfer succeeds while the File Upload Failed error is present, the
	error is cleared.

^{*1.} This is the connection number assigned to the Web server to which data is transferred. (Numeric value from 01 to 03)

4-5-2 Application Method

To execute this function, go to **Monitor/Operation - WebAPI Connection Function - File Upload** screen on the AI Operator, and then click **Confirm Cnct.**.

^{*2.} This is the time information in the year, month, day, hour, minute, and second format.

W558).

4-6 Operation Processing of the WebAPI Connection Service

The WebAPI connection service runs in the system services of the Al Controller.

For details on the system services, refer to the NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501) or the NY-series Industrial Panel PC / Industrial Box PC Software User's Manual (Cat. No.

4-7 File Transfer Results

4-7-1 Transfer Results

You can check the file transfer results for the three web servers that you registered by opening the **Monitor/Operation** screen on the Al Operator and by using **WebAPI Connection Function**.

The meaning of the results you can check on the Al Operator is described below.

Results displayed on the Al Operator	Description
Disable	The WebAPI connection service settings are set to Do not use
	The WebAPI connection service is in the state other than running
Ready	The WebAPI connection service is enabled but file transfer was never executed
	There is no file to transfer
	Time that is set to the transfer period, is not reached yet.
Success	The last file transfer succeeded
Fault	The last file transfer failed

4-7-2 Statistical Information

Statistical information of the file transfer for each connection number can be checked on **Statistics** - **WebAPI Connection** screen on the AI Operator.

The meaning of the statistical information you can check on the Al Operator is described below.

Statistical info	ormation display of the Al Operator	Description
Transmission target	Number of files currently set as the transfer target	It is the number of files transferred in the Controller.
Transmission succeeded	Total transferred files	It is the total number of files that were successfully transferred to the server.
	Total transfer bytes	It is the total number of bytes for the files that were successfully transferred to the server.
	Total transfer time	It is the total transfer time for files that were successfully transferred to the server.
	The latest transfer start time	It is the start time of a last successful file transfer.
	The latest transfer completion time	It is the completion time of a last successful file transfer.
	Average transfer time of 1 file	It is the average value of the transfer time of a file that was successfully transferred to the server.
	Minimum transfer time of 1 file	It is the minimum value of the transfer time of a file that was successfully transferred to the server.
	Maximum transfer time of 1 file	It is the maximum value of the transfer time of a file that was successfully transferred to the server.
	Transfer time of the latest file	It is the transfer time of a last successful file transfer.
	Average transfer rate of 1 file	It is the average value of the transfer rate of a file that was successfully transferred.
	Minimum transfer rate of 1 file	It is the minimum value of the transfer rate of a file that was successfully transferred.
	Maximum transfer rate of 1 file	It is the maximum value of the transfer rate of a file that was successfully transferred.
	Transfer rate of the latest file	It is the transfer rate of a last successful file transfer.

Statistical info	rmation display of the Al Operator	Description
Transmission	Connection failed count	It is the number of failed connections with the Web,
failed		proxy, or DNS server.
	Transfer failed count	It is the number of times that the file transfer failed. (It
		does not include the number of failed connections.)
Latest send error code		It is the error code of the last failed file transfer.
	The latest send error detection time	It is the detection time of the failure when the last file
		transfer failed.
	The latest send error recovery time	It is the recovery time from the failure when the last file
		transfer failed.

4-8 List of Settings

The settings for the WebAPI Connection Function are described below. These settings can be configured by the AI Operator.

Service Settings

The Al Operator screen	Sett	ting name	Description	Set value	Default	
WebAPI Connectio n Setting - Basics -	Automatic activation of Service		Specify whether to start for the WebAPI connection service when the AI Controller starts running.	Yes/No	No	
Service Settings	Proxy settings	Use	Specify whether to use a proxy server.	Yes/No	No	
		Address (Host name)*1	Specify an IP address or host name of the proxy server.	128 characters or less (case sensitive)		
		Port No.*1	Specify the destination port number of the proxy server.	1 to 65535		
			Authentica- tion*1	Specify if you use or do not use the basic authentication of your proxy server.	Yes/No	No
		User name*1 *2	Specify a user name for your proxy server's basic authentication.	1 to 128 characters (case sensitive)		
		Password*1 *2	Specify a password for your proxy server's basic authentication.	1 to 128 characters (case sensitive)		

^{*1.} The setting is enabled when you use a proxy server.

^{*2.} The setting is enabled when you use the basic authentication of the proxy server.

• File Upload Setting

Up to three sets of the following settings can be configured according to each TimeSeries.

The Al Operator screen	Sett	ing name	Description	Set value	Default
WebAPI Connectio	Use/Do not use		Specify whether to use the file upload function.	Yes/No	No
n Setting - Basics - File Upload	Send Data	<u>*</u> 1	Specify which TimeSeries' CSV file to transfer.	Analysis data (ANL_DA- TA)/Feature (FTR_DATA)/ Equipment Event Monitor- ing Results (AIS_DATA)	
Settings	URL*1		Specify a URL of the server to which files are transferred. Example: https://omronsample.co.jp:8080/upload.php	256 characters (not case sensitive)	
	Transfer set-tings*1	Cycle [sec]	Specify a period for trans- ferring files to the web server.	1 to 60	10
	S	Transfer time- out time [sec]	Specify a timeout period of the file transfer to the web server.	1 to 600	120
	Authentication set-tings*1	Authentication	Specify whether to use the basic authentication of the web server.	Yes/No	No
		User ID*2	Specify a user name for the basic authentication.	1 to 128 characters (case sensitive)	
		Password*2	Specify a password for the basic authentication.	1 to 32 characters (case sensitive)	
	Connection retry*1	Connection timeout time [sec]	Specify a timeout period.	1 to 60	20
		Number of re- tries	Specify the number of retries.	0 to 5	3
		Retry interval [sec]	Specify a retry interval.	1 to 60	3
	Security	TLS version	Specify a TLS version.	1.0 / 1.1 / 1.2	1.2
	set- tings*1 *3	Forwarding when server certificate expires	Specify whether to enable or disable file transfer when the server certificate is expired.	Yes/No	No
		OCSP stapling	Specify whether to enable or disable revocation check by OCSP stapling.	Yes/No	No

^{*1.} The setting is enabled when you use the File Upload Function.

^{*2.} The setting is enabled when you use the basic authentication of the web server.

^{*3.} The setting is enabled when the web server uses the HTTPS protocol.

4-9 Restrictions

The following restrictions apply to the WebAPI Connection Function.

- Since this function is dependent on the network environment, the performance of the file transfer is not guaranteed. Make sure to conduct system verification in the user environment before you use this function in an actual environment.
- If the file export speed of the Time Series Database Function is faster than the file transfer speed of the WebAPI Connection Function, there is no free space of the storage in the AI Controller and the Time Series Database Function cannot export the file. Make sure to conduct system verification in the user environment before you use this function in an actual environment.
- In addition, if the file transfer to the Web server is compromised by problems such as when the Web server is stopped or a problem exists in the communication path, it could also cause a shortage of the storage space. When you use this function, make sure to consider this possibility.
- Up to three Web servers can be registered, but you cannot transfer a file to the separate Web servers.
- If you transfer files to a cloud-based Web server, make sure to implement security measures for the network, such as installing a proxy server and so on.

4	WehAPI	Connection	Function
т			i uncuon



Time Series Database Instructions

This section describes specifications of the instructions used for the Time Series Database.

TimeSeries ControlService	5-2
TimeSeries_ControlSampling	5-6
TimeSeries ControlExport	5-8

5-1

TimeSeries_ControlService

The TimeSeries_ControlService instruction controls TSDB service status (start, stop, or shutdown).

Instruction	Name	FB/F UN	Graphic expression	ST expression
			TimeSeries_ControlService_instance	
TimeSer- ies_Control- Service	Control TSDB Service Status	FB	TimeSeries_ControlService Execute Done Cmd Busy Error ErrorID	TimeSeries_ContorlService_instance (Execute, Cmd, Done, Busy, Error, ErrorID);
]

Variables

Name	Meaning	I/O	Description	Valid range	Unit	Default
			Input a command to be executed.			
Cmd	Command	Input	1: Start command 2: Stop command 9: Shutdown command	1, 2, 9		0

Name	Boo lean		Bit st	rings			Integers							Re nu be	m-	Times, durations, dates, and text strings				
Name	BOOL	вүте	WORD	DWORD	LWORD	USINT	UINT	UDINT	ULINT	SINT	INT	DINT	LINT	REAL	LREAL	TIME	DATE	TOD	DT	STRING
Cmd											OK									

Function

This instruction performs the *Start command*, *Stop command* or *Shutdown command* to the TSDB service.

This instruction ends normally if the TSDB service is already in the same status as the command, such as when *Start command* is input for *Cmd* while the TSDB service is *Running*.

Related System-defined Variables

Name	Meaning	Data type	Description						
_TSDB_Status	TSDB Service Status	_sTSDB_STATUS	System-defined variable that shows the status of the TSDB service						
_TSDB_ShutdownCmd	TSDB Service Shut- down Command	BOOL	When the variable changes from FALSE to TRUE, the shutdown command sends to the TSDB service.						

Precautions for Correct Use

- Execution of this instruction is continued until processing is completed even if the value of *Execute* changes to FALSE or the execution time exceeds the task period. The value of *Done* changes to TRUE when processing is completed. Use this to confirm normal completion of processing.
- Refer to *Using this Section* in the *NJ/NX-series Instructions Reference Manual* (Cat. No. W502) for a timing chart of *Execute*, *Done*, *Busy*, and *Error*.
- You cannot use this instruction in an event task. A compiling error will occur.
- *Error* is TRUE if an error occurred. The meanings of the values of *ErrorID* are given in the following table.

ErrorID values	Error description
16#0400	The value of the <i>Cmd</i> is outside the valid range.
16#4C0C	There is not sufficient resources to execute the time series database instruction.
16#4C0D	While the TSDB service is in the <i>Error</i> or <i>Shutdown</i> state, the <i>Start command</i> or <i>Stop</i>
10#4C0D	command was executed.

Additional Information

If you run this instruction in the Simulator, when *Execute* changes from FALSE to TRUE, the values of output variables are shown in the table below.


Output variable	Normal input value	Abnormal input value
Done	TRUE	FALSE
Busy	FALSE	FALSE
Error	FALSE	TRUE
ErrorID	16#0000	16#0400

Sample Programming

This sample executes the Shutdown command for the TSDB service.

LD

Internal Varia- bles	Variable	Data type	Initial value	Comment
	OperatingEnd	BOOL	FALSE	Processing completed
	Trigger	BOOL	FALSE	Execution condition
	Operating	BOOL	FALSE	Processing
	RS_instance	RS		
	IsExport	BOOL	FALSE	
	ControlService_instance	TimeSeries_ContorlService		

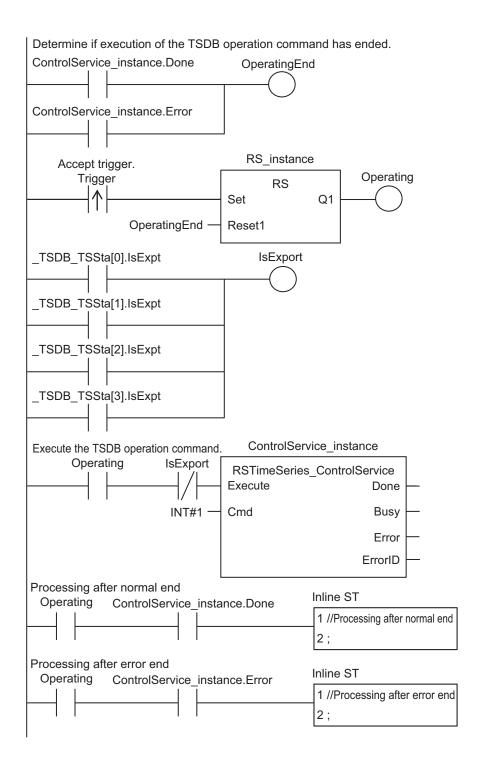

ST

Internal Varia- bles	Variable	Data type	Initial value	Comment
	Trigger	BOOL	FALSE	Execution condition
	LastTrigger	BOOL	FALSE	Value of Trigger from previous task period
	OperatingStart	BOOL	FALSE	Processing started
	Operating	BOOL	FALSE	Processing
	IsExport	BOOL	FALSE	

Internal Varia- bles	Variable	Data type	Initial value	Comment
	ControlService_instance	TimeSeries_ContorlService		

```
// Detect when Trigger changes to TRUE.
IF ( (Trigger=TRUE) AND (LastTrigger=FALSE) ) THEN
         OperatingStart:=TRUE;
         Operating :=TRUE;
END IF;
LastTrigger:=Trigger;
// Initialize TimeSeries_ContorlService instruction
IF (OperatingStart=TRUE) THEN
         ControlService instance (
                 Execute :=FALSE,
                 Cmd :=1);
         OperatingStart:=FALSE;
END IF;
// Determination during the execution of export
IF ((_TSDB_TSSta[0].IsExpt=TRUE) OR (_TSDB_TSSta[1].IsExpt=TRUE)OR
                 ( TSDB TSSta[2].IsExpt=TRUE) OR ( TSDB TSSta[3].IsExpt=TRUE)) THEN
         IsExport:=TRUE;
END IF;
// Execute TimeSeries ContorlService instruction
IF ((Operating=TRUE)AND(IsExport=FALSE)) THEN
ControlService_instance (
Execute :=TRUE,
         Cmd:=INT#9);
         IF (ControlService instance.Done=TRUE) THEN
                  // Processing after normal end
                  Operating:=FALSE;
         END IF;
         IF (ControlService instance.Error=TRUE) THEN
                  // Processing after error end
                  Operating:=FALSE;
         END IF;
END_IF;
```

TimeSeries_ControlSampling

The TimeSeries_ControlSampling controls the sampling status for the specified TimeSeries.

Instruction	Name	FB/F UN	Graphic expression	ST expression
TimeSer- ies_Control- Sampling	Control Sampling Status	FUN	TimeSeries_ControlSampling EN ENO TimeSeriesName Out Cmd	Out:=TimeSeries_ControlSam-pling(TimeSeriesName,Cmd);

Variables

Name	Meaning	I/O	Description	Valid range	Unit	Default
TimeSeries- Name	Name of TimeSeries	Input	Enter any of the following TimeSeries names as a text string: • 'RAW_DATA' • 'ANL_DATA'	64 bytes max. (Including the final NULL character)		"
Cmd	Command	Input	Input a command to be executed. 1: Start 2: Stop	1, 2		0
Out	Processing Result Output		Store the processing result. 0: Normal end 6: Invalid Cmd 9: Invalid TimeSeries In any of the cases, ENO of the instruction will become TRUE.	Depends on the data type.		

Name	Boo lean		Bit st	rings	•	Integers								Real num- bers		Times, durations, dates, and text strings				
Name	BOOL	ВҮТЕ	WORD	DWORD	LWORD	USINT	UINT	UDINT	ULINT	SINT	TNI	DINT	LNIT	REAL	LREAL	TIME	DATE	TOD	DT	STRING
TimeSeries- Name																				ОК
Cmd											OK									
Out											OK									

Function

This instruction starts or stops sampling the TimeSeries specified for the *TimeSeriesName* according to the *Cmd* command.

Related System-defined Variables

Name	Meaning	Data type	Description
TCDD TCCto	Time Corios Status	ARRAY[031] OF	Output the Time Series status
_TSDB_TSSta	TimeSeries Status	_sTSDB_TSSta*1	Output the TimeSeries status.
TCDD CompletentCond	Sampling Start Com-	ARRAY [031] OF	Instruct the TimeSeries to start sam-
_TSDB_SmplStartCmd	mand	BOOL*1	pling.
TCDD CmnlCtonCmd	Sampling Stop Com- ARRAY [031] (Instruct the TimeSeries to stop sam-
_TSDB_SmplStopCmd	mand	BOOL*1	pling.

^{*1.} The array element numbers mean the following:

Precautions for Correct Use

An error occurs in the following cases. Identify the cause of the error based on the value of Out.

- The TimeSeries specified by the *TimeSeriesName* is not found.
- There is not sufficient resources to execute the instruction.

^{0:} RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved

TimeSeries_ControlExport

The TimeSeries_ControlExport instruction starts and stops exporting the specified TimeSeries.

Instruction	Name	FB/F UN	Graphic expression	ST expression
TimeSer- ies_ControlEx- port	Control Export Status	FUN	TimeSeries_ControlExport EN ENO TimeSeriesName Out Cmd	Out:=TimeSeries_ControlEx- port(TimeSeriesName,Cmd);

Variables

Name	Meaning	I/O	Description	Valid range	Unit	Default
TimeSeries- Name	Name of TimeSeries	Input	Enter any of the following the TimeSeries names as a text string: • 'RAW_DATA' • 'ANL_DATA' • 'FTR_DATA' • 'AIS_DATA'	64 bytes max. (Including the fi- nal NULL char- acter)		"
Cmd	Command	Input	Input a command to be executed. 1: Start 2: Stop	1, 2		0
Out	Processing Result	Output	Store the processing result. 0: Normal end 6: Invalid Cmd 9: Invalid TimeSeries In any of the cases, ENO of the instruction will become TRUE.	Depends on the data type.		

Name	Boo lean		Bit st	trings	•				Inte	gers				Re nu be	m-		imes es, ar			
Name	вооц	ВҮТЕ	WORD	DWORD	LWORD	USINT	UINT	UDINT	ULINT	SINT	TNI	DINT	LNIT	REAL	LREAL	TIME	DATE	TOD	TO	STRING
TimeSeries- Name																				ок
Cmd											OK									
Out											OK									

Function

This instruction starts or stops exporting the TimeSeries specified for the *TimeSeriesName* according to the *Cmd* command.

Related System-defined Variables

Name	Meaning	Data type	Description
TCDD TCCto	TimeSeries Status	ARRAY[031] OF	Output the Time Series status
_TSDB_TSSta	TimeSeries Status	_sTSDB_TSSta*1	Output the TimeSeries status.
TCDD EventStortCmd	Evnert Start Command	ARRAY [031] OF	Instruct the TimeSeries to start export-
_TSDB_ExptStartCmd	Export Start Command	BOOL*1	ing.
TCDD FuntStonCmd	anCmd Evnert Sten Command		Instruct the TimeSeries to stop export-
_TSDB_ExptStopCmd	Export Stop Command	BOOL*1	ing.

^{*1.} The array element numbers mean the following:

Precautions for Correct Use

An error occurs in the following cases. Identify the cause of the error based on the value of Out.

- The TimeSeries specified by the *TimeSeriesName* is not found.
- There is not sufficient resources to execute the instruction.

^{0:} RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved

5	Time	Sarias	Datahasa	Instructions
J		Selles	Dalabase	111511 46110115



Startup Procedures for the Al Controller

This section describes the procedure to start the Al Controller. It describes the overview of startup procedures, and then describes them in detail.

6-1	Over	view of Startup Procedures	6-2
6-2	Prelir	minary Preparation Phase	6-6
6-3	Data	Collection Phase	6-8
6-4	Data	Analysis Phase	6-14
6-5	Data	Utilization Phase	6-15
6-6	Using	g Extension Function	6-25
	6-6-1	WebAPI Connection Function	6-25
	6-6-2	Variable Data Collection	6-28

6-1 Overview of Startup Procedures

The AI Controller startup procedure is as follows.

			Us	ed so ware	oft-		ated fo	unc-	
Phase	Step	Procedure	Sysmac Studio	Al Operator	Al Viewer	Time Series Database Function	Feature Value/Machine Learning Function	WebAPI Connection Function	Reference
Prelimi- nary	Step 1 Determining equipment events/varia-	1-1 Determining equipment events to monitor							page 6-6
Prepara- tion	bles to monitor	1-2 Analyzing cause of equipment event							page 6-6
	Step 2 Preparing the Al Controller	2-1 Preparing the Al Controller							page 6-6
	Step 3 Downloading user program and FTP	3-1 Setting variables to use in Al functions to the user program	0						page 6-6
	server function settings	3-2 Setting the FTP server function	0						page 6-7
	from the Sysmac Studio	3-3 Downloading to the Al Controller	0						page 6-7



			Hs	ed so	oft-	Rela	ated fi	ınc-	
				ware	/IC-		tions		
Phase	Step	Procedure	Sysmac Studio	Al Operator	Al Viewer	Time Series Database Function	Feature Value/Machine Learning Function	WebAPI Connection Function	Reference
Data Collec- tion	Step 4 Connecting the Al Controller with a computer	4-1 Connecting the Al Controller with a computer							page 6-8
	Step 5 Common settings	5-1 Setting the project name		0					page 6-8
	in the Al Operator	5-2 Setting the model of the connected AI Controller		0					page 6-8
		5-3 Setting the FTP client of the Al Operator		0					page 6-8
	Step 6 Setting variable data	6-1 Registering variable data to the Al Operator		0					page 6-9
	Step 7 Setting equip-	7-1 Setting equipment event names		0					page 6-10
	ment events	7-2 Setting variable data		0					page 6-10
		7-3 Setting frame variables		0					page 6-10
		7-4 Setting subframe variables		0					page 6-10
		7-5 Setting feature extraction output frame variables		0					page 6-10
		7-6 Setting machine learning output frame variables		0					page 6-10
		7-7 Downloading to the Al Controller		0					page 6-10
	Step 8 Starting data collection	8-1 Starting data collection		0		0			page 6-12
	Step 9 Checking collect- ed data for missing or omitted data	9-1 Checking collected data for missing or omitted data							page 6-12
	Step 10 Stopping data collection	10-1 Stopping data collection		0		0			page 6-13



			Us	ed so ware	oft-		ated f		
Phase	Step	Procedure	Sysmac Studio	Al Operator	Al Viewer	Time Series Database Function	Feature Value/Machine Learning Function	WebAPI Connection Function	Reference
Data Analysis	Step 11 Generating and downloading the Al ma-	11-1 Generating and downloading the AI machine learning model		0					page 6-14
Allalysis	chine learning model	The At machine learning model							



				ed so	oft-		ated fo	unc-	
				ware			tions		
Phase	Step	Procedure	Sysmac Studio	Al Operator	Al Viewer	Time Series Database Function	Feature Value/Machine Learning Function	WebAPI Connection Function	Reference
Data Uti- lization	Step 12 Connecting the AI Controller with a computer	12-1 Connecting the Al Controller with a computer							page 6-15
	Step 13 Creating programs	13-1 Creating the Feature Value/ Machine Learning Function program	0						page 6-15
		13-2 Creating the Time Series Database program	0						page 6-16
	Step 14 Connecting the Al Controller with a computer	14-1 Connecting the Al Controller with a computer							page 6-16

			Us	sed so			ated f		
			(0	ware			tions		
Phase	Step	Procedure	Sysmac Studio	Al Operator	Al Viewer	Time Series Database Function	Feature Value/Machine Learning Function	WebAPI Connection Function	Reference
	Step 15 Starting the	15-1 Starting the transfer of CSV		0					page 6-17
	transfer of CSV files from the Al Controller to	files from the AI Controller to the AI Operator							
	the Al Operator	15-2 Starting the transfer of CSV files from the Al Controller to the Web server						0	page 6-17
	Step 16 Starting device operation	16-1 Starting device operation							page 6-17
	Step 17 Checking the Al function operation	17-1 Checking that collection status is running		0		0	0		page 6-18
		17-2 Checking that Feature Value/ Machine Learning Function status is running		0		0	0		page 6-19
		17-3 Checking that frame variables/ variable data/subframe variables are being written	0			0	0		page 6-19
		17-4 Checking collected data for missing or omitted data							page 6-20
	Step 18 Visualizing with	18-1 Setting project names			0	0	0		page 6-20
	the Al Viewer	18-2 Importing the AI Controller project to monitor equipment events			0	0	0		page 6-21
		18-3 Displaying the Status Monitoring screen			0	0	0		page 6-21
		18-4 Displaying equipment event log			0	0	0		page 6-22
		18-5 Displaying the Trend Graph			0	0	0		page 6-22
	Step 19 Stopping device operation	19-1 Stopping device operation							page 6-22
	Step 20 Stopping the transfer of CSV files from the AI Controller to	20-1 Stopping the transfer of CSV files from the AI Controller to the AI Operator		0					page 6-23
	the Al Operator	20-2 Stopping the transfer of CSV files from the Al Controller to Web server		0				0	page 6-23
	Step 21 Powering off the Al Controller	21-1 Shutting down the TSDB service		0		0			page 6-24
		21-2 Powering off the AI Controller							page 6-24

6-5

6-2 Preliminary Preparation Phase

Use the following procedure for the Preliminary Preparation Phase.

	Step	User tasks
Step 1 Determining equipment events/varia- bles to moni- tor	Step 1-1 Determining equipment events to monitor	Determine equipment events to monitor. An example of an equipment event is "To perform predictive maintenance for OO error in equipment". Up to 128 equipment events can be registered in the AI Controller.
	Step 1-2 Analyzing cause of equipment event	Analyze the parameters needed to determine equipment events and identify variables for the Al Controller. For example, a sensor value or a servo speed is required to determine equipment events. Install devices (such as a sensor) used to determine equipment events if it is not installed yet.
		Specify the variables identified here as the <i>variable data</i> in the Al Controller in Step 3-3. Up to 16 variable data can be specified per equipment event.
Step 2 Preparing the Al Controller	Step 2-1 Preparing the Al Controller	 Prepare the Al Controller and connect it to the computer where the Sysmac Studio is installed. For details on the Al Controller models, refer to Section 1 Overview and Features on page 1-1. For an NX-series Al Controller, make sure that an SD memory card is inserted. For an NY-series Al Controller, make sure that an expanded storage (SSD) is inserted in drive bay A.
Step 3 Downloading user program and FTP serv- er function settings from the Sysmac Studio	Step 3-1 Setting variables to use in Al functions to the user program	Set the following variables required to use AI functions in user programs. Register them as global variables. (You can specify any variable name) Refer to Section 3 Feature Value/Machine Learning Function on page 3-1 for the explanation of each variable. • Frame variables • Variable data • Subframe variables • Feature extraction output frame variables • Machine learning output frame variables Also, input values of frame variables, variable data, and subframe variables from
		the user program. Do not input feature extraction output frame variables and machine learning output frame variables from the user program because the Feature Value/ Machine Learning Function of the Al Controller uses them.

Step	User tasks
Step 3-2 Setting the FTP server function	Set the FTP server on the AI Controller. You need to enable the FTP server settings because the AI Operator obtains files from the AI Controller using FTP communications. Select Controller Setup - Built-in EtherNet/IP Port Settings on the Sysmac Studio. Make the following settings on the FTP Dialog. • Set FTP server to Use. • Set Port No. to the port number used for the FTP server. • Set Login name to the login name for the FTP server. (Example: admin) • Set Password to the password for the FTP server. (Example: omron1234) Multiview Explorer Configurations and Setup FTP Settings FTP Settings
Step 3-3 Downloading to the Al Controller	Download the settings you set in Step 3-1 and Step 3-2 to the Al Controller.

6-3 Data Collection Phase


The procedure to start the data collection phase is as follows:

In this phase, analysis data is collected to the Al Controller with the Time Series Database Function of the Al Controller while the equipment is running.


The analysis data collected by the Al Controller is retrieved into your computer with the Al Operator.

	Step	User tasks
Step 4 Connecting the Al Controller with a computer	Step 4-1 Connecting the Al Controller with a com- puter	Use Ethernet cables to connect the AI Controller with the computer where the AI Operator is installed. (When you install the AI Operator to Windows for an NY-series AI Controllers, you are not required to use cable connections.) At this time, use the same domain for the computer's IP address and the AI Controller's IP address.
Step 5 Common settings in the Al Operator	Start the Al Operator and perform Step 5-1 through 5-3.	Start the Al Operator. Al Operator (Al Controller project) New Project Open Project Project Properties Project name AnalysisBase Author Author Author Comment AnalysisProjectComment Al Controller model NX701-2800 Version 1.18 Al Controller model NX701-2800 Version 1.18 License License 5-3 Al Operator FTP Client Settings FTP Pot 21 FTP user name admin FTP Password community34 Create
	Step 5-1 Setting the project name	Set up a project on the Al Operator. These settings can be left as default. • Specify Project name. • Specify Author. • Enter Comment.
	Step 5-2 Setting the model of the connected AI Controller Step 5-3 Setting the FTP client of the AI Operator	 Specify a model of the connected Al Controller. Select an Al Controller model from Al Controller model. Select an Al Controller version from Version. Specify an IP address of the Al Controller for IP address. Specify the FTP client settings for the Al Operator. Enter the same FTP server settings specified on the Al Controller in Step 3-2. Specify an FTP Port Specify a port number that the Al Controller opened for the FTP server. Specify an FTP user name. Specify a user name for the FTP server settings of the Al Controller. Specify an FTP Password. Specify a password for the FTP server settings of the Al Controller. Press the Create Button.

User tasks Step Step 6 Open the Variable Press the Variable Settings Button on the Al Operator to open the Variable Setting varia-Settings screen and Settings screen. ble data perform Step 6-1. Variable Settings Variable Settings Linked Controller Variable (b) + 🖮 Step 6-1 There are two methods to register variable data into the Al Operator: (a) and (b). Registering variable For the variable data, specify the variables downloaded to the Al Controller in data to the Al Operaa. Importing from Sysmac Studio to the AI Operator by using a CSV file · Select variables specified in the variable table in the Sysmac Studio. Copy and paste them to the spreadsheet software. · Save the file in the CSV format at any location in the computer and exit the spreadsheet software. • Press the Import CSV Button on the Al Operator. When the file selection dialog appears, select the saved file. b. Entering variable names directly in the Al Operator • Press the + Button on the Al Operator, and specify Variable name and * If there is more than one variable, register all the variables. Step 7 Press the **Equipment Event Settings** Button on the Al Operator to open the Open the Equipment Setting equip-**Event Settings screen** Equipment Event Settings screen. ment events and perform Step 7-1 through 7-7. Data Collection

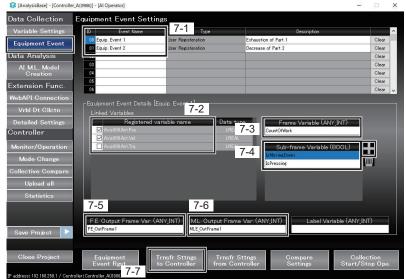

Step	User tasks
Step 7-1 Setting equipment event names	Name the equipment event that you decided in Step 1-1 and specify it for Event Name . Select an equipment event ID after the setting. Up to 128 equipment events can be registered in the AI Controller.
Step 7-2 Setting variable data	Select a check box of the variable data used for the equipment event. If there is more than one data, select them all. Up to 16 variable data can be specified per equipment event. (Among the variable data specified in Step 6, those in the LREAL or BOOL data are displayed.)
Step 7-3 Setting frame varia- bles	Specify Frame Variable. Specify the frame variables that you downloaded to the Al Controller in Step 3. A frame is the time range in which feature values are calculated by the Feature Value/Machine Learning Function.
Step 7-4 Setting subframe variables	Specify Sub-frame variable. Specify the subframe variables that you downloaded to the Al Controller in Step 3. A subframe is the more detailed time range that is targeted for calculation within a frame. * The settings of subframe variables are not required. * If there is more than one, you can register them by pressing the + Button. * Up to six subframe variables can be registered to an equipment event.
Step 7-5 Setting feature extraction output frame variables	Specify F.E. Output Frame Var. . Specify the feature extraction output frame variables that you downloaded to the Al Controller in Step 3.
Step 7-6 Setting machine learning output frame variables	Specify M.L. Ouput Frame Var Specify the machine learning output frame variables that you downloaded to the AI Controller in Step 3. If there is more than one equipment event, go back to Step 7-1. Once you finish configuring all the equipment events, go to Step 7-7.
Step 7-7 Downloading to the Al Controller	Press the Trnsfr Sttngs to Controller Button.

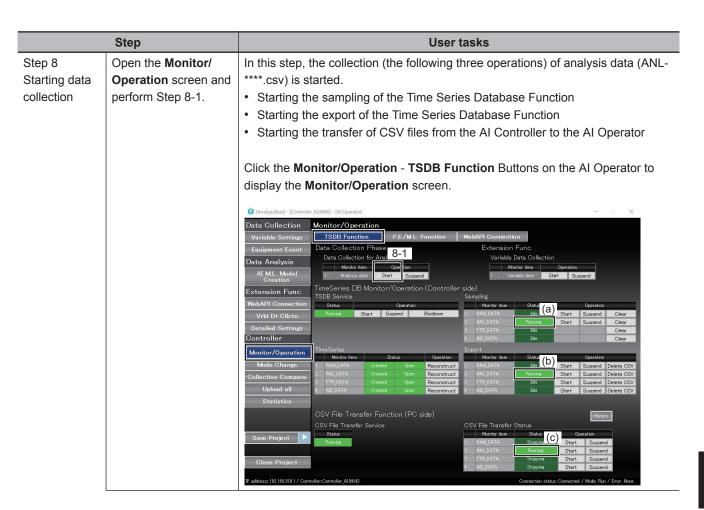

	Step	User tasks
	Step 8-1 Starting data collection	Go to Data Collection Phase - Data Collection for Analysis and press the Start Button. This will start the sampling/export of the Time Series Database Function and the transfer by the Al Operator.
		You can check that the collection has started by the following items: a. Sampling status of the Time Series Database Function: Sampling of No.2 (ANL_DATA) Status is Running b. Export status of the Time Series Database Function: Export of No.2 (ANL_DATA) Status is Running c. Transfer status by the Al Operator: CSV File Transfer Status of No.2 (ANL_DATA) Status is Running
		The analysis data file (ANL-****.csv) is transferred to the following folder in the computer where the Al Operator is installed.
		C:\OMRON\CSVData\[Controller_Serial_No.]\ANL_DATA\YYYY\MM\dd\ (YYYY: Year/MM: Month/dd: Day)
		[Reference] You can also use the time series database instructions to send a sampling/export start command for the Time Series Database Function. Execute the following instructions in the user program. Export: Execute the TimeSeries_ControlExport instruction with the following input variables. TimeSeries input variable: 'ANL_DATA' Cmd input variable: INT#1 Sampling: Execute the TimeSeries_ControlSampling instruction with the following input variables. TimeSeries input variable: 'ANL_DATA' Cmd input variable: INT#1
Step 9 Checking collected data for missing or omitted data	Step 9-1 Checking collected data for missing or omitted data	Check to see if the analysis data file (FTR-****.csv) has been transferred to the following folder in a computer where the Al Operator is installed and contact an engineer of OMRON.
		C:\OMRON\CSVData\[Controller_Serial_No.]\ANL_DATA\YYYY\MM\dd\ (YYYY: Year/MM: Month/dd: Day)
		Open the CSV file and check the Indx (index) field values to see if there is no irregular increment. If there is any missing Indx (index) field value, take any of the following measures. Reduce the volume of variables (size and number of variables) to collect. Increase the task period of the primary periodic task. Increase the export period. Secure the execution time for the system services.
		* For details on the CSV file format, refer to A-5 CSV File Format on page A-32.

User tasks Step Step 10 Open the Monitor/ In this step, the collection (the following three operations) of analysis data (ANL-Stopping data Operation screen and ****.csv) is stopped. collection perform Step 10-1. · Stopping the sampling of the Time Series Database Function • Stopping the export of the Time Series Database Function · Stopping the transfer of CSV files from the AI Controller to the AI Operator Click the Monitor/Operation - TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. 10-1 CSV File Transfer Function (PC side) Step 10-1 Go to Data Collection Phase - Data Collection for Analysis and press the Stopping data collec-Suspend Button. This will stop the sampling/export of the Time Series Database Function and the tion transfer by the Al Operator. You can check that the collection has stopped by the following items: a. Sampling status of the Time Series Database Function: Sampling of No.2 (ANL_DATA) Status is Idle b. Export status of the Time Series Database Function: Export of No.2 (ANL_DATA) Status is Idle c. Transfer status by the Al Operator: CSV File Transfer Status of No.2 (ANL_DATA) Status is Stopping [Reference] You can also send a stop command from the user program. Execute the following instructions in the user program. Export: Execute the TimeSeries_ControlExport instruction with the following input variables. TimeSeries input variable: 'ANL DATA' Cmd input variable: INT#2 Sampling: Execute the TimeSeries ControlSampling instruction with the following input variables. TimeSeries input variable: 'ANL DATA'

Cmd input variable: INT#2

6-4 Data Analysis Phase

The operations performed in the Data Analysis Phase are as follows.

	Step	Operation of an engineer of OMRON
Step 11 Generating and down- loading the AI machine learning mod- el	Step 11-1 Generating and down- loading the AI ma- chine learning model	 This phase are performed by an engineer of OMRON. Generate the AI machine learning model from analysis data (ANL-****.csv). Download the generated AI machine learning model to the AI Controller with the AI Operator.

6-5 Data Utilization Phase

The procedure to start the data utilization phase is as follows:

Step	User tasks
-	Use USBs or Ethernet cables to connect the Al Controller with the computer
Connecting the Al	where Sysmac Studio is installed. (When you install the Al Operator to Windows
	for an NY-series Al Controllers, you are not required to use cable connections.)
p acc.	
Step 13-1 Creating the Feature Value/Machine Learning Function program	In the user program, send the run and idle commands for the Feature Extraction Function and the Machine Learning Function. Write a program as specified below on the Sysmac Studio and download the program to the AI Controller. • Send the run command to the Feature Extraction Function and to the Machine Learning Function when the equipment operation starts. • Send the idle command to the Feature Extraction Function and to the Machine Learning Function when the equipment operation stops. It will run the Feature Extraction Function and the Machine Learning Function when the equipment starts running in Step 16. It will also set the Feature Extraction Function and the Machine Learning Function to idle when the equipment stops running in Step 19.
	Assign TRUE (run) or FALSE (idle) to the Feature Extraction Service Enable Command (_FE_Enable) to send the command. • Machine Learning Function Assign TRUE (run) or FALSE (idle) to the Machine Learning Service Enable Command (_MLE_Enable) to send the command. [Reference]
	The run/idle commands for the Feature Extraction Function and the Machine Learning Function can be also sent from the Al Operator. © [AnalysisBase] - [Controller_Al(2886]] - [Al Controller Project] - [Al Operator]
	Data Collection Wariable Settings Equipment Event Data Analysis Al ML Model Creation Extension Func. WebAPI Connection Vrbl Dt Glictn Detailed Settings Controller Monitor/Operation Monitor/Operation Monitor/Operation Monitor Service Feature Extraction Service Operation Extension Func. WebAPI Connection Vrbl Dt Glictn Detailed Settings Controller Monitor/Operation Mochine Learning Service Monitor imm Status Mochine Learning Service Monitor imm Status Mochine Learning Service Monitor imm Status Mochine Learning Service Finable Disable Machine Learning Service Mochine Immission Status Mochine Learning Service Mochine Immission Status Mochine Learning Service Disable Trable Disable
	Controller with a computer Step 13-1 Creating the Feature Value/Machine Learn-

Step	User tasks
Step 13-2 Creating the Time Series Database program	In the user program, send the commands for starting or stopping the export of the Time Series Database Function. Write a program as specified below on the Sysmac Studio and download the program to the AI Controller. Send the command for starting the export of the Time Series Database Function when the equipment operation starts. Send the command for stopping the export of the Time Series Database Function when the equipment operation stops. It will start the export when the equipment starts running in Step 16. It will also stop the export when the equipment stops running in Step 19. Write a program for starting or stopping the export of feature data (FTR-****.csv) as specified below. TimeSeries_ControlExport instruction TimeSeries input variable: INT#1 (start command), INT#2 (stop command) Write a program for starting or stopping the export of equipment event monitoring score (AIS-****.csv) as specified below. TimeSeries_ControlExport instruction TimeSeries input variable: INT#1 (start command), INT#2 (stop command) (Reference) The command to start or stop the export of feature value data and equipment event monitoring result data can be also sent from the AI Operator. (Reference) The command to start or stop the export of feature value data and equipment event monitoring result data can be also sent from the AI Operator. (Reference) The command to start or stop the export of feature value data and equipment event monitoring result data can be also sent from the AI Operator. (Reference) The command to start or stop the export of feature value data and equipment event monitoring result data can be also sent from the AI Operator. (Reference) The command to start or stop the export of feature value data and equipment event monitoring result data can be also sent from the AI Operator. (Reference) The Command to Start or stop the export of feature value data and equipment event monitoring result data can be also sent from the AI Operator. (Reference) The Command to Start or stop the export o
Step 14 Step 14-1 Connecting the AI Controller with a computerr Step 14 Step 14-1 Connecting the AI Controller with a computer	Use Ethernet cables to connect the Al Controller with the computer where the Al Operator is installed. (When you install the Al Operator to Windows for an NY-series Al Controllers, you are not required to use cable connections.) At this time, use the same domain for the computer's IP address and the Al Controller's IP address.

	Step	User tasks
Step 15 Starting the transfer of CSV files from the AI Controller to the AI Operator	Open the Monitor/ Operation screen and perform Step 15-1 through Step 15-2.	Start the transfer of feature value data and equipment event monitoring result data from the AI Controller to the AI Operator. Click the Monitor/Operation - TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. Like (Analysis and - [Controller A(1986]] - [AI Operator] Data Collection Monitor/Operation Variable Settings Laude Collection Flass Extension Func. Data Analysis AI M.L. Model Creation Late Analysis AI M.L. Model Creation Late Analysis AI M.L. Model Creation Velb API Connection Velb D t Click Start Support Las GATA Running Collective Compare Upload all Las GATA Cealed Open Reconstruct Las GATA Running Collective Compare Upload all Las GATA Running Collective Compare Upload all Las GATA Cealed Open Reconstruct Las GATA Running Collective Compare Upload all Las GATA Running Collective Collection Collective Compare Upload all Las
	Step 15-1 Starting the transfer of CSV files from the AI Controller to the AI Operator Step 15-2	 Go to CSV File Transfer Function (PC side) and press the Start Button for No.3 (FTR_DATA). Go to CSV File Transfer Function (PC side) and press the Start Button for No.4 (AIS_DATA). When the data has been transferred successfully, Status of CSV File Transfer Status changes to Running. Perform this step if you transfer the CSV file to a web server with the WebAPI
	Starting the transfer of CSV files from the Al Controller to the Web server	Connection Function. For details on the procedure, refer to 6-6-1 WebAPI Connection Function on page 6-25.
Step 16 Starting de- vice operation	Step 16-1 Starting device opera- tion	Start the equipment operation. The user program written in Step 13-1 executes and the Feature Value/ Machine Learning Function starts running. The user program written in Step 13-2 executes and the export of the Time Series Database Function starts.

	Step	User tasks
Step 17 Checking the Al function operation	Step 17-1 Checking that collection status is running	User tasks On the AI Operator, select Monitor/Operation and press the TSDB Function Button to open the Monitor/Operation screen. Check the items (a) through (d) described below. • Checking the operation status of the Time Series Database Function (a) Check to see if Status of TSDB Service in TimeSeries DB Monitor/Operation (Controller side) is Running. (b) Check to see if Status of Sampling in TimeSeries DB Monitor/Operation (Controller side) for No.3 (FTR_DATA) and No.4 (AIS_DATA) is Running. (c) Check to see if Status of Export in TimeSeries DB Monitor/Operation (Controller side) for No.3 (FTR_DATA) and No.4 (AIS_DATA) is Running. If the status is not running, check the user program created in Step 13. • Checking the transfer status from the AI Controller to the AI Operator (d) Check to see if Status of CSV File Transfer Status in CSV File Transfer Function (PC side) for No.3 (FTR_DATA) and No.4 (AIS_DATA) is Running. Status Controller Cont
		2 ANL_DATA Stopping Start Suspend

Step **User tasks** Check to see if the status of the Feature Value/Machine Learning Function is Step 17-2 Checking that Feature Running. Value/Machine Learn-On the Al Operator, select Monitor/Operation and press the F.E./M.L. Function ing Function status is Button to open the Monitor/Operation screen. Check the items (a) and (b) derunning scribed below. a. Check to see if Status of Feature Extraction Service is Running. The Feature Extraction Function enters in the Running state when the Feature Extraction Service Enable Command (FE Enable) is TRUE and the AI Controller is in the RUN mode. b. Check to see if Status of Machine Learning Service is Running. The Machine Learning Function enters in the Running state when the Machine Learning Service Enable Command (_MLE_Enable) is TRUE and the Al Controller is in the RUN mode. Data Collection Step 17-3 Use the user program written in Step 3-1 to check if values are written to the fol-Checking that frame lowing variables: variables/variable da-· Frame variables ta/subframe variables · Variable data

Subframe variables

are being written

	Step	User tasks
	Step 17-4 Checking collected data for missing or omitted data	Check to see if the feature value data (FTR-****.csv) has been transferred to the following folder in the computer where the AI Operator is installed. C:\OMRON\CSVData\[Controller_Serial_No.]\FTR_DATA\YYYY\MM\dd (YYYY indicates a year, MM indicates a month, and dd indicates a day.) Check to see if the equipment event monitoring result data (AIS-****.csv) has been transferred to the following folder in the computer where the AI Operator is installed. C:\OMRON\CSVData\[Controller_Serial_No.]\AIS_DATA\YYYY\MM\dd (YYYY indicates a year, MM indicates a month, and dd indicates a day.) Open the CSV file and check the indx (index) field values to see if there is no irregular increment. If there is any missing indx (index) field value, take any of the following measures. Reduce the volume of variables (size and number of variables) to collect. Increase the task period of the primary periodic task. Increase the export period. Secure the execution time for the system services. * For details on the CSV file format, refer to A-5 CSV File Format on page A-32.
Step 18 Visualizing with the AI Viewer	Start the Al Viewer and perform Step 18-1 through Step 18-5.	The Al Viewer allows you to visualize feature value data and equipment event monitoring result data that the Al Operator collected from the Al Controller. Start the Al Viewer. Al Viewer Al Viewer Al Viewer Project Settings


Step	User tasks
Step 18-2 Importing the AI Controller project to monitor equipment events	Import an AI Controller project that is output by the AI Operator to the AI Viewer. In the field of Select AI Controller project to import, projects grouped by each AI Controller are displayed in a tree view. The numbers shown here are the serial number of AI Controller. If an AI Controller has more than one AI Controller project, the projects are displayed by pressing the + Button. Select a check box for the AI Controller you will monitor. Press the + Button for the AI Controller you will monitor and select a check box for the AI Controller project. *Select one AI Controller project for an AI Controller. Press the Create Button.
Step 18-3 Displaying the Status Monitoring screen	When you press the Event Monitoring Button, the status monitoring screen for the AI Controller project selected in Step 18-2 is displayed. The top part of each equipment event button indicates the controller name of the AI Controller. The bottom part indicates equipment event name. The meaning of each button color is explained as follows: Dark green : Stopped Data transfer from the AI Controller to the AI Viewer is not in progress Light green : Normal Data transfer from the AI Controller to the AI Viewer is in progress and the equipment event monitoring score is less than Threshold 1 Yellow : Alarm Level 1 Data transfer from the AI Controller to the AI Viewer is in progress and the equipment event monitoring score is equal to or greater than Threshold 1 but less than Threshold 2 Red : Alarm Level 2 Data transfer from the AI Controller to the AI Viewer is in progress and the equipment event monitoring score is equal to or greater than Threshold 2 Gray : Error Data transfer from the AI Controller to the AI Viewer is in progress and the equipment event monitoring score is equal to or greater than Threshold 2 Gray : Error Data transfer from the AI Controller to the AI Viewer is in progress and the equipment event monitoring score is negative infinity The AI Operator transfers equipment event monitoring result files (CSV files) from the AI Controller, and the result is displayed.
	Controller_B Controller_B (0010) Controller_A (0986) Controller_A C

18-4 Eqpmnt Evnt Hst.

1 / 10 🔿

	Step	User tasks
Step 18-4 Displaying equipment event history		On the Status Monitoring screen described in Step 18-3, press the Eqpmnt Evnt Hst. Button. The Equipment Event History window opens. The transition among Alarm Level 1 / Alarm Level 2 can be checked as logs. The logs you can check here are those displayed after showing the Status Monitoring screen described in Step 18-3.
		Equipment Event History Return
		Date Controller Event Status
	Step 18-5 Displaying the Trend Graph	On the Status Monitoring screen described in Step 18-3, press any of the equipment event buttons. The Trend Graph screen opens. It displays a transition of the equipment event monitoring score and the feature value that is adopted in the AI machine learning model. Trend Graph (Controller A(0986):Equip. Event 1) Return 2018-09-21
Step 19 Stopping de- vice operation	Step 19-1 Stopping device oper- ation	Stop the equipment operation. • The user program written in Step 13-1 executes and the Feature Value/ Machine Learning Function becomes idle. • The user program written in Step 13-2 executes and the export of the Time Series Database Function stops.

	Step	User tasks
Step 20 Stopping the transfer of CSV files from the AI Controller to the AI Operator	Open the Monitor/ Operation screen and perform Step 20-1 through Step 20-2.	Stop the transfer of feature value data and equipment event monitoring result data from the AI Controller to the AI Operator. Click the Monitor/Operation - TSDB Function Buttons to display the Monitor/Operation Screen. **Charlester Arcellot AI Operator **Charlester Arcellot AI Operator **Data Collection Monitor/Operation **Variable Settings TSDB Function **Variable Settings TSDB Function **Equipment Event **Data Analysis **Al Medel Arcellot Collection for Analysis **Al Medel Arcellot Collection **Verb API Connection **Verb API Connection **Verb API Connection **Verb API Connection **Status Operation **Detailed Settings **Controller **Monitor riem Status **Status Operation **Monitor riem Status **Detailed Settings **Controller **Monitor riem Status **Status Operation **Monitor riem Status **Status Operation **Monitor riem Status **Operation **Monitor riem Status **Monitor r
	Step 20-1 Stopping the transfer of CSV files from the Al Controller to the Al Operator	 Go to CSV File Transfer Function (PC side) and press the Suspend Button for No.3 (FTR_DAT). Go to CSV File Transfer Function (PC side) and press the Suspend Button for No.4 (AIS_DATA). When the data has been transferred successfully, Status of CSV File Transfer Function (PC side) changes to Stopping.
	Step 20-2 Stopping the transfer of CSV files from the Al Controller to Web server	Perform this step if you transfer the CSV file to a web server with the WebAPI Connection Function. For details on the procedure, refer to 6-6-1 WebAPI Connection Function on page 6-25.

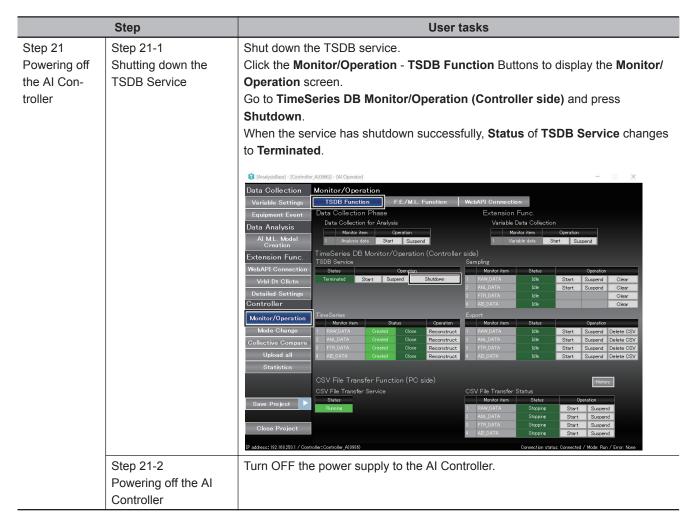



Precautions for Safe Use


Check the created parameters for proper execution and then use them for actual operation.

6-6 Using Extension Function

As an extension function, the Al Operator allows you to configure the WebAPI Connection Function. The WebAPI Connection Function allows you to transfer the various Al Controller data to a Web server.


6-6-1 WebAPI Connection Function

When you transfer CSV files to Web servers with the WebAPI Connection Function, configure settings according to the procedure described below.

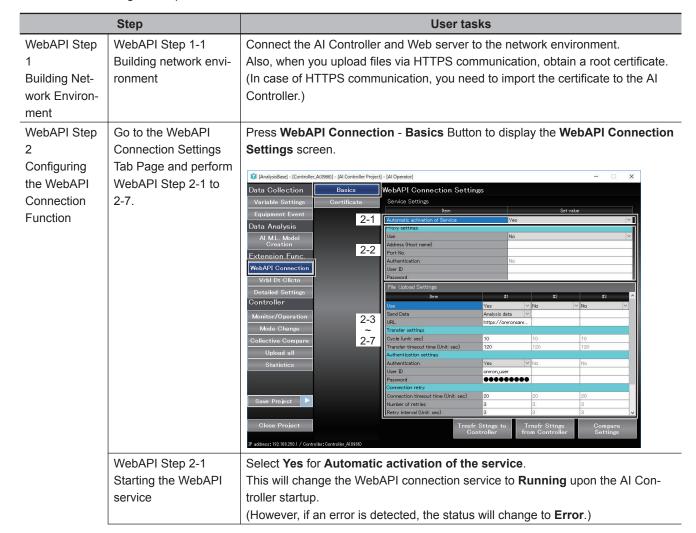

Step	User tasks
WebAPI Step 2-2	Set proxy settings as follows.
Proxy settings	When proxy is not used:
	Select No for Use.
	Proceed to WebAPI Step 2-3.
	When proxy is used:
	Select Yes for Use.
	Set the IP address or host name of the proxy server to Address (Host name).
	Set the port number of the proxy server to Port No .
	Set basic authentication settings for connecting to proxy server as follows.
	a. When the basic authentication is not performed
	Select No for Authentication.
	b. When the basic authentication is performed
	Select Yes for Authentication.
	Set User ID.
	Set Password.
WebAPI Step 2-3	To upload files, select Yes for Use .
Setting Web server	Select data to transfer on Send Data. (Analysis data, Feature value, or
address	Equipment Event Monitoring Score.)
	Set the Web server address to URL.
WebAPI Step 2-4	These settings can be left as default.
Transfer settings	Refer to Section 4 WebAPI Connection Function on page 4-1 for details on the
	settings.
WebAPI Step 2-5	Set basic authentication settings for connecting to the Web server as follows.
Authentication settings	When the basic authentication is not performed:
	Select No for Authentication.
	When the basic authentication is performed:
	• Select Yes for Authentication.
	• Set User ID.
W 1 4 B 1 C 1 C 1 C 1	• Set Password.
WebAPI Step 2-6	These settings can be left as default.
Connection retry	Refer to Section 4 WebAPI Connection Function on page 4-1 for details on the
W/- LADIO(0.7	setting items.
WebAPI Step 2-7	These settings can be left as default.
Security settings	Refer to Section 4 WebAPI Connection Function on page 4-1 for details on the
	setting items.

	Step	User tasks
WebAPI Step 3 Importing Cer-	WebAPI Step 3-1 Importing certificate	When you use HTTPS to communicate with the WebAPI server, you need to import a root certificate to the Al Controller. This setting is required only when the destination URL that is set in WebAPI
tificate		Step 2-3 is an HTTPS address. When communicating with Web server via HTTP: • Go to WebAPI Step 4. When communicating with Web server via HTTPS: • Press WebAPI Connection - Certificate Button to display the WebAPI Connection Settings screen. • Press the + Button. • A dialog for file selection will be displayed. Select the root certificate to import. • If you import more than one root certificate, repeat WebAPI Step 3-1. Paralyzidad - Controller All Controller Propert All Controller Paralyzidad Certificate Institute Certificate Certificate Institute Certificate Certificate Certificate Institute Certificate Certi
WebAPI Step 4 Downloading WebAPI Con- nection Func- tion Settings	WebAPI Step 4-1 Downloading WebAPI Connection Function settings	Press the Trnsfr Sttngs to Controller Button.
		Passwerd Connection retry Connection timeout time (Unit: sec) 20 20 20 Number of retries 3 3 3 3 Rotry interval (Unit: sec) 3 3 3 3 Close Project Trnsfr Sttngs to Controller Controller Settings P addess: 192189 250 1 / Centroller Controller A(998)

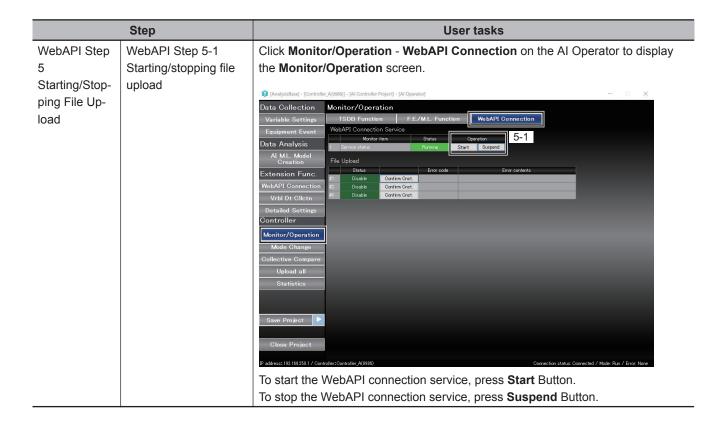

6-6-2 Variable Data Collection

This function collects variable data for an equipment (except for frame variables and subframe variables).


You can use it if you want to determine variable data after you check the values of the variables in 6-2 Preliminary Preparation Phase on page 6-6.

Use the following procedure to collect variable data.

	Step	User tasks
RAW Step 1	RAW Step 1-1	Perform the same procedure described in Step 2 in 6-2 Preliminary Preparation
Preparing the	Preparing the Al Con-	Phase on page 6-6.
Al Controller	troller	
RAW Step 2		Set only Variable data with the same procedure described in Step 3 in 6-2 Pre-
Downloading		liminary Preparation Phase on page 6-6.
User Program		You do not need to input Frame variables, Sub-frame Variable, F.E. Output
and FTP		Frame Var., and M.L. Output Frame Var
Server Func-		
tion Settings		
From the Sys-		
mac Studio		
RAW Step 3		Perform the same procedure described in Step 4 in 6-3 Data Collection Phase
Connecting		on page 6-8.
the Al Con-		
troller to a		
Computer		
RAW Step 4		Perform the same procedure described in Step 5 in 6-3 Data Collection Phase
Common Set-		on page 6-8.
tings in the Al		
Operator		

	21	
	Step	User tasks
RAW Step 5 Setting Varia- ble Data		Perform the same procedure described in Step 6 in 6-3 Data Collection Phase on page 6-8.
RAW Step 6 Downloading Variable Data	Switch to the Variable Data Collection screen and perform RAW Step 6-1 and 6-2.	Click the VrbI Dt Clictn Button on the Al Operator to switch to the Variable Data Collection screen. © Analysisase Controller A(9988) (Al Controller Project) (Al Contr
	RAW Step 6-1	The variable data that you set in RAW Step 5 is displayed in Registered
	Setting variable data	variable name. Select the check box for each variable that you want to collect.
	RAW Step 6-2 Downloading the set- tings	Press the Trnsfr Sttngs to Controller Button.

Step		User tasks	
RAW Step 7 Starting Data Collection	Switch to the Monitor/ Operation screen, and perform RAW Step 7-1.	In this step, the collection (the following three operations) of variable data (RAW-*****.csv) is started. Starting the sampling of Time Series Database Function Starting the export of Time Series Database Function Starting the transfer of CSV files from the AI Controller to the AI Operator Click the Monitor/Operation - TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. TSDB Function Buttons on the AI Operator to display the Monitor/Operation screen. TSDB Function Function WebAI Connection Function Funct	
	RAW Step 7-1 Starting data collection	Select Extension Func Vrbl Dt Cllctn and press the Start Button. You can check that the collection has started by the following items: a. Sampling status of the Time Series Database Function: Sampling of No.1 (RAW_DATA) Status is Running b. Export status of the Time Series Database Function: Export of No.1 (RAW_DATA) Status is Running c. Transfer status by the Al Operator: CSV File Transfer Status of No.1 (RAW_DATA) Status is Running The variable data file (RAW-****.csv) is transferred to the following folder in the computer where the Al Operator is installed. * For details on the CSV file format, refer to A-5 CSV File Format on page A-32. C:\OMRON\CSVData\[Controller_Serial_No.]\RAW_DATA\YYYY\MM\dd\((YYYY: Year/MM: Month/dd: Day))	

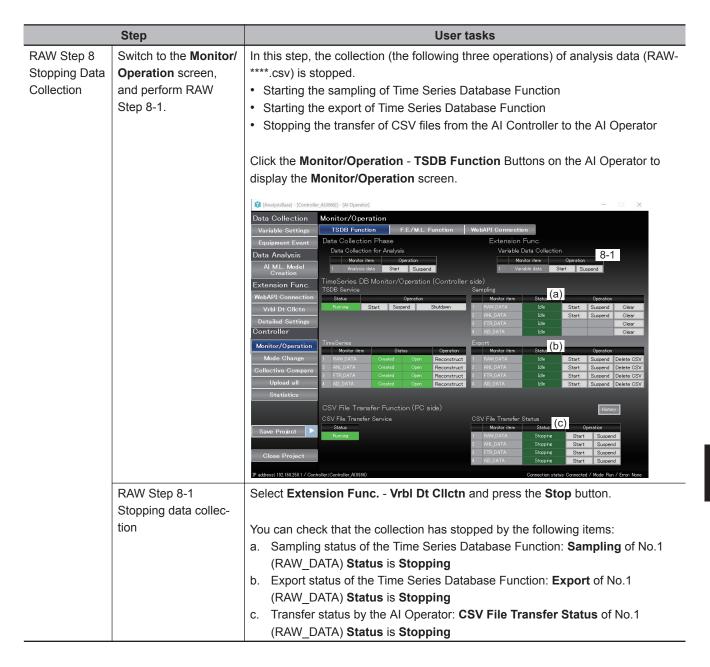

Startup Procedures for the Al Controller	



Maintenance

This section describes the backup functions and the storage replacement on the Al Controller.

7-1	Introdu	uction	7-2
7-2	Data T	hat Is Backed Up and Compatibility Between the Models	7-3
	7-2-1	Backup Data (NX701-Z□00 and NY5□2-Z□00)	
	7-2-2	Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00)	
	7-2-3	Compatibility between the Unit Versions (NX701-Z□00 and NY5□2-	
		Z□00)	7-4
7-3	Storag	e Replacement	7-5
	7-3-1	Storage Replacement Timing	
	7-3-2	Data Saved in the Storage	7-5
	7-3-3	Replacement Procedure	
	7-3-4	Checking Operation After Replacement (NX701-Z□00, NY5□2-Z□00)	

7-1 Introduction

To properly maintain and inspect AI Controllers, take note of data to be backed up, compatibility between models, and storage replacement. This section describes the functional specifications related to these procedures. The term storage in this section refers to non-volatile memory media used with Time Series Database Function on the AI Controller. This would be the SD Memory Card in NX-series AI Controller, and expanded storage in drive bay A in NY-series AI Controller.

For other periodic maintenance and inspection procedures, refer to the following manuals.

- NX-series Al Controller (NX701-Z□□□):
 NX-series CPU Unit Hardware User's Manual (Cat. No. W535)
- NY-series Al Controller (NY5□2-Z□□□)
 NY-series Industrial Box PC Hardware User's Manual (Cat. No. W556)
 NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557)
 NY-series Industrial Panel PC and Industrial Box PC Setup User's Manual (Cat. No. W568)

The following specifies the overview of "Data that is backed up and compatibility between the models" and "Storage replacement".

Item	Overview	Reference
Data that is backed up	Describes data for the backup function of the Al Con-	7-2 Data That Is Backed Up
and Compatibility be-	troller along with the compatibility between Controller	and Compatibility Between
tween the Models	models and between Unit versions.	the Models on page 7-3
Storage Replacement	Describes when to replace the storage of the Al Con-	7-3 Storage Replacement on
	troller target media, saved data as well as the replace-	page 7-5
	ment procedure.	

7-2 Data That Is Backed Up and Compatibility Between the Models

This section describes the data for backup function of the AI Controller and explains the compatibility between Controller models and between Unit versions depending on the model number.



Additional Information

If you perform backup and restore operations with an NY-series AI Controller using the Industrial PC Support Utility, make sure to use the Industrial PC Support Utility version 1.1.1541 or higher.

7-2-1 Backup Data (NX701-Z□00 and NY5□2-Z□00)

The backup function performs to the setting information of the Al Controller functions that are specified on the Al Operator, the Al machine learning models, and the event logs.*1 All the data that is backed up are treated as items of *User program and settings* in the *data group*.

For details on the data that is backed up for the common Controllers, refer to the *Data That Is Backed Up* in the *NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501)* or the *NY-series Industrial Panel PC / Industrial Box PC Software User's Manual (Cat. No. W558)*.

*1. This does not apply to Importing and exporting Sysmac Studio backup file.

(OK: Applicable, NA: Not applicable)

Al Controller function	Data targeted for operation	Backup	Restore and verifica- tion
Time Series Database Function	Settings for the Time Series Database Function	OK	OK
	Data in TimeSeries	NA	NA
	Exported CSV file	NA	NA
	Event logs*1	ОК	NA
Feature Value/Machine Learning Function	Settings for the Feature Value/Machine Learning Function	ОК	OK
	Al machine learning model	OK*2	OK*2
	Event logs*1	ОК	NA
WebAPI Connection Function	Settings for WebAPI Connection Function	OK	ОК
	CA certificates	OK	ОК
	Event logs*1	ОК	NA

^{*1.} Event logs are targeted for backup since they store data associated with the backup source device. However, they are not targeted for restore.

^{*2.} The automatic transfer from SD Memory Card function and program transfer from SD Memory Card function are not targeted for backup, restore, and verification.

7-2-2 Compatibility between the Models (NX701-Z□00 and NY5□2-Z□00)

This section describes the compatibility of backup data between the NX-series and NY-series Controllers.

The following table specifies the backup function compatibility between the backup source and the restore destination when the Al Controller models are different.

(C: Compatible, N: Not compatible)

	Al Controller model to restore to		
Al Controller model where data was backed up	NX701-Z700 NX701-Z600	NY5□2-Z500 NY5□2-Z400 NY5□2-Z300	
NX701-Z700	С	N	
NX701-Z600			
NY5□2-Z500	N	С	
NY5□2-Z400			
NY5□2-Z300			



Additional Information

There is no compatibility for the backup data between the Al Controllers and the Automation Controllers that are not the Al Controllers.

7-2-3 Compatibility between the Unit Versions (NX701-Z□00 and NY5□2-Z□00)

The compatibility of the Al Controller's backup data between the Unit versions are same as that for the standard controllers.

Refer to the Compatibility between Unit Versions of CPU Units in the NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501) or Compatibility between Unit Versions of NY-series Controllers in the NY-series Industrial Panel PC / Industrial Box PC Software User's Manual (Cat. No. W558).

7-3 Storage Replacement

This section describes when to replace the Al Controller's storage, target media format, saved data, as well as the replacement procedure for each model.

For formats and specifications of storage subject to replacement, refer to *General Specifications* on page A-5.



Precautions for Correct Use

- If you replace the storage in the procedure described in this manual, you cannot migrate data saved in the old storage.
- If you insert a new storage into a wrong drive bay, the Al Controller may not start up. Make sure to insert an expanded storage into drive bay A.
- Do not replace the main storage inserted into the Al Controller to another main storage in a different format. If you do so, it could prevent the Al Controller from starting up.

7-3-1 Storage Replacement Timing

NX701-Z□00

NX-series AI Controllers allow you to check the replacement timing with SD Memory Card life expiration detection. For details on how to use this function, refer to SD Memory Card Life Expiration Detection in the NX-series CPU Unit Software User's Manual (Cat. No. W501).

If you use an OMRON SD Memory Card, the end of the life of the SD Memory Card can be detected in the following methods.

When the end of the life is detected, replace the SD Memory Card.

- a. __Card1Deteriorated (SD Memory Card Life Warning Flag) system-defined variable
- b. SD Memory Card Life Exceeded event

NY5□2-Z□00

NY-series Al Controllers allow you to detect the end of service life for the expanded storage (SSD) that is inserted to drive bay A and check the replacement timing of the storage.

The detection for the end of service life of the expanded storage is performed in the *Expanded Storage Life* event. Replace the expanded storage when you see this event.

7-3-2 Data Saved in the Storage

Data in the TimeSeries is saved in the storage you use for the Time Series Database Function of the Al Controller. Note that you cannot migrate the data when you replace the storage.

7-3-3 Replacement Procedure

NX701-Z□00

Replace the SD Memory Card for the NX-series Controller.

Refer to *Installing and Removing the SD Memory Card* in the *NX-series CPU Unit Hardware User's Manual (Cat. No. W535)* to remove the old SD Memory Card and replace it with a new one.

NY5□2-Z□00

This section describes the replacement procedure of the expanded storage (SSD) in the drive bay A of the NY-series Controller. After you replace the SSD on the NY-series Al Controller, you need to format the new SSD. Use the Rescue Disk Utility to format the SSD.

The Rescue Disk Creator to install the Rescue Disk Utility is installed in Windows of the Al Controller.

Step	Item	Description
Step	Verifi-	Make sure that you prepare an USB storage device to install the Rescue Disk Utility.
1	cation	Next, refer to Backing up and Recovering the Industrial PC System in the NY-series Industrial
	and	Panel PC / Industrial Box PC Setup User's Manual (Cat. No. W568), and install the Rescue
	prepa-	Disk Utility into the USB storage device.
	ration	At this time, check to see if the version of Rescue Disk Creator that you will use to install the
	prior	Rescue Disk Utility is version 1.1.2004.0100000040 or higher. You can check the version of
	to the	Rescue Disk Creator by opening Control Panel and selecting Programs and Features. If the
	re-	installed version is older than this version, download the latest version of Rescue Disk Creator
	place-	from the OMRON website and install it to your NY-series Al Controller.
	ment	
Step	SSD	Refer to Drive Replacement in the NY-series Industrial Box PC Hardware User's Manual (Cat.
2	re-	No. W556) or the NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557) and
	place-	replace the expanded storage (SSD) in Drive Bay A.
	ment	

Cton	léana	Description
Step	Item	Description
Step 3	SSD for- mat- ting	Step3-1 While the power of the NY-series Al Controller turned off, mount the USB storage device where the Rescue Disk Utility is installed to the NY-series Al Controller. Step3-2 Press the power button of the NY-series Al Controller and press the F11 Key on the keyboard.
		Please select boot device: PO: 32GB SATA Flash Drive My Rescue Disk Genenc Ultra HS-COMBO Enter Setup 1 and 1 to move selection ENTER to select boot device ESC to boot using defaults The name of the USB storage device displayed on the screen varies for each USB storage device. The My Rescue Disk is shown as an example here. Step3-3 Select a USB storage device where the Rescue Disk Utility is installed and press the Enter Key. The Rescue Disk Utility starts and the Main Menu appears. Welcone to the Rescue Disk Utility 9999.9999, what would you like to do? Create backup Restore backup Restore backup Restore backup Rackup information Maintenance Exit *9999.9999 shows the version number of Rescue Disk Utility. Step3-4 Select Maintenance and press the Enter Key. The Maintenance Menu screen appears. Welcone to the maintenance Menu, what would you like to do? Create Al Database Disk Exit Maintenance Menu

Step	Item	Description
		Step3-5 Select Create Al Database Disk and press the Enter Key. A confirmation screen to continue the formatting appears.
		All data on the target disk will be removed. The target disk will be formatted as FAT32. Return Continue
		Step3-6 Select Continue and press the Enter Key. The screen where you input the volume label for the SSD to format appears.
		Enter a name for Volume Label (11 chars max):AIDISK
		Step3-7 Enter a volume label and press the Enter Key to start the SSD formatting. * Up to 11 characters can be entered for the volume label. * The volume label entry is optional. Once the formatting finishes successfully, the completion screen appears.
		AI database disk partition created successfully.
		Step3-8 After OK is selected, press the Enter Key to go back to the Main Menu. When you select Exit and press the Enter Key on the Main Menu, the power of the NY-series Al Controller automatically turns off.
Step 4	Re- start after the re- place- ment	Make sure that the power is not turned on when you remove the USB storage device. Press the power button and start the NY-series AI Controller.

7-3-4 Checking Operation After Replacement (NX701-Z□00, NY5□2-Z□00)

In the **Tools** - **Troubleshooting** Dialog Box on the Sysmac Studio, select **Controller error** Tab Page and check that there is not an error related to the storage. If an error has occurred, refer to *Section* 8 *Troubleshooting* on page 8-1 and take suitable measures for the relevant event.

Troubleshooting


This section describes the errors (events) that can occur in the Al Controller uniquely. The corrections for them are also given.

The troubleshooting methods and event codes other than the Al Controller are used in the same series. For the NX-series, refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)*. For the NY-series, refer to the *NY-series Troubleshooting Manual (Cat. No. W564)*.

8-1	Over	8-2	
	8-1-1	How to Check for Errors	8-2
	8-1-2	Errors Related to the AI Functions	8-4
8-2	Troub	oleshooting	8-7
	8-2-1	Error Table	8-7
	8-2-2	Error Description	8-15

8-1 Overview of Errors

You manage all of the errors that occur on the AI Controller as events. The same methods are used for all events. This allows you to see what errors have occurred and find corrections for them with the same methods for the entire range of errors that is managed (AI Controllers and EtherCAT slaves*1). You can use the troubleshooting functions of Sysmac Studio or the Troubleshooter on an HMI to check the error details and find corrections for them.

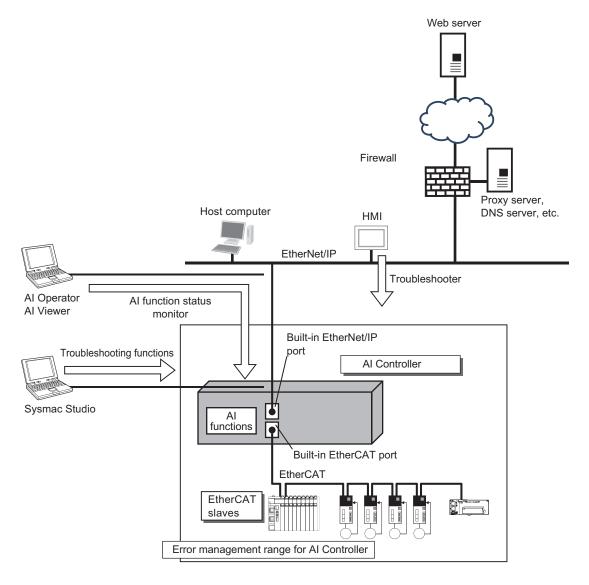

*1. Only Sysmac devices are supported. For information on EtherCAT slaves of the Sysmac devices, refer to the NJ/NX-series CPU Unit Built-in EtherCAT Port User's Manual (Cat.No. W505) or the NY-series Industrial Panel PC / Industrial Box PC Built-in EtherCAT Port User's Manual (Cat. No. W562).

8-1-1 How to Check for Errors

You can check to see if an error has occurred with the following methods.

Checking method	What you can check	
Checking the indicators	You can check the operating status of the Al Controller	

Checking method	What you can check
Checking with the troubleshooting	You can check for current Controller errors, a log of past Controller er-
function of Sysmac Studio	rors, error sources, error causes, and corrections.
Checking with the Troubleshooter of	You can check for current Controller errors, a log of past Controller er-
an HMI ^{*1}	rors, error sources, error causes, and corrections.
Checking with Instruction That Gets	You can check the highest-level status and highest-level event code in
Error Status	the current Controller errors.
Checking with system-defined varia-	You can check the current Controller error status for each function mod-
bles	ule.

^{*1.} To perform troubleshooting from an HMI, connect the HMI to the built-in EtherNet/IP port on the AI Controller.

This section describes the above checking methods as follows.

Checking the Indicators

For an NX-series AI Controller, you can use the PWR indicator on the Power Supply Unit and the RUN and ERROR indicators on the AI Controller to check the error status. Refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)* for details.

For an NY-series AI Controller, you can use the PWR, RUN, and ERROR indicators on the AI Controller to check the error status. Refer to the NY-series Troubleshooting Manual (Cat. No. W564) for details.

Checking with the Troubleshooting Function of Sysmac Studio

When an error occurs, you can connect Sysmac Studio to the Al Controller online to check for current Controller errors and the log of past Controller errors. You can also check the cause of the error and corrections. For details, refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)* or the *NY-series Troubleshooting Manual (Cat. No. W564)*. For troubleshooting information when the Sysmac Studio cannot connect to the Al Controller, refer to the *Sysmac Studio Version 1 Operation Manual (Cat. No. W504)*.

Checking with the Troubleshooter of an HMI

When an error occurs, if you can connect communications between an HMI and the Controller, you can check for current Controller errors and the log of past Controller errors. You can also check the cause of the error and corrections. For details, refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)* or the *NY-series Troubleshooting Manual (Cat. No. W564)*.

Checking with Instruction That Gets Error Status

In the user program, you can get the error status with the instruction to get error information for each function module.

The following table lists the instruction that are used to get error information for AI functions.

Instruction	Name	Function
GetPLCError	Get PLC Controller Error Status	Gets the highest-level status (partial fault or minor fault) and the highest-level event code of the current Controller errors in the PLC Function Module.

For details on the Get PLC Controller Error Status instruction, refer to the *NJ/NX-series Instructions Reference Manual (Cat. No. W502)* or the NY-series Instructions Reference Manual (Cat. No. W560).

Checking with System-defined Variables

Al function errors can be checked with the following system-defined variables.

Variable name	Data type	Name	Function
_PLC_ErrSta	WORD PLC Function Module Er-		Displays the status of all the errors
		ror Status	that occur in the PLC Function Mod-
			ule.

Each status of the AI functions can be checked with the following system-defined variables.

Variable name	Data type	Name	Function
_TSDB_Status	_sTSDB_STATUS	TSDB Service Status	Shows the operation status of the TSDB service.
_TSDB_TSSta	ARRAY[031] OF _sTSDB_TSSTA	TimeSeries Status	Shows the TimeSeries status.
_FE_Status	_eFE_STATUS	Feature Extraction Service Status	Shows the status of the feature extraction service.
_MLE_Status	_eMLE_STATUS	Machine Learning Service Status	Shows the status of the machine learning service.

8-1-2 Errors Related to the Al Functions

This section describes errors that are related to the Al functions. For details on the errors that are related to the function modules except for the Al functions, refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)* or the *NY-series Troubleshooting Manual (Cat. No. W564)*.

Classification

The AI function errors are classified into the following categories according to the error sources.

Classification	Event source	Event source de- tails	Event log category		
			System log	Access log	User-defined event log
Errors for self diagnosis*1	PLC Function Module		YES	NO	NO
Time Series Data- base Function	PLC Function Module	TSDB	YES	NO	NO
Feature Value/ Machine Learning Function	PLC Function Module	FE/MLE	YES	YES	NO
WebAPI Connection Function	PLC Function Module	WebAPI	YES	YES	NO
Time series data- base instruction	PLC Function Module	Instructions	YES	NO	NO

^{*1.} NY5□2-Z□□□ only

Event Levels

This section describes the operation of the AI functions in each event level.

Event Levels	Operation
Major fault	The control operations of the entire Al Controller stop for errors in this event level.

Event Levels	Operation
Partial fault	The control operations of one of the function modules in the Al Controller stop for errors
	in this event level.
	If an error occurs in locations described above, the entire function are stopped.
Minor fault	Part of the control operations of each function module in the Al Controller stop for errors
	in this event level.
Observation	These errors do not affect the control operations of the Al Controller.
	The observation notifies you of potential problems before they develop into a minor fault
	level error or worse.
Information	Events that are classified as information that do not indicate errors.

• Error of the Al Functions

The following tables list events according to the error levels.

• Errors for Self Diagnosis (NY5□2-Z□□□ only)

Event Levels	Event name
Major fault	None
Partial fault	None
Minor fault	None
Observation	Expanded Storage Life
	Expanded Storage Data Corrupted
Information	Expanded storage available

• Time Series Database Function

Event Levels	Event name
Major fault	None
Partial fault	None
Minor fault	TimeSeries Creation Failed
	TimeSeries Deletion Failed
	TimeSeries Record Export Failed
	Time Series Database Setting Error
	TSDB Service Startup Failed
	TimeSeries Setting Update Failed
	TSDB Service Memory Allocation Failed
	TimeSeries Error
	TimeSeries Open Failed
	Timeout Occurred
	TimeSeries Record Addition Request Lost
	TimeSeries Record Addition Failed
	TimeSeries Time Backward Counter Overflow
	TimeSeries Time Index Overflow
Observation	None
Information	TSDB Service Started
	TSDB Service Stopped
	TSDB Service Shutdown
	Sampling Started
	Sampling Stopped
	Export Started
	Export Stopped
	TimeSeries Setting Updated

• Feature Value/Machine Learning Function

Event Levels	Event name
Major fault	None
Partial fault	None
Minor fault	Feature Extraction Setting Error
	PLC System Processing Error
	Machine Learning Service Setting Error
Observation	PLC System Processing Error
Information	Feature Extraction Setting Changed
	Feature Extraction Service Stopped
	Feature Extraction Service Started
	Machine Learning Service Setting Changed
	Machine Learning Service Stopped
	Machine Learning Service Started

• WebAPI Connection Function

Event Levels	Event name
Major fault	None
Partial fault	None
Minor fault	WebAPI Connection Service Setting Error
	WebAPI Connection Service System Processing Error
	Directory Access Failed
	File Deletion Failed
	File Upload Failed
Observation	WebAPI Connection Service Root Certificate Expiration Notice
Information	WebAPI Connection Service Started
	WebAPI Connection Service Stopped
	WebAPI Connection Service Setting Updated
	File Upload Succeeded
	WebAPI Connection Service Certificate Imported

• Time Series Database Instruction

Event Levels	Event name
Major fault	None
Partial fault	None
Minor fault	None
Observation	Export in Progress Insufficient TimeSeries Resources TSDB Service Control Disabled
Information	None

8-2 Troubleshooting

8-2-1 Error Table

This section describes a list of errors (events) that can occur on the Al Controller uniquely.

Interpreting Error Table

The contents of the error tables are described below.

Item	Description
Event code	The event code of the error in the AI Controller is given.
	The codes are displayed in eight hexadecimal digits.
Event name	The name of the error is given.
Meaning	A short description of the error is given.
Assumed cause	The assumed cause of the error is given.
Level	The level of influence on control is given.
	The abbreviations have the following meanings.
	Maj: Major fault level
	Prt: Partial fault level
	Min: Minor fault level
	Obs: Observation
	Info: Information
	The symbol has the following meaning.
	O: Event levels that are defined by the system.
Reference	The page number of the manual that provides details on the event is given.

Errors for Self Diagnosis (NY5□2-Z□□□ Only)

	Event name	Meaning	Assumed cause	Level					Refer-
Event code				Maj	Prt	Min	Obs	In- fo	ence
00140000	Expanded	The specified num-	The expanded storage				0		page
hex	Storage	ber of deletion for	reached its service life.						8-17
	Life	the expanded stor-							
		age was exceeded.							
		Or, the number of							
		bad blocks exceed-							
		ed the specified val-							
		ue.							

	Event name	Meaning	Assumed cause	Level					Dofor
Event code				Maj	Prt	Min	Obs	In- fo	Refer- ence
10140000 hex	Expanded Storage Data Cor- rupted	A file that must be in the expanded stor- age is missing or corrupted.	The power supply to the Controller was interrupted while the HDD or SSD was being accessed (HDD indicator was lit). The power supply to the Controller was interrupted momentarily while the HDD or SSD was being accessed (HDD indicator was lit). The expanded storage has failed.				0		page 8-18
90A10000 hex	Expanded Storage Available	The expanded storage can be used.	The expanded storage can be used.					0	page 8-18

Time Series Database

	Event name	Meaning	Assumed cause	Level					Defer
Event code				Maj	Prt	Min	Obs	In- fo	Refer- ence
14F00000 hex	TimeSeries Creation Failed	Creating TimeSeries failed.	 The directory where the TimeSeries is stored, cannot be accessed. Insufficient storage capacity 			0			page 8-19
14F10000 hex	TimeSeries Deletion Failed	Deleting TimeSeries failed.	TimeSeries cannot be accessed.			0			page 8-19
14F20000 hex	TimeSeries Record Ex- port Failed	Exporting records from the TimeSeries to a CSV file failed.	 The file system returned an error. Accessing the export output file failed. Export was interrupted because the TimeSeries close or the TSDB service shutdown was executed during export. 			0			page 8-20

						Leve	I		Defen
Event code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	Refer- ence
35960000 hex	Time Series Database Setting Error	There is an error in the time series database setting.	 A variable that was not registered in the Sysmac Studio was specified for the Time Series Database. Power was interrupted while the setting was being downloaded. Power was interrupted during the Clear All Memory operation. Power was interrupted during the restore operation. Non-volatile memory failed. 			0			page 8-21
35970000 hex	TSDB Serv- ice Startup Failed	Starting the TSDB service failed.	There is an error in the setting file of the Time Series Database.			0			page 8-21
35980000 hex	TimeSeries Setting Up- date Failed	Updating the TimeSeries set- tings failed.	There is an error in the record setting. Memory resources are insufficient.			0			page 8-22
44640000 hex	TSDB Service Memory Allocation Failed	The TSDB Service failed to allocate memory.	The TSDB Service failed to allocate memory.			0			page 8-22
44650000 hex	TimeSeries Error	The TimeSeries corruption was detected.	Power was interrupted during access to the TimeSeries.			0			page 8-23
44670000 hex	TimeSeries Open Failed	Opening the TimeSeries failed.	 The TSDB service is not started. TimeSeries cannot be accessed. The TimeSeries memory is corrupted. The TimeSeries setting that is saved in the expanded storage and the set values for the Time Series Database do not match. Power was interrupted during access to the TimeSeries. 			0			page 8-24
65400000 hex	Timeout Oc- curred	A timeout occur- red while records are added to TimeSeries or da- ta exports to a CSV file.	The file access delayed due to insufficient memory space or memory error (access prohibited, hardware failure, or locked).			0			page 8-25
95930000 hex	TimeSeries Record Ad- dition Re- quest Lost	A record addition request to the TimeSeries was lost.	A delay of access speed occur- red to the directory where the TimeSeries is stored.			0			page 8-26

						Leve			Refer-
Event code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	ence
95940000 hex	TimeSeries Record Ad- dition Failed	Adding records to the TimeSeries failed.	 The directory where the TimeSeries is stored, cannot be accessed. A record cannot be added to the TimeSeries. 			0			page 8-27
95960000 hex	TimeSeries Time Back- ward Coun- ter Overflow	The order reversal of records and time stamps stored in the TimeSeries occurred more than the specified number of times.	The time of the AI Controller is set to older than the current time.			0			page 8-28
95970000 hex	TimeSeries Time Index Overflow	Writing records of the same time stamp occurred more than the specified number of times.	Records with the same time stamp are stored in sequence.			0			page 8-28
95900000 hex	TSDB Serv- ice Started	The TSDB service entered the running state.	The TSDB service entered the running state.					0	page 8-29
95910000 hex	TSDB Service Stopped	The TSDB service entered the idle state.	The TSDB service entered the idle state.					0	page 8-29
95920000 hex	TSDB Serv- ice Shut- down	The TSDB service entered the shutdown state.	The TSDB service entered the shutdown state.					0	page 8-30
95980000 hex	Sampling Started	The sampling of the Time Series Database was started.	The sampling of the Time Series Database was started.					0	page 8-30
95990000 hex	Sampling Stopped	The sampling of the Time Series Database was stopped.	The sampling of the Time Series Database was stopped.					0	page 8-31
959A0000 hex	Export Start- ed	The export of the Time Series Database was started.	The export of the Time Series Database was started.					0	page 8-31
959B0000 hex	Export Stop- ped	The export of the Time Series Database was stopped.	The export of the Time Series Database was stopped.					0	page 8-32
959C0000 hex	TimeSeries Setting Up- dated	The TimeSeries setting was updated.	The TimeSeries setting (basic controller setting) was updated.					0	page 8-32

Feature Value/Machine Learning Function

• Feature Extraction Function

Event						Leve	ı		Refer-
code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	ence
35EB0000 hex	Feature Extraction Setting Error	There is an error in the settings of the Feature Extraction Function.	 There is a variable that is not registered in the Sysmac Studio. Power was interrupted while the setting was being downloaded. Power was interrupted during the Clear All Memory operation. Power was interrupted during the restore operation. Non-volatile memory failed. 			0			page 8-33
446F0000 hex	PLC System Processing Error	An error was detected in the PLC Function Module.	An error occurred in the software or hardware.			0			page 8-34
44710000 hex	Feature Ex- traction Serv- ice TimeSer- ies Write Er- ror	Writing from the feature ex- traction service to TimeSeries failed.	 The TSDB service was stopped. The TSDB service was shut down. There is insufficient free space in the internal buffer of the TSDB service. The SD Memory Card was removed. (for NX-series AI Controllers) The expanded storage was removed. (for NY-series AI Controllers) 				0		page 8-35
95E30000 hex	Feature Ex- traction Set- ting Changed	The setting of the Feature Extraction Function was updated.	 The setting of the Feature Extraction Function was changed with the AI Operator. The setting of the Feature Extraction Function was changed by the Clear All Memory operation. The setting of the Feature Extraction Function was changed by the download operation. The setting of the Feature Extraction Function was changed by the restore operation. 					0	page 8-36
95E40000 hex	Feature Ex- traction Serv- ice Stopped	The Feature Extraction Function entered the idle state.	The Feature Extraction Function entered the idle state.					0	page 8-36

Event						Refer-			
code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	ence
95E50000 hex	Feature Ex- traction Serv- ice Started	The Feature Extraction Function entered the running state.	The Feature Extraction Function entered the running state.					0	page 8-37

Machine Learning Function

Event						Leve			Refer-
code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	ence
35EA0000 hex	Machine Learning Service Set- ting Error	There is an error in the machine learning function setting.	 There is a variable that is not registered in the Sysmac Studio. Power was interrupted while the setting was being downloaded. Power was interrupted during the Clear All Memory operation. Power was interrupted during the restore operation. A format error of the learned data occurred. An mismatch between the setting and the learned data occurred. 			0			page 8-38
446E0000 hex	PLC System Processing Error	An error was detected in the PLC Function Module.	An error occurred in the software or hardware.			0			page 8-39
44700000 hex	Machine Learning Service TimeSeries Write Error	Writing from the machine learning serv- ice to TimeSer- ies failed.	 The TSDB service was stopped. The TSDB service was shut down. There is insufficient free space in the internal buffer of the TSDB service. The SD Memory Card was removed. (for NX-series AI Controllers) The expanded storage was removed. (for NY-series AI Controllers) 				0		page 8-40

Event			Level			Refer-			
code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	ence
95E00000 hex	Machine Learning Service Set- ting Changed	The setting of the Machine Learning Func- tion or the learned data was updated.	 The setting of the Machine Learning Function or the learned data was changed with the AI Operator. The setting of the Machine Learning Function was changed by the Clear All Memory opera- tion. The setting of the Machine Learning Function was changed by the restore operation. 					0	page 8-41
95E10000 hex	Machine Learning Service Stop- ped	The Machine Learning Func- tion entered the idle state.	The status of the Machine Learning Function entered the reading or error state.					0	page 8-41
95E20000 hex	Machine Learning Service Start- ed	The Machine Learning Func- tion entered the running state.	The status of the Machine Learning Function entered the idle or running state.					0	page 8-42

WebAPI Connection Function

Event				Le	Leve	l		Refer-	
code	Event name	Meaning	Assumed cause		Prt	Min	Obs	In- fo	ence
35F40000 hex	WebAPI Connection Service Set- ting Error	There is an error in the WebAPI connection service setting.	 There is a setting error. Power was interrupted while the setting was being downloaded. Power was interrupted during the Clear All Memory operation. Power was interrupted during the restore operation. Non-volatile memory failed. 			0			page 8-43
44780000 hex	WebAPI Connection Service Sys- tem Process- ing Error	A fatal error was detected in the WebAPI connection service.	A fatal error was detected in the WebAPI connection service.			0			page 8-44

Event						Leve	l		Defer
Event code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	Refer- ence
65450000 hex	Directory Access Failed	Accessing to the directory that is stored the transfer file failed.	The directory specified the source file for transfer does not exist. The SD Memory Card is not inserted (when the SD Memory Card was specified for the transfer source) The SD Memory Card was removed during the execution of file upload (when the SD Memory Card was specified for the transfer source)			0			page 8-44
65460000 hex	File Deletion Failed	Deleting the file stored in the transfer source di- rectory failed after the file is transfer- red.	The SD Memory Card is write-protected.			0			page 8-45
85180000 hex	File Upload Failed	Uploading a file to the HTTP server failed.	 The specified destination URL is incorrect. The specified HTTP server stopped the service. There is an incorrect equipment setting (Ethernet switch, Proxy server, and DNS server) in the communications path. The Ethernet cable connector is disconnected. The Ethernet cable is broken. An error occurred in the communications path. 			0			page 8-46
65470000 hex	WebAPI Connection Service Root Certificate Expiration Notice	The root certificate of the WebA-PI connection service will expire in one month.	It was detected that the root certificate of the WebAPI connection service would expire in one month.				0		page 8-47
95F10000 hex	WebAPI Connection Service Started	The WebAPI connection service was started.	The WebAPI connection service was started.					0	page 8-48
95F20000 hex	WebAPI Connection Service Stopped	The WebAPI connection service was stopped.	The WebAPI connection service was stopped.					0	page 8-48
95F30000 hex	WebAPI Connection Service Set- ting Updated	The WebAPI connection service setting was updated.	The WebAPI connection service setting was updated.					0	page 8-49

Event						Leve		Refer-	
code	Event name	Meaning	Assumed cause	Maj	Prt	Min	Obs	In- fo	ence
95F40000	File Upload	The file upload to	The file transfer to the HTTP					0	page
hex	Succeeded	the HTTP server	server has succeeded.						8-49
		has succeeded.							
95F50000	WebAPI	The root certifi-	The root certificate of the We-					0	page
hex	Connection	cate of the WebA-	bAPI connection service was						8-50
	Service Cer-	PI connection	imported.						
	tificate Im-	service was im-							
	ported	ported.							

Time Series Database Instructions

The following list shows errors (i.e., events) that can occur in the time series database instructions.

					Leve		el		Refer-
Event code	Event name	Meaning	Assumed cause		Prt	Min	Obs	In- fo	ence
54014C0C hex	Insufficient TimeSeries Resources	There is not sufficient resources to execute the Time Series Database Instruction.	Insufficient free space in the internal buffer of the TSDB service				0		page 8-50
54014C0D hex	TSDB Service Control Disabled	While the TSDB service was in the <i>Error</i> or <i>Shutdown</i> state, <i>Start</i> command or <i>Stop</i> command was executed.	The relevant instruction was executed while the TSDB service was shutting down. The relevant instruction was executed while the TSDB service was in the error state.				0		page 8-51

8-2-2 Error Description

This section provides details of the errors.

Interpreting Error Descriptions

The items that are used to describe individual errors (events) are described in the following copy of an error table.

Event name	Gives the name	of the error.		Event code	Gives the code of the error.				
Meaning	Gives a short de	es a short description of the error.							
Source	Gives the source	of the error.	Source details	Gives details	Detection tim-	Tells when the			
				on the source	ing	error is detect-			
				of the error.		ed.			
Error attrib-	Level	Tells the level	Recovery	Gives the re-	Log category	Tells which log			
utes		of influence on		covery meth-		the error is			
		control.*1		od.*2		saved in.*3			

Effects	User program	Tells what will happen to exe- cution of the user pro- gram.*4	Operation	Provides special information on the operation results from the error.					
System-de-	Variable		Data type		Name				
fined varia-	Lists the variable	Lists the variable names, data types, and meanings for system-defined variables that provide direct err							
bles	notification, that	are directly affecte	ed by the error, or	that contain settin	gs that cause the error.				
Cause and	Assumed cause	9	Correction		Prevention				
correction	Lists the possible	e causes, correction	ons, and preventiv	e measures for th	e error.				
Attached in-	This is the attach	ned information that	at is displayed by	Sysmac Studio or	HMI.*5				
formation			. , ,						
Precautions/	Provides precau	Provides precautions, restrictions, and supplemental information. If the user can set the event level, the							
Remarks	event levels that	event levels that can be set, the recovery method, operational information, and other information is also							
	provided.								

*1. One of the following:

Major fault: Major fault level, Partial fault: Partial fault level, Minor fault: Minor fault level, Observation, Information

*2. After the correction is performed, one of the following methods is used to reset the Controller error state:

Automatic recovery: Normal status is restored automatically when the cause of the error is removed.

Error reset: Normal status is restored when the error is reset after the cause of the error is removed.

Cycle the power supply: Normal status is restored when the power supply to the Controller is turned OFF and then back ON after the cause of the error is removed.

Controller reset: Normal status is restored when the Controller is reset after the cause of the error is removed.

*3. One of the following:

System: System event log Access: Access event log

*4. One of the following:

Continues: Execution of the user program will continue.

Stops: Execution of the user program stops.

Starts: Execution of the user program starts.

*5. Refer to the *NJ/NX-series Troubleshooting Manual (Cat. No. W503)* or the *NY-series Troubleshooting Manual (Cat. No. W564)* for the applicable range of the HMI Troubleshooter.

Errors for Self Diagnosis (NY5□2-Z□□□ Only)

Event name	Expanded Storage	ge Life		Event code	00140000 hex		
Meaning	· ·	The specified number of deletion for the expanded storage was exceeded. Or, the number of bad blocks exceeded the specified value.					
Source	PLC Function Me	odule	Source details		Detection tim- ing	At power ON, Controller reset or periodically	
Error attrib- utes	Level	Observation	Recovery		Log category	System	
Effects	User program	Not affected.	Operation	Not affected.	·		
System-de-	Variable		Data type		Name		
fined varia- bles							
Cause and	Assumed cause)	Correction		Prevention		
correction	The expanded storage reached its service life.		Replace the expanded storage.				
Attached in-	None						
formation							
Precautions/	If you replace the	e expanded storag	ge, you cannot mig	grate the data stor	ed in the old expa	nded storage.	
Remarks	For details on ho	w to replace the	expanded storage,	refer to Section	7 Maintenance on	page 7-1.	

Event name	Expanded Storage	ge Data Corrupted	t	Event code	10140000 hex		
Meaning	A file that must b	e in the expanded	d storage is missin	g or corrupted.			
Source	PLC Function Mo	odule	Source details		Detection tim- ing	At power ON or Controller reset	
Error attrib- utes	Level	Observation	Recovery	Cycle the pow- er supply or re- set the Control- ler after the correction	Log category	System	
Effects	User program	Not affected.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	_ExtendedStora	ge2Ready	BOOL		Extended Storag	je 2 Ready Flag	
Cause and	Assumed cause	•	Correction		Prevention		
correction	The power suppl ler was interrupte HDD or SSD wa cessed (HDD inc	ed while the s being ac-	Use the Rescue Disk Utility to format the expanded storage, and then download the correct file.		Do not interrupt the power supply to the Controller while the HDD or SSD is being accessed (HDD indicator is lit). Follow the correct shutdown procedure to turn the power off.		
	The power supply to the Controller was interrupted momentarily while the HDD or SSD was being accessed (HDD indicator was lit).				 Use an UPS and supply power at the rated voltage. Do not remove the expanded storage while the power is ON. 		
	The expanded st failed.	torage has	If this error occurs even though the above problem does not ex- ist, replace the expanded stor- age.				
Attached in- formation	None						
Precautions/ Remarks	operate norma • If you replace	ally. the expanded sto	eries Database, the rage, you cannot r e expanded storag	migrate the data s	tored in the old ex	panded storage.	

Event name	Expanded Storage	ge Available		Event code	90A10000 hex		
Meaning	The expanded st	torage can be use	d.				
Source	PLC Function Mo	PLC Function Module			Detection tim-	At power ON or	
					ing	Controller reset	
Error attrib-	Level	Information	Recovery		Log category	System	
utes							
Effects	User program	Not affected.	Operation Not affected.				
System-de-	Variable		Data type		Name		
fined varia-	_ExtendedStorag	ge2Ready	BOOL		Extended Storage 2 Ready Flag		
bles							
Cause and	Assumed cause	•	Correction	Correction		Prevention	
correction	The expanded st	torage can be					
	used.						
Attached in-	None						
formation							
Precautions/							
Remarks							

Time Series Database

Event name	TimeSeries Crea	tion Failed		Event code	14F00000 hex		
Meaning	Creating TimeSe	Creating TimeSeries failed.					
Source	PLC Function Module		Source details	TSDB	Detection tim- ing	When the TimeSeries creation fails	
Error attrib- utes	Level	Minor fault	Recovery	Execute the TimeSeries creation again	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None	None					
Cause and	Assumed cause	9	Correction	Correction			
correction	The directory wheries is stored, concessed.		tory where the T stored, to enable	Change the attribute of the directory where the TimeSeries is stored, to enable writing and then download the TimeSeries setting		bute of the direc- imeSeries is writing.	
	Insufficient storage capacity		Increase the free space of the storage where the TimeSeries is stored and then download the TimeSeries setting again.		Check the free s age where the T stored.	•	
Attached in- formation	Attached information 1: TimeSeries Name (beginning 15 characters)			g 15 characters)			
Precautions/ Remarks	None						

Event name	TimeSeries Deletion Failed			Event code	14F10000 hex		
Meaning	Deleting TimeSe	Deleting TimeSeries failed.					
Source	PLC Function Module		Source details	TSDB	Detection tim- ing	When the TimeSeries de- letion fails	
Error attrib- utes	Level	Minor fault	Recovery	Execute the TimeSeries de- letion again	Log category	System	
Effects	User program	Continues.	Operation Not affected.				
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	e	Correction		Prevention		
correction	TimeSeries cann	ot be accessed.	Check the TimeS	Series file and	Check the TimeSeries file and		
			the setting (read	attribute, etc) of	the setting (read	attribute, etc) of	
			the directory who	ere the TimeSer-	the directory who	ere the TimeSer-	
			ies was stored.		ies was stored.		
Attached in-	Attached informa	ation 1: TimeSerie	s Name (beginnin	g 15 characters)			
formation							
Precautions/	None						
Remarks							

Event name	TimeSeries Reco	ord Export Failed		Event code	14F20000 hex		
Meaning	Exporting record	s from the TimeSe	eries to a CSV file	failed.			
Source	PLC Function M	odule	Source details	TSDB	Detection timing	When the TimeSeries re- cord export fails	
Error attrib- utes	Level	Minor fault	Recovery	Cycle the pow- er supply or re- set the Control- ler.	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	Э	Correction		Prevention		
correction	The file system returned an error.		Restart the Al Co	Restart the AI Controller.			
	Accessing the export output file failed.		Check the status, volume, and write allowance setting of the storage to which the file is output.		Check the status, volume, and write allowance setting of the storage to which the file is output, and then execute the command.		
	Export was inter the TimeSeries of TSDB service sh executed during	close or the nutdown was	Since the export was interrupted, the output file may be corrupted. Check the output file.		Shut down the T correct procedur	SDB service in a e.	
Attached information	Attached information 1: TimeSeries Name (b Attached Information 2: Cause of the error 4C00 hex: TSDB Service Not Started 4C02 hex: TimeSeries Handle Out Of Rai 4C04 hex: No Corresponding Record For 4C05 hex: Exporting 4C0B hex: TimeSeries Access Failed 4C0C hex: Insufficient resources 4C14 hex: Insufficient Capacity in Export						
Precautions/ Remarks	None						
Nemains							

Event name	Time Series Data	abase Setting Erro	or	Event code	35960000 hex		
Meaning	There is an error	in the time series	database setting.				
Source	PLC Function Module		Source details	TSDB	Detection timing	At power ON, Controller re- set, or when downloading	
Error attrib- utes	Level	Minor fault	Recovery	Automatic re- covery	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause		Correction		Prevention		
correction	A variable that was not registered in the Sysmac Studio was specified for the Time Series Database.		Register the variable from the Sysmac Studio and then download the settings.		Download from the Sysmac Studio first and then from the AI Operator next.		
	Power was interrupted while the setting was being downloaded.		Perform the Clear All Memory operation or download the set-		Do not interrupt during download		
	Power was interrupted during the Clear All Memory operation.		tings.		Clear All Memory, or restore operations.		
	Power was interrupted during the restore operation.						
	Non-volatile mer	nory failed.	Replace the Al C	Controller.	None		
Attached in- formation	Attached informa	ation 1: TimeSerie	s Name (beginnin	g 15 characters)			
Precautions/ Remarks	None						
Event name	TSDB Service S	tartup Failed		Event code	35970000 hex		
Meaning	Starting the TSD	B service failed.					
Source	PLC Function Module		Source details	TSDB	Detection tim- ing	When the TSDB service startup fails	
Error attrib- utes	Level	Minor fault	Recovery		Log category	System	

Lveiit iiailie	13DD Service Startup Falled			Lveiit code	33970000 Hex		
Meaning	Starting the TSD	B service failed.					
Source	PLC Function Module		Source details	TSDB	Detection tim- ing	When the TSDB service startup fails	
Error attrib- utes	Level	Minor fault	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	_TSDB_Status	_TSDB_Status		_sTSDB_STATUS		TSDB Service Status	
Cause and	Assumed cause		Correction	Correction			
correction	An error occurred in the setting file of the Time Series Database		settings (basic co	me series database controller setting database settings (bases settings) and settings from the database settings (bases settings) are correct before loading the settings.		s (basic control- iable registra- before down-	
Attached in-	None		•		•		
formation							
Precautions/	None						
Remarks	I						

Event name	TimeSeries Setti	ng Update Failed		Event code	35980000 hex		
Meaning	Updating the Tin	neSeries settings t	failed.				
Source	PLC Function Module		Source details	TSDB	Detection timing	When the time- series data- base setting is downloaded from the AI Op- erator	
Error attrib-	Level	Minor fault	Recovery	Download the	Log category	System	
utes				setting again			
Effects	User program	Continues.	Operation	Not affected.	1		
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	9	Correction		Prevention		
correction	There is an error in the record setting.		ble registration, or data set regist	Check the record settings (variable registration, equipment event or data set registration) and then download the settings again.		Make sure that the record settings (variable registration, equipment event or data set registration) are correct and then download the settings.	
	Insufficient mem	ory resources	ources Restart the Al Controller.				
Attached in- formation	Attached information 1: TimeSeries Name (beginning 15 characters) Attached Information 2: Cause of the error 4C03 hex: Setting error 4C0C hex: Insufficient resources						
Precautions/ Remarks	None						
Event name	TSDB Service M	emory Allocation	Failed	Event code	44640000 hex		
Meaning	-	ce failed to allocat		240111 0000	THO TOOGG TICK		
Source	PLC Function M		Source details	TSDB	Detection tim-	Continuously	
Error attrib- utes	Level	Minor fault	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	•	Correction		Prevention		
correction	The TSDB service	ce failed to allo-	End unnecessar	y programs.	Do not run unne	cessary pro-	
	cate memory.				grams.		
Attached in- formation	None						
Precautions/ Remarks	None						

Event name	TimeSeries Erro	r		Event code	44650000 hex	
Meaning	The TimeSeries	corruption was de	tected.			
Source	PLC Function Module		Source details	TSDB	Detection timing	When the TimeSeries corruption is detected
Error attrib- utes	Level	Minor fault	Recovery		Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	None					
Cause and	Assumed cause	9	Correction		Prevention	
correction	Power was interrupted during access to the TimeSeries.		Download the time series data- base settings from the Al Opera- tor again, and then reconstruct the TimeSeries.		Do not interrupt the power supply during access to the TimeSeries.	
Attached in-	Attached informa	ation 1: TimeSerie	s Name (beginnin	g 15 characters)	•	
formation						
Precautions/ Remarks	None					

Event name	TimeSeries Ope	n Failed		Event code	44670000 hex	
Meaning	Opening the Tim	eSeries failed.		,		
Source	PLC Function Module Source details		TSDB	Detection tim- ing	When opening the TimeSeries fails	
Error attrib- utes	Level	Minor fault	Recovery		Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	_TSDB_TSSta		ARRAY [031] C _sTSDB_TSSTA		TimeSeries State	us
Cause and	d Assumed cause		Correction		Prevention	
correction	The TSDB service is not started.		Start the TSDB s	Start the TSDB service.		of the TSDB ou perform the
	TimeSeries cannot be accessed.		 Insert the TimeSeries storage correctly. Remove write protection from the TimeSeries storage. 		 Insert the storage correctly. Do not set the read attribute to the storage. 	
	The TimeSeries rupted.	memory is cor-	Replace the TimeSeries storage.		Turn OFF the Al Controller power supply in the correct procedure.	
	The TimeSeries setting that is saved in the expanded storage and the set values for the Time Series Database do not match.		Download the time series data- base settings from the Al Opera- tor again, and then reconstruct the TimeSeries.		If you download the time series database settings after the settings are changed, reconstruct the TimeSeries.	
	Power was intercess to the Time	rupted during ac- Series.			Do not interrupt the power supply during access to the TimeSeries.	
Attached information	Attached Information 4C00 hex: TS 4C03 hex: Ti 4C08 hex: Ti 4C0B hex: Ti	ation 2: Code of ca SDB Service Not S	Started ailed Failed	g 15 characters)		
Precautions/ Remarks	None					

Event name	Timeout Occurre	ed		Event code	65400000 hex		
Meaning	A timeout occurred while records are added to TimeSei			eries or data exports to a CSV file.			
Source	PLC Function Module		Source details	TSDB	Detection timing	During the access to the database or the processing to access to the Export file	
Error attrib- utes	Level	Minor fault	Recovery	Access to the database again or execute to access to the Export file	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type	Data type			
fined varia- bles	None						
Cause and	Assumed cause		Correction	Correction			
correction	The file access of insufficient mem memory error (a hardware failure	ory space or ccess prohibited,	eries or the statu	eries or the status, volume, and write allowance setting of the storage to which the CSV file is exported.		Check the storage of the TimeSeries or the status, volume, and write allowance setting of the storage to which the CSV file is exported, and then execute the command.	
Attached in- formation	Attached information 1: TimeSeries Name (beginning 15 characters) Attached Information 2: Cause of the error 0: Record addition timeout 1: Record writing or reading timeout during export 2: File open timeout during export 3: File close timeout during export						
Precautions/ Remarks	None	<u> </u>					

Event name	TimeSeries Reco	ord Addition Requ	est Lost	Event code	95930000 hex			
Meaning	A record addition	request to the Ti	meSeries was lost					
Source	PLC Function Module		Source details	TSDB	Detection timing	When the record addition request to the TimeSeries is lost		
Error attrib- utes	Level	Minor fault	Recovery	Execute the addition request again	Log category	System		
Effects	User program	Continues.	Operation	Not affected.				
System-de-	Variable	Variable [Data type		Name		
fined varia- bles	None							
Cause and	Assumed cause	9	Correction		Prevention			
correction	A delay of acces	s speed occur-	Increase the acc	ess speed to the	Increase the acc	ess speed to the		
	red to the directo	ory where the	directory where t	the TimeSeries is	directory where t	the TimeSeries is		
	TimeSeries is stored.		stored.		stored and then execute the command.			
Attached in- formation	Attached informa	ation 1: TimeSerie	s Name (beginnin	g 15 characters)				
Precautions/ Remarks	None							

Event name	TimeSeries Rec	ord Addition Failed	d	Event code	95940000 hex	
Meaning	Adding records t	to the TimeSeries	failed.			
Source	PLC Function M	odule	Source details	TSDB	Detection timing	When the TimeSeries re- cord addition fails
Error attrib- utes	Level	Minor fault	Recovery	Execute the record addition again	Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-			Data type	Data type		
fined varia- bles						
Cause and	Assumed cause	9	Correction	Correction		
correction	The directory where the TimeSeries is stored, cannot be accessed.		Take appropriate measures to ensure that the directory where the TimeSeries is stored, can be accessed.		Take appropriate measures to ensure that the directory where the TimeSeries is stored, can be accessed.	
	A record cannot TimeSeries.	be added to the	Increase the free space of the storage (output destination of the TimeSeries)*1.		Increase the free space of the storage (output destination of the TimeSeries)*1.	
			Check to see if the storage (output destination of the TimeSeries)*1 is not corrupted.		Check to see if the storage (output destination of the TimeSeries)*1 is not corrupted.	
Attached in- formation	Attached informa	ation 1: TimeSerie	s Name (beginning	·	1 7	- m 51
Precautions/ Remarks	None					

^{*1.} For NX-series, the output destination of the TimeSeries is the SD Memory Card. For NY-series, this event does not occur.

Event name	TimeSeries Time	Backward Count	er Overflow	Event code	95960000 hex		
Meaning	The order revers		time stamps store	d in the TimeSerie	es occurred more	han the speci-	
Source	PLC Function Me	odule	Source details	TSDB	Detection timing	The time back- ward counter for the TimeS- eries is over- flown	
Error attrib- utes	Level	Minor fault	Recovery	Delete the TimeSeries and create it again	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable	Variable			Name		
fined varia- bles	None						
Cause and	Assumed cause	Assumed cause C			Prevention		
correction			Delete the TimeSeries and create it again.		Check the time of the Al Controller.		
Attached in- formation	Attached informa	Attached information 1: TimeSeries Name (beginning 15 characters)					
Precautions/ Remarks	None						
_	I			1			
Event name	TimeSeries Time			Event code	95970000 hex		
Meaning	_		tamp occurred mo				
Source	PLC Function Mo	odule	Source details	TSDB	Detection tim- ing	The time index for the TimeS- eries is over- flown	
Error attrib- utes	Level	Minor fault	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	•	Correction		Prevention		
correction	Records with the same time stamp are stored in sequence.		Store records without the time stamp (auto) or with another time stamp.		Do not write records that have the same time stamp.		
Attached in- formation	Attached informa	ation 1: TimeSerie	s Name (beginnin	g 15 characters)			
Precautions/ Remarks	None						

Event name	TSDB Service S	tarted		Event code	95900000 hex		
Meaning	The TSDB service	ce entered the run	ning state.				
Source	PLC Function Module		Source details	TSDB	Detection tim- ing	When the TSDB service is started	
Error attrib- utes	Level	Information	Recovery		Log category	System	
Effects	User program Continues. Operation		Not affected.	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	_TSDB_Status		_sTSDB_STATUS		TSDB Service Status		
Cause and	Assumed cause	•	Correction	Correction		Prevention	
correction	The TSDB service running state.	ce entered the					
Attached in-	None						
formation							
Precautions/	None						
Remarks							

Event name	TSDB Service S	topped		Event code	95910000 hex		
Meaning	The TSDB service	ce entered the idle	e state.				
Source	PLC Function Module S		Source details	TSDB	Detection tim- ing	When the TSDB service is stopped	
Error attrib- utes	Level	Information	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable	Variable [Data type		Name	
fined varia- bles	_TSDB_Status		_sTSDB_STATUS		TSDB Service Status		
Cause and	Assumed cause	e	Correction		Prevention		
correction	The TSDB service idle state.	ce entered the					
Attached in- formation	None						
Precautions/ Remarks	None						

Event name	TSDB Service S	hutdown		Event code	95920000 hex		
Meaning	The TSDB servi	ce entered the shu	utdown state.		•		
Source	PLC Function M	odule	Source details	TSDB	Detection timing	When the TSDB service is shut down	
Error attrib- utes	Level	Information	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	_TSDB_Status			IS	TSDB Service S	tatus	
Cause and	Assumed cause	е	Correction		Prevention		
correction	The TSDB service entered the shutdown state.						
Attached in- formation	None	None					
Precautions/ Remarks	None						
Event name	Sampling Starte			Event code 95980000 hex			
Meaning			Database was star				
Source	PLC Function M	odule	Source details	TSDB	Detection tim- ing	When the sam- pling is started	
Error attrib- utes	Level	Information	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	_TSDB_SmplSta	a	ARRAY [031] o	f BOOL	Sampling Execution Flag		
Cause and	Assumed cause	9	Correction		Prevention		
correction	The sampling of the Time Series Database was started.						
Attached in- formation	Attached informa	ation 1: TimeSerie	s Name (beginnin	g 15 characters)			
Precautions/ Remarks	None						

Event name	Sampling Stoppe	ed		Event code	95990000 hex		
Meaning	The sampling of	the Time Series D	atabase was stop	ped.			
Source	PLC Function Module Source		Source details	TSDB	Detection tim- ing	When the sam- pling is stopped	
Error attrib- utes	Level	Information	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	e- Variable [Data type		Name		
fined varia- bles	_TSDB_SmplSta	3	ARRAY [031] of BOOL		Sampling Execution Flag		
Cause and	Assumed cause	Assumed cause		Correction		Prevention	
correction	The sampling of the Time Series Database was stopped.						
Attached in- formation	Attached informa	Attached information 1: TimeSeries Name (beginning 15 characters)					
Precautions/ Remarks	None						

Event name	Export Started			Event code	959A0000 hex		
Meaning	The export of the	e Time Series Dat	abase was started				
Source	PLC Function M	PLC Function Module Sc		TSDB	Detection tim- ing	When the export is started	
Error attrib- utes	Level	Information	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable D		Data type	Data type		Name	
fined varia- bles	_TSDB_ExptSta		ARRAY [031] of BOOL		Export Execution Flag		
Cause and	Assumed cause	9	Correction		Prevention		
correction	The export of the Time Series Database was started.						
Attached in- formation	Attached informa	ation 1: TimeSerie	es Name (beginning	g 15 characters)			
Precautions/ Remarks	None						

Event name	Export Stopped			Event code	959B0000 hex			
Meaning	The export of the	e Time Series Dat	abase was stoppe	d.				
Source	PLC Function M	odule	Source details	TSDB	Detection tim- ing	When the export is stopped		
Error attrib- utes	Level	Information	Recovery		Log category	System		
Effects	User program	Continues.	Operation	Not affected.				
System-de-	Variable		Data type		Name			
fined varia- bles	_TSDB_ExptSta		ARRAY [031] o	f BOOL	Export Execution	n Flag		
Cause and	Assumed cause	9	Correction		Prevention			
correction	The export of the Time Series Database was stopped.							
Attached in- formation	Attached informa	Attached information 1: TimeSeries Name (beginning 15 characters)						
Precautions/ Remarks	None							
Event name	TimeSeries Setti	ng Updated		Event code	959C0000 hex			
Meaning	The TimeSeries	setting was updat	ed.					
Source	PLC Function M	odule	Source details	TSDB	Detection tim- ing	When down- loading		
Error attrib- utes	Level	Information	Recovery		Log category	System		
Effects	User program	Continues.	Operation	Not affected.				
System-de-	Variable		Data type		Name			
fined varia- bles	None							
Cause and	Assumed cause	9	Correction		Prevention			
correction	The TimeSeries controller setting	• .						
Attached in- formation			s Name (beginning	g 15 characters)	•			
Precautions/ Remarks	None							

Feature Value/Machine Learning Function

• Feature Extraction Function

Event name	Feature Extraction	on Setting Error		Event code	35EB0000 hex		
Meaning	There is an error	r in the settings of	the Feature Extra	he Feature Extraction Function.			
Source	PLC Function M	odule	Source details	FE/MLE	Detection timing	When down- loading, at power ON, or Controller reset	
Error attrib- utes	Level	Minor fault	Recovery	Downloading by the Al Oper- ator or Sysmac Studio	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable D		Data type		Name		
fined varia- bles	_FE_Status		_eFE_STATUS		Feature Extraction Service Status		
Cause and	Assumed cause	9	Correction Register the variable from the Sysmac Studio and then down- load the settings.		Prevention		
correction	There is a variable registered in the				Download from the Sysmac Studio first and then from the Al Operator next.		
		Power was interrupted while the setting was being downloaded.		Perform the Clear All Memory operation or download the set-		Do not interrupt the power supply during download of the settings,	
		Power was interrupted during the Clear All Memory operation.		tings.		y, or restore op-	
		Power was interrupted during the restore operation.					
	Non-volatile mer	mory failed.	Replace the AI C	Replace the Al Controller.		None	

Attached information

Attached information 1: Classification for identifying the cause of the error

01 hex: Setting error

02 hex: Variable setting error

03 hex: Non-volatile memory access error

Attached information 2: Classification for identifying the cause of the error

When the value of attached information 1 is 1

01 hex: Setting error

When the value of attached information 1 is 2 01 hex: A variable that is not existed was specified

02 hex: A data type that is not permitted was specified

03 hex: A variable with the Constant attribute was specified for the output frame variable of the feature extraction.

Attached information 3: Classification for identifying the cause of the error. Only when the value of attached information 1 is 1 or 2

65535: A setting error of the Feature Extraction Function shared by equipment events

0 to 127: Equipment event number where an error was detected first

(ID corresponding to the equipment event name in equipment event or data set registration on the Al Operator)

Attached information 4: Number of equipment events that have a setting error

When the value of attached information 3 is 65535

0: Equipment event setting error

1: Setting error in linking with the Time Series Database

When the value of attached information 3 is from 0 to 127

1 to 128: Number of equipment events that have a setting error

Precautions/ Remarks

None

Event name	PLC System Processing Error		Event code	446F0000 hex			
Meaning	An error was det	ected in the PLC	Function Module.		•		
Source	PLC Function Module		Source details	FE/MLE	Detection tim- ing	Continuously	
Error attrib- utes	Level	Minor fault	Recovery	Cycle the pow- er supply.	Log category	System	
Effects	User program Continues.		Operation	The Feature Ext	he Feature Extraction Function stops.		
System-de-	Variable	Variable [Data type		Name	
fined varia- bles	None						
Cause and	Assumed cause	•	Correction		Prevention		
correction	An error occurred in the software or hardware.		Contact your OMRON representative.				
Attached in- formation	None						
Precautions/ Remarks	None						

Event name	Feature Extracti	on Service TimeSe	eries Write Error	Event code	44710000 hex	
Meaning	Writing from the	feature extraction	service to TimeSe	eries failed.		
Source	PLC Function M	odule	Source details	FE/MLE	Detection tim- ing	Periodically
Error attrib- utes	Level	Observation	Recovery	_	Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	None					
Cause and	and Assumed cause		Correction		Prevention	
correction	The TSDB service was stopped.		Start the TSDB s	service.		
	The TSDB service was shutdown.		Cycle the power supply to the Al Controller and start the TSDB service.			
		There is insufficient free space in the internal buffer of the TSDB service.		 Increase the set value for the task period of the primary periodic task. Decrease the number of equipment events. 		
	The SD Memory Card was removed. (for NX-series Al Controllers)		Insert an SD Memory Card.			
	The expanded storage was removed. (for NY-series AI Controllers)		Turn off the power supply to the NY-series Al Controller and mount the expanded storage, and then turn on the power supply.			
Attached in- formation	None		,			
Precautions/ Remarks	None					

Event name	Feature Extraction	on Setting Change	ged Event code 95E30000 hex			
Meaning	The setting of the	he setting of the Feature Extraction Function was updated.				
Source	PLC Function Mo	odule	Source details	FE/MLE	Detection tim- ing	When down- loading
Error attrib- utes	Level	Information	Recovery		Log category	Access
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia-	None					
bles						
Cause and	Assumed cause		Correction		Prevention	
correction	tion The setting of the Feature Extraction Function was changed with the Al Operator.					
	The setting of the traction Function by the Clear All N tion.	was changed				
	The setting of the traction Function by the download	was changed operation.				
	The setting of the traction Function by the restore op	was changed				
Attached in- formation	None					
Precautions/ Remarks	None					
Event name	Feature Extraction	on Service Stoppe	ed	Event code	95E40000 hex	
Meaning	The Feature Ext	action Function e	ntered the idle sta	te.		
Source	PLC Function Mo	odule	Source details	FE/MLE	Detection tim- ing	At power ON, when down- loading, when memory is all cleared, at re- store operation
Error attrib- utes	Level	Information	Recovery		Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	_FE_Status		_eFE_STATUS		Feature Extraction tus	on Service Sta-
Cause and	Assumed cause)	Correction		Prevention	
correction	The Feature Extremely entered the idle					
Attached in- formation	None					
Precautions/ Remarks	None					

Event name	Feature Extraction	on Service Started		Event code	95E50000 hex	
Meaning	The Feature Extraction Function entered the running state.					
Source	PLC Function Module		Source details	FE/MLE	Detection timing	When reading the setting of the Feature Ex- traction Func- tion is complet- ed normally
Error attrib- utes	Level	Information	Recovery		Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	_FE_Status		_eFE_STATUS		Feature Extraction Service Status	
Cause and	Assumed cause	9	Correction		Prevention	
correction	The Feature Extraction Function entered the running state.					
Attached in- formation	None					
Precautions/ Remarks	None					

• Machine Learning Function

Event name	Machine Learnin	g Service Setting	Error	Event code	35EA0000 hex	35EA0000 hex	
Meaning	There is an error	in the machine le	arning function se	tting.			
Source	PLC Function M			Detection timing	At power ON, Controller re- set, or when downloading settings		
Error attrib- utes	Level	Minor fault	Recovery	Downloading by the Al Oper- ator or Sysmac Studio	Log category	System	
Effects	User program	Continues.	Operation Not affected.				
System-de-	Variable		Data type		Name		
fined varia- bles	_MLE_Status		_eMLE_STATUS		Machine Learning Service Status		
Cause and	Assumed cause	9	Correction		Prevention		
correction		There is a variable that is not registered in the Sysmac Studio.		Register the variable from the Sysmac Studio and then download the settings.		Download from the Sysmac Stu- dio first and then from the AI Op- erator next.	
		Power was interrupted while the setting was being downloaded.		Download the setting from the Al Operator (machine learning serv-		Do not interrupt the power supply during download of the settings,	
		Power was interrupted during the Clear All Memory operation.		ice setting) or Sysmac Studio (variable setting).		Clear All Memory, or restore operations.	
	Power was interrestore operation	rupted during the n.					
	A format error of occurred.	the learned data	Create the learned and then downlo	•	None		
	An mismatch be and the learned	tween the setting data occurred.					

Attached in-	Attached information 1: Classification for identifying the cause of the error
formation	01 hex: Setting error
	02 hex: Variable setting error
	03 hex: Learned data error
	04 hex: Inconsistent setting data
	05 hex: Non-volatile memory access error
	Attached information 2: Classification for identifying the cause of the error
	When the value of attached information 1 is 1
	01 hex: Setting error
	When the value of attached information 1 is 2
	01 hex: A variable that is not existed was specified
	02 hex: A data type that is not permitted was specified
	03 hex: A variable with the Constant attribute was specified for the output frame variable of the ma-
	chine learning.
	When the value of attached information 1 is 3
	01 hex: The learned data cannot read or does not exist
	02 hex: The format of the learned data is not correct
	When the value of attached information 1 is 4
	01 hex: The number of learned data fields and the number of dimensions in the setting file do not match
	02 hex: The number of learned data records and the number of records in the setting file do not match
	Attached information 3: Only when the value of attached information 1 is 1, 2, 3, or 4. Classification for identifying the cause of the error
	65535: Setting error of the Machine Learning Function
	0 to 127: Equipment event number where an error was detected first
	(ID corresponding to the equipment event name in equipment event or data set registration on the Al
	Operator)
	Attached information 4: Only when the value of attached information 3 is from 0 to 127. Number of
	equipment events that have a setting error
	1 to 128: Number of equipment events that have a setting error

Event name	PLC System Processing Error			Event code	446E0000 hex	
Meaning	An error was det	ected in the PLC	Function Module.			
Source	PLC Function M	odule			Detection tim- ing	Continuously
Error attrib- utes	Level	Minor fault	Recovery	Cycle the pow- er supply.	Log category	System
Effects	User program	Continues.	Operation	The Machine Le	arning Function stops.	
System-de-	Variable		Data type		Name	
fined varia- bles	None					
Cause and	Assumed cause	•	Correction		Prevention	
correction	An error occurre or hardware.	d in the software	Contact your ON tative.	IRON represen-		
Attached in-	None					
formation						

Remarks

Event name	Machine Learning Service TimeSeries Write Error			Event code	44700000 hex	
Meaning	Writing from the	machine learning	service to TimeSe	eries failed.		
Source	PLC Function M	odule	Source details	FE/MLE	Detection tim- ing	Periodically
Error attrib- utes	Level	Observation	Recovery		Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	None					
Cause and	Assumed cause	e	Correction		Prevention	
correction	The TSDB service	ce was stopped.	Start the TSDB s	service.		
	The TSDB servio	ce was shut	Cycle the power	supply to the Al		
	down.		Controller and st	art the TSDB		
			service.		_	
		ent free space in	Increase the s			
	the internal buffe service.	er of the TSDB	odic task.	the primary peri-		
	service.		Decrease the	number of		
			equipment eve			
	The SD Memory Card was re-		Insert an SD Memory Card.		-	
	moved. (for NX-series Al Control-		meer, an earmer, ear ar			
	lers)					
	The expanded s	torage was re-	Turn off the power supply to the			
	,	series Al Control-	NY-series AI Controller and			
	lers)		mount the expan	•		
			and then turn on	the power sup-		
Attached in-	None		ply.			
formation	INOTIE					
Precautions/	None					
Remarks						

Event name	Machine Learnin	g Service Setting	Changed	Event code 95E00000 hex		
Meaning	The setting of the	e Machine Learnir	ng Function or the	g Function or the learned data was updated.		
Source	PLC Function Module		Source details	FE/MLE	Detection timing	When down- loading, when memory is all cleared, at re- store operation
Error attrib- utes	Level	Information	Recovery		Log category	Access
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	None					
Cause and	Assumed cause		Correction		Prevention	
Cause and correction	Learning Function data was change Operator.	The setting of the Machine Learning Function or the learned data was changed with the Al Operator.				
	The setting of the Machine Learning Function was changed by the Clear All Memory opera- tion.					
	The setting of the Machine Learning Function was changed by the restore operation.					
Attached in- formation	None					
Precautions/	None					
Remarks						

Event name	Machine Learning Service Stopped			Event code	95E10000 hex		
Meaning	The Machine Learning Function entered the idle state.						
Source			Source details	FE/MLE	Detection timing	At power ON, when down- loading, when memory is all cleared, at re- store operation	
Error attrib- utes	Level	Information	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.	·		
System-de-	Variable		Data type	type Name			
fined varia- bles	_MLE_Status		_eMLE_STATUS	3	Machine Learning Service Status		
Cause and	Assumed cause	•	Correction		Prevention		
correction	The status of the	Machine Learn-					
	ing Function ente	ered the reading					
	or error state.						
Attached in-	None						
formation							
Precautions/	None						
Remarks							

Event name	Machine Learnin	g Service Started		Event code	95E20000 hex			
Meaning	The Machine Learning Function entered the running state.							
Source			Source details	FE/MLE	Detection timing	When reading the setting of the Machine Learning Func- tion is complet- ed normally		
Error attrib- utes	Level	Information	Recovery		Log category	System		
Effects	User program	Continues.	Operation	Not affected.				
System-de-	Variable		Data type		Name			
fined varia- bles	_MLE_Status		_eMLE_STATUS	3	Machine Learning Service Status			
Cause and	Assumed cause	9	Correction		Prevention			
correction	The status of the Machine Learning Function entered the idle or running state.							
Attached in-	None							
formation								
Precautions/	None							
Remarks								

WebAPI Connection Function

Event name	WebAPI Connec	tion Service Settir	ng Error	Event code	35F40000 hex		
Meaning	There is an error	in the WebAPI co	onnection service	setting.			
Source	PLC Function M	odule	Source details	Source details WebAPI i		At power ON, Controller re- set, or when downloading settings	
Error attrib- utes	Level	Minor fault	Recovery	Automatic re- covery	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	9	Correction		Prevention		
correction	Setting error		Identify the error from the attached information, correct the setting, and then download the setting again.		None		
	Power was interrupted while the setting was being downloaded.		Perform the Clear All Memory operation or download the set-		Do not interrupt the power supply during download of the settings,		
		Power was interrupted during the Clear All Memory operation.		tings.		Clear All Memory, or restore operations.	
	Power was interrrestore operation	rupted during the					
	Non-volatile mer	nory failed.	Replace the Al C	Controller.	None		
Attached information	01 hex: Non- 02 hex: Web. 03 hex: Certi 04 hex: File t Attached Informa Connection I	Attached information 1: Error details 01 hex: Non-volatile memory access error 02 hex: WebAPI connection service setting is not correct 03 hex: Certificate management setting is not correct 04 hex: File upload setting is not correct Attached Information 2: Only when attached information 1 is 3 or 4 Connection ID (01 hex-) (It corresponds to the combo box for selecting a destination in the WebAPI Settings Tab Page on the AI Operator.)					
Precautions/ Remarks	None						

Event name	Error Error	tion Service Syste	em Processing	Event code	44780000 hex		
Meaning	A fatal error was	detected in the W	ebAPI connection	service.			
Source	PLC Function Me	odule	Source details	WebAPI	Detection tim- ing	Continuously	
Error attrib- utes	Level	Minor fault	Recovery	Cycle the pow- er supply or re- set the Control- ler.	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	9	Correction		Prevention		
correction	A fatal error was WebAPI connect		Contact your ON tative.	IRON represen-			
Attached in- formation	Attached information 1: System information Attached information 2: System information Attached information 3: System information Attached information 4: System information						
Precautions/ Remarks	None None						
Event name	Director: Access	. Tailed		Event code	65450000 hex		
Event name	Directory Access		torod the transfer				
Meaning Source	PLC Function M		Source details	WebAPI	Detection tim-	At file transfer	
					ing		
Error attrib- utes	Level	Minor fault	Recovery	Remove the error and transfer the file	Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause	9	Correction		Prevention		
correction	The directory specified the source file to transfer does not exist.		The directory to specify a transfer file is wrong.		Specify an existing directory in the SD Card inserted to the PLC.		
	The SD Memory Card is not inserted (when the SD Memory Card was specified for the transfer source)		Insert an SD Memory Card.		Insert an SD Memory Card.		
	The SD Memory moved during the file upload (wher Card was specifi fer source)	e execution of the SD Memory	-		Do not remove the SD Memory Card while the file upload func- tion is running.		
Attached in- formation			n ID (01 hex-) (It o Page on the AI O	=	combo box for se	electing a desti-	
Precautions/	None						
Remarks							

Event name	File Deletion Fai	led		Event code	65460000 hex	
Meaning	Deleting the file	stored in the trans	fer source director	y failed after the f	ile is transferred.	
Source	PLC Function Module		Source details	WebAPI	Detection tim- ing	At file transfer
Error attrib- utes	Level	Minor fault	Recovery	Remove the error and transfer the file	Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type	Name		
fined varia- bles	None					
Cause and	Assumed cause	•	Correction		Prevention	
correction	The SD Memory Card is write-		Remove write protection from the		Remove write protection from the	
	protected.		SD Memory Card. SD Memory Card.			d.
Attached in- formation	Attached information 1: Connection ID (01 hex-) (It corresponds to the combo box for selecting a destination in the WebAPI Settings Tab Page on the Al Operator.)					
Precautions/	None					
Remarks						

Event name	File Upload Failed			Event code	85180000 hex	
Meaning	Uploading a file t	to the HTTP serve	r failed	ailed		
Source	PLC Function Mo	odule	Source details	WebAPI	Detection tim- ing	At file transfer
Error attrib- utes	Level	Minor fault	Recovery	Eliminate the error and transfer the file	Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia- bles	None					
Cause and	Assumed cause	•	Correction		Prevention	
correction	The specified connation URL is inc		Correct the conn tion setting and cagain.		Make sure that t destination settin then download to	ng is correct and
	The specified HT ped the service.	TP server stop-	Make sure that the operates normal		Review the oper server.	
	Equipment settin switch, Proxy set server) in the cor path are incorrec	rver, and DNS mmunications	Correct equipme (Ethernet switch, and DNS server) nications path.	Proxy server,	Make sure that t settings (Etherne server, and DNS communications and then transfe	et switch, Proxy S server) in the path are correct
	The Ethernet cable connector is disconnected.		Make sure that the connector is inserted correctly.		Insert the connector securely.	
	The Ethernet cable is broken.		Replace the Ethe	Replace the Ethernet cable.		
	An error occurred in the communications path.		Check the communications path to see if there is any problem and take corrective measures.		None	
Attached information	nation in the Wel Attached informa 01 hex: Serve 02 hex: HTTF 03 hex: Invali Attached informa When the val Example: 5: Proxy na 6: Host nar 7: Connect 28: Timeou 35: SSL es 59: Incorre When the val HTTP statu When the val 1: The serve	paPI Settings Tab ation 2: Reason for connection failure response error at certificate (for Fation 3: Detailed end attached information and unresolved in failure (host of attached information for service of attached information failure (host of attached information for service of attached information for service of attached information for attached information for certificate is invercentificate is expected.	Ittps communication ror codes formation 2 is 01 h for proxy) er encryption commormation 2 is 02 h formation 2 is 03 h formati	perator.) ons only) ex*1 munications (TLS ex ined in RFC) ex		electing a desti-

Precautions/	This event log is only registered in any of the following cases:
Remarks	The first file transfer failed after powering on the Al Controller
	The last file transfer succeeded and the file transfer this time failed

^{*1.} You can check the cause of the detailed error code on the Al Operator.

Event name	WebAPI Connector	tion Service Root	Certificate Expi-	Event code	65470000 hex		
Meaning	The root certifica	ite of the WebAPI	connection service	e will expire in one	e month.		
Source	PLC Function Module		Source details	WebAPI	Detection timing	At power ON, Controller re- set, when im- porting a certifi- cate, or periodi- cally (every 24 hours)	
Error attrib- utes	Level	Observation	Recovery		Log category	System	
Effects	User program	Continues.	Operation	Not affected.			
System-de-	Variable		Data type Name		Name		
fined varia- bles	None						
Cause and	Assumed cause	•	Correction		Prevention		
correction	It was detected that the root certificate of the WebAPI connection service would expire in one month.						
Attached in- formation	Attached informa "YYYY-MM-DD"	ation 1: Expiration	date of the root ce	ertificate			
Precautions/ Remarks	This event log w icate again.	ill not be registere	d in duplicate until	you restart the A	l Controller or imp	ort the root certif-	

_								
Event name	WebAPI Connec	tion Service Start	ed	Event code	95F10000 hex			
Meaning	The WebAPI cor	nnection service w	as started.					
Source	PLC Function M	odule	Source details	WebAPI	Detection timing	At power ON, Controller re- set, or when executing the service start		
Error attrib- utes	Level	Information	Recovery		Log category	Access		
Effects	User program	Continues.	Operation	Not affected.				
System-de-	Variable		Data type		Name			
fined varia- bles	None							
Cause and	Assumed cause	e	Correction		Prevention			
correction	The WebAPI connection service was started.							
Attached in-	Attached informa	ation 1: Reason fo	r starting					
formation		ration from the AI	Operator					
	02 hex: Auto-start Attached Information 2: Connection method for only when the value of attached information 1 is 1 01 hex: Direct USB connection							
		ct Ethernet connec		oonnootion				
	03 hex: Remote USB connection or Ethernet hub connection Attached Information 3: Only when the value of attached information 2 is 2 or 3							
	Connecting IP address. (Connection through proxy: Proxy IP address)							
Precautions/	None		<u> </u>	<u>, , , , , , , , , , , , , , , , , , , </u>	,			
Remarks								
Event name	WebAPI Connec	tion Service Stop	ped	Event code	95F20000 hex			
Meaning	The WebAPI cor	nnection service w	as stopped.					
Source	PLC Function M	odule	Source details	WebAPI	Detection timing	When executing the service stop		
Error attrib- utes	Level	Information	Recovery		Log category	Access		
Effects	User program	Continues.	Operation	Not affected.				
System-de-	Variable		Data type		Name			
fined varia- bles	None							
Cause and	Assumed cause	е	Correction		Prevention			
correction	The WebAPI cor was stopped.	nnection service						
Attached in-		ation 1: Reason fo	r stopping		1			
formation	01 hex: Operation from the Al Operator							
	Attached Information 2: Connection method for only when the value of attached information 1 is 1							
	01 hex: Direct USB connection							
		ct Ethernet connec						
			on or Ethernet hub) is 2 or 2			
		•	n the value of attac ection through pro					
Precautions/ Remarks	None		ecaon anough pro	A, I TONY II AUGIT				
Kemarks	I .							

Event name	WebAPI Connec	tion Service Settir	ng Updated	Event code	95F30000 hex	
Meaning	The WebAPI cor	nnection service s	etting was updated	d.	•	
Source	PLC Function Module		Source details	WebAPI	Detection tim- ing	When the set- ting is updated
Error attrib- utes	Level	Information	Recovery		Log category	Access
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable None		Data type		Name	
fined varia-						
bles						
Cause and	Assumed cause	e	Correction		Prevention	
correction	The WebAPI connection service					
	setting was upda	ated.				
Attached in-	Attached Informa	ation 1: Connectio	n method			
formation	01 hex: Direc	ct USB connection	1			
	02 hex: Direc	t Ethernet connec	ction			
	03 hex: Rem	ote USB connection	on or Ethernet hub	connection		
	Attached Informa	ation 2: Only wher	n the value of attac	ched information 1	is 2 or 3	
	Connecting I	P address. (Conn	ection through pro	xy: Proxy IP addre	ess)	
Precautions/	None					
Remarks						


Event name	File Upload Suco	ceeded		Event code	95F40000 hex	
Meaning	The file upload to	the HTTP server	has succeeded.			
Source	PLC Function Module		Source details	WebAPI	Detection tim- ing	At file transfer
Error attrib- utes	Level	Information	Recovery		Log category	System
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type	Name		
fined varia-	None					
bles						
Cause and	Assumed cause	•	Correction		Prevention	
correction	The file transfer	to the HTTP				
	server has succe	eeded.				
Attached in-	Attached Informa	ation 1: Connectio	n ID (01 hex-)			
formation						
Precautions/	This event log is	only registered in	any of the following	ng cases:		
Remarks	The first file transfer	ansfer succeeded	after powering on	the AI Controller		
	The last file tra	ansfer failed and t	he file transfer this	s time succeeded		

Event name	WebAPI Connec	tion Service Certi	ficate Imported	Event code	95F50000 hex	
Meaning	The root certification	ate of the WebAPI	connection service	e was imported.		
Source	PLC Function Module		Source details	WebAPI	Detection tim- ing	When import-ing a certificate
Error attrib- utes	Level	Information	Recovery		Log category	Access
Effects	User program	Continues.	Operation	Not affected.		
System-de-	Variable		Data type		Name	
fined varia-	None					
bles						
Cause and	Assumed cause		Correction		Prevention	
correction	The root certificate of the WebA-					
	PI connection se	ervice was im-				
	ported.					
Attached in-	Attached Informa	ation 1: Connectio	n method			
formation	01 hex: Direc	t USB connection	l			
	02 hex: Direc	t Ethernet connec	ction			
	03 hex: Rem	ote USB connection	on or Ethernet hub	connection		
	Attached Informa	ation 2: Only wher	the value of attac	ched information 1	is 2 or 3	
		•	ection through pro			
Precautions/	None					
Remarks						

Time Series Database Instructions

Event name	Insufficient Time	Series Resources		Event code	54014C0C hex		
Meaning	There is not suff	icient resources to	execute the Time	cute the Time Series Database Instruction.			
Source	PLC Function Module		Source details	Instruction	Detection tim- ing	At instruction execution	
Error attrib- utes	Level	Observation	Recovery		Log category	System	
Effects	User program	Continues.	Operation The relevant instructions.		ruction will end according to speci-		
System-de-	em-de- Variable		Data type		Name		
fined varia- bles	None						
Cause and	Assumed cause		Correction		Prevention		
correction	Insufficient free s	space in the in-	Review the number of internal				
	ternal buffer of the TSDB service		buffers specified in the TSDB				
			service setting.				
Attached in-	None						
formation							
Precautions/	None						
Remarks							

Event name	TSDB Service C	ontrol Disabled		Event code	54014C0D hex		
Meaning	While the TSDB cuted.	service was in the	Error or Shutdow	n state, Start com	nmand or Stop cor	mmand was exe-	
Source	PLC Function Module		Source details	Instruction	Detection tim- ing	At instruction execution	
Error attrib- utes	Level	Observation	Recovery		Log category	System	
Effects	User program	Continues.	Operation The relevant instructions.		truction will end a	ccording to speci-	
System-de-	Variable None		Data type		Name	ıme	
fined varia- bles							
Cause and	Assumed cause	9	Correction		Prevention	Prevention	
correction	The relevant instruction was executed while the TSDB service was shutting down.		Cycle the power Controller, and the relevant instruction	nen execute the	Write the user program so that the relevant instruction is not executed while the TSDB service is shutting down.		
	The relevant instruction was executed while the TSDB service was in the error state.		Update the setting or execute the Clear All Memory operation to set the Al Controller to the factory state.		Write the user program so that the relevant instruction is not executed while the TSDB service is in the error state.		
Attached in- formation	None		1 -				
Precautions/ Remarks	None						



Al Predictive Maintenance Library

This section describes the overview and features of the Al Predictive Maintenance Library.

9-1	Overview of Al Predictive Maintenance Library	9-2
9-2	Features of Al Predictive Maintenance Library	9-3

9-1 Overview of Al Predictive Maintenance Library

The AI Predictive Maintenance Library is one of the function components of the Sysmac Library software that allows you to use the AI functions of the AI Controller.

The Al Predictive Maintenance Library consists of libraries containing the function blocks (FB, hereinafter) for each mechanism (devices and components) used.

When the control and status data of the running mechanism is passed to the FBs, the outlier detection of the mechanism can be performed with the Feature Value/Machine Learning Function of the Al Controller.

The Al Predictive Maintenance Library allows you to perform predictive maintenance easily with the Al functions.

9-2 Features of Al Predictive Maintenance Library

The AI Predictive Maintenance Library has the following features.

Simplified Preparation Processes for Using the Al Functions

The AI Predictive Maintenance Library does not require event definitions for the mechanisms for which predictive maintenance is performed.

Therefore, you can realize to perform the advanced Al-based predictive maintenance even without special knowledge

Selection of Components Used for Typical Mechanisms

The Al Predictive Maintenance Library offers a selection of software function components that can be used for typical mechanisms, such as cylinders and belt conveyors.

The AI functions can be used for multiple mechanisms.

Inherits the Sysmac Library Concept

The AI Predictive Maintenance Library inherits the conventional "Sysmac Library" concept. This means that you can directly apply the conventional usage of "Sysmac Library", so that you can use AI functions with little additional learning.

For details on the Al Predictive Maintenance Library, refer to the *Sysmac Library Al Predictive Maintenance Library User's Manual (Cat. No. W610)*.

9	ΑI	Predictive	Maintenance	Library	
---	----	------------	-------------	---------	--



Appendices

This section describes the supplemental information for the body of this manual, such as the detailed specifications of the AI Controllers, specifications for individual system-defined Variables, and the CSV format specifications.

A-1	Speci	fications	A-2
	A-1-1	Specifications Unique to the Al Controllers	
	A-1-2	Common Specifications with Standard Models	
A-2	List of	f System-defined Variables	A-6
	A-2-1	Common Variables	
	A-2-2	Time Series Database Function	A-8
	A-2-3	Feature Value/Machine Learning Function	A-10
	A-2-4	WebAPI Function	A-13
A-3	Specif	fications for Individual System-defined Variables	A-14
	A-3-1	System-defined Variables for the Overall Al Controller (No Category)	A-14
	A-3-2	Al Function Modules, Category Name: _AIC	A-16
	A-3-3	Al Function Modules, Category Name: _TSDB	A-17
	A-3-4	Al Function Modules, Category Name: _FE	A-23
	A-3-5	Al Function Modules, Category Name: _MLE	A-24
	A-3-6	Al Function Modules, Category Name: _WAC	A-26
A-4	Proce	ssing in the Data Collection, Data Analysis, and Data Uti-	
	lization	n Phases	A-28
	A-4-1	Data Collection Phase	A-28
	A-4-2	Data Analysis Phase	A-29
	A-4-3	Data Utilization Phase	A-29
A-5	CSV F	ile Format	A-32
	A-5-1	Variable Data File (RAW-***.csv)	A-32
	A-5-2	Analysis Data File (ANL-***.csv)	A-33
	A-5-3	Feature Value File (FTR-****.csv)	
	A-5-4	Equipment Event Monitoring Result File (AIS-***.csv)	A-35
A-6	Versio	on Information	A-38
	A-6-1	Version Information for NX-series AI Controllers	A-38
	A-6-2	Version Information for NY-series AI Controllers	A-38
	A-6-3	Specifications When Not Using the Sysmac Studio Version That Cor-	
		responds to the Unit Version of the Al Contoller	A-38

A-1 Specifications

This section describes the specifications of the Al Controller.

The AI Controllers refer to the standard CPU Units without the AI functions or the IPC Machine Controllers that are equipped with the AI functions. Thus, the AI Controller specifications are classified into those unique to the AI Controllers and those common to the standard CPU Units or the IPC Machine Controllers. For the specifications that are unique to the AI Controllers, refer to *A-1-1 Specifications Unique to the AI Controllers* on page A-2. For the specifications that are common to the standard CPU Units or the IPC Machine Controllers, refer to *A-1-2 Common Specifications with Standard Models* on page A-5.

A-1-1 Specifications Unique to the Al Controllers

This section describes the AI Controller specifications that are unique to the AI Controllers.

Function Specifications of AI Functions

Refer to the following sections for each function specification of the AI functions.

- Time Series Database Function
 Section 2 Time Series Database Function on page 2-1
- Feature Value/Machine Learning Function
 Section 3 Feature Value/Machine Learning Function on page 3-1
- WebAPI Connection Function
 Section 4 WebAPI Connection Function on page 4-1

SD Memory Card Specifications (NX701-Z□□□ Only)

This section describes the specifications of the SD Memory Cards used in the NX-series AI Controller.

An SD Memory Card is already inserted into the NX-series Al Controller in the factory default state.

Model	Card type	Capacity [GB]	Format	Number of overwrites	Weight
HMC-SD1A1*1	SDHC Card	16	FAT32	100,000	2 g max.

Always use the HMC-SD1A1 SD Memory Card.



Additional Information

Write Protection Key

You will not be able to write to the SD Memory Card if the key is set to the LOCK position. Use this setting to prevent overwriting.



Memory Specifications (NY5□2-Z□□□ Only)

The following table shows the memory specifications for the NY-series AI Controller.

Item		Specification	
Total memory size / Memory size for Windows		16 GB/12.8 GB (for Windows 64-bit version)	
Memory type		DDR3L	
Package memory format		SO-DIMM	
Serial Presence Detect (SPD) Speed grade		1.600 Mbps	
	CAS latency	CL11	




Additional Information

Small Outline Dual In-Line Memory Modules (SO-DIMM) cannot be added or replaced by users.

Drive Bay Component Specifications (NY5□2-Z□□□ Only)

The drive bays of the NY-series AI Controllers support 2.5-inch Solid State Drive (SSD).

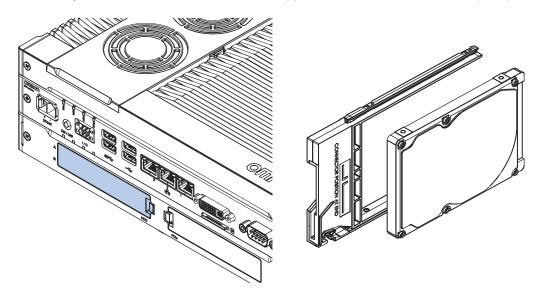

A storage is inserted into both of the drive bays of the NY-series AI Controller in the factory default state. The following table shows the specifications of the drive bay components for the NY-series AI Controllers.

Drive bay	Inserted storage type	Storage (SSD) format	Description
Α	Expanded storage	NY000-AS06	It is designed for the Machine Automation Control Software. It cannot be accessed from the
			Windows operating systems.
			Drive Bay A is a bay for a connector.
В	Main storage	NY000-AS04	It is designed for the Windows operating sys-
			tems. It cannot be accessed from the Machine
			Automation Control Software.
			Drive Bay B is a bay located on the display pan-
			el (for Panel PCs) or a bay located on the exteri-
			or side (for Box PCs).



Precautions for Correct Use

Make sure to insert a main storage for the operating systems to the correct drive bay. If you insert it into a wrong drive bay, the AI Controller may not start.

SSD Specifications (NY5□2-Z□□□ Only)

The following table shows the SSD specifications for the NY-series AI Controllers.

Item	Model spe	ecification
Model	NY000-AS04*1	NY000-AS06*2
Capacity	128 GB	
Туре	iMLC	pSLC
Details	Innodisk:	Innodisk:
	DES25-A28M41BC1DC	DHS25-A28M41BC1DC
S.M.A.R.T. supported	Yes	
Interface	Serial ATA 3.1	
Sustained read speed	530 MB/s max.	530 MB/s max.
Sustained write speed	210 MB/s max.	380 MB/s max.
Operating temperature	0 to 70°C*3	
Operating humidity	10% to 95%RH (with no	condensation)*3
Storage temperature	-55 to 95°C*3	
Storage humidity	10% to 95%RH (with no condensation)*3	
Life	374 TB	2500 TB

^{*1.} It is a dedicated storage device to be inserted into Drive Bay B of an NY5\(\subseteq 2-Z\subseteq \subseteq \subseteq Controller and is used as the main storage. Do not use it for any other purpose.

Installer for the Al Controller Software (NY5□2-Z□□□ Only)

An installer used to install the AI Controller Software that is called the AI Viewer and the AI Operator into Windows is saved in the NY-series AI Controllers. The installer is located in D:\OMRON-NY\Installers\AI_Controller_Standard_Software.

When you install the Al Viewer and the Al Operator, open the above storage folder with Windows Explorer or similar applications and double-click the setup.exe file. For details on the installation procedure and specifications of the installed Al Controller Software, refer to the *Al Controller Standard Software Operation Manual (Cat. No. W611)*.

^{*2.} It is a dedicated storage device to be inserted into Drive A of an NY5□2-Z□□□ Controller and is used as the expanded storage. Do not use it for any other purpose.

^{*3.} For the overall specifications of the NY-series Al Controllers, refer to *A-1-2 Common Specifications with Standard Models* on page A-5.

A-1-2 Common Specifications with Standard Models

The specifications of the AI Controller other than the specifications described in *A-1-1 Specifications Unique to the AI Controllers* on page A-2 are in common with those of standard CPU Units or IPC Machine Controllers without the AI functions. Refer to the corresponding specifications for each AI Controller model according to the table below.

Al Controller model	Corresponding standard model
NX701-Z700	NX701-1700
NX701-Z600	NX701-1600
NY532-Z500	NY532-1500
NY532-Z400	NY532-1400
NY532-Z300	NY532-1300
NY512-Z500	NY512-1500
NY512-Z400	NY512-1400
NY512-Z300	NY512-1300

General Specifications

Refer to the hardware user's manual for general specifications.

- · NX-series Al Controller:
 - NX-series CPU Unit Hardware User's Manual (Cat. No. W535)
- NY-series AI Controller (NY532-Z□□□):
 - NY-series Industrial Panel PC Hardware User's Manual (Cat. No. W557)
- NY-series AI Controller (NY512-Z□□□):
 - NY-series Industrial Box PC Hardware User's Manual (Cat. No. W556)

Performance Specifications

Refer to the following manual for the performance specifications.

- · NX-series AI Controller:
 - NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501)
- · NY-series Al Controller:
 - NY-series Industrial Panel PC / Industrial Box PC Software User's Manual (Cat. No. W558)

Function Specifications

Function Specifications other than AI functions are same as those for the standard CPU Units or for the IPC Machine Controllers without the AI functions. Refer to the following manual.

- · NX-series Al Controller:
 - NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501)
- · NY-series Al Controller:
 - NY-series Industrial Panel PC / Industrial Box PC Software User's Manual (Cat. No. W558)

A-2 List of System-defined Variables

This section describes the system-defined variables that are unique to the Al Controllers. System-defined variables except for the Al Controller are used in the same series. For more information on the NX-series Controllers, refer to the *NJ/NX-series CPU Unit Software User's Manual (Cat. No. W501)*. For more information on the NY-series Controllers, refer to the *NY-series Industrial Panel PC / Industrial Box PC Software User's Manual (Cat. No. W558)*.

A-2-1 Common Variables

Variable name	Meaning	Function	Data type	Range of values
_AIC_Version	AIC Version	Shows the version of the AI Controller package. The integer part of the version is stored in the element number 0. The fractional part of the version is stored in the element number 1. Example) If the unit version is 1.10, 1 is stored in element number 0 and 10 is stored in element number 1.	ARRAY[01] OF USINT	0 to 99
_Card1Capacity	SD Memory Card Storage Capacity	Specifies the total capacity of the inserted SD Memory Card (NX-series) or that of the Virtual SD Memory Card (NY-series). The unit is MiB. (1 MiB = 1,048,576 Byte) The value is updated every 60 seconds. If the SD PWR indicator is not lit, such as when an SD Memory Card is not inserted, the value is "0" (NX-series). If the Virtual SD Memory Card is disabled, the value is "0" (NY-series).	UDINT	Depends on the data type.

Variable name	Meaning	Function	Data type	Range of values
_Card1Used	SD Memory Card Storage Usage	Specifies the usage of the inserted SD Memory Card (NX-series) or that of the Virtual SD Memory Card (NY-series). The unit is MiB. (1 MiB = 1,048,576 Byte) The value is updated every 60 seconds. If the SD PWR indicator is not lit, such as when an SD Memory Card is not inserted, the value is "0" (NX-series). If the Virtual SD Memory Card is disabled, the value is "0" (NY-series).	UDINT	Depends on the data type.
_Card1RestoreCmdTar- getAicMLD* ¹	Al Machine Learning Model Transfer Flag	TRUE when you specify the AI machine learning model as the transfer target for the restore operation with the system-defined variable of the SD Memory Card backup function. Always set this variable to TRUE for the restore with the system-defined variable.	BOOL	TRUE or FALSE
_ExtendedStor- age1Ready	Extended Storage1 Ready Flag	Specifies the usage status of the storage to which CSV files are exported from the Time Series Database Function. TRUE: Available FALSE: Not available	BOOL	TRUE or FALSE
_ExtendedStorage1Ca- pacity	Extended Storage1 Capacity	Specifies the total capacity of the storage to which CSV files are exported from the Time Series Database Function. The unit is MiB. (1 MiB = 1,048,576 Byte)	UDINT	Depends on the data type.
_ExtendedStor- age1Used	Extended Storage1 Usage	Specifies the usage of the storage to which CSV files are exported from the Time Series Database Function. The unit is MiB. (1 MiB = 1,048,576 Byte) The value is updated periodically.	UDINT	Depends on the data type.
_ExtendedStor- age2Ready* ²	Extended Storage2 Ready Flag	Specifies the usage status of the expanded storage that is mounted to the drive bay A. TRUE: Available FALSE: Not available	BOOL	TRUE or FALSE
_ExtendedStorage2Ca- pacity* ²	Extended Storage2 Capacity	Specifies the total capacity of the expanded storage that is mounted to the drive bay A. The unit is MiB. (1 MiB = 1,048,576 Byte)	UDINT	Depends on the data type.

Variable name	Meaning	Function	Data type	Range of values
_ExtendedStor- age2Used*2	Extended Storage2 Usage	Specifies the usage of the expanded storage that is mounted to the drive bay A. The unit is MiB. (1 MiB = 1,048,576 Byte) The value is updated periodically.	UDINT	Depends on the data type.

^{*1.} This can be used for the NX-series only.

A-2-2 Time Series Database Function

	Variable name	Meaning	Function	Data type	Range of val-
	Member name			,,	ues
_TSDB_Status		TSDB Service Status	Shows the operation status of the TSDB service.	_sTSDB_STA- TUS	
	Run	Running	TRUE when the TSDB service is running.	BOOL	TRUE or FALSE
	Idle	Idle	TRUE when the TSDB service is idle.	BOOL	TRUE or FALSE
	Error	Error	TRUE when the TSDB service is stopped by an error.	BOOL	TRUE or FALSE
	Shutdown	Shutdown	TRUE when the TSDB service has shut down.	BOOL	TRUE or FALSE
_T:	SDB_ShutdownCmd	TSDB Service Shut- down Command	TRUE when you shut down the TSDB service.	BOOL	TRUE or FALSE
_TSDB_TSName		TimeSeries Name	Specifies a TimeSeries name.	ARRAY[031] OF STRING(64)*1	Depends on the data type.
_TSDB_TSSta		TimeSeries Status	Shows the TimeSeries status.	ARRAY[031] OF _sTSDB_TSST A*1	

^{*2.} This can be used for the NY-series only.

	Variable name	Meaning	Function	Data type	Range of val-
	Member name			Data type	ues
	IsCreate	TimeSeries Creation Flag	TRUE when the TimeSeries has already been created.	BOOL	TRUE or FALSE
	IsOpen	TimeSeries Open Status Flag	TRUE when the TimeSeries is already opened.	BOOL	TRUE or FALSE
	IsSmpl	Sampling Execution Flag	TRUE when sampling is being executed.	BOOL	TRUE or FALSE
	IsExpt	Export Execution Flag	TRUE when export is being executed.	BOOL	TRUE or FALSE
	IsExptRec	Export Record Existence Flag	TRUE when export is being executed and the record to be exported exists.	BOOL	TRUE or FALSE
	OpenErr	Sampling Mode Open Error Flag	TRUE when an error occurred during TimeSeries open processing.	BOOL	TRUE or FALSE
	SmplErr	Sampling Error Flag	TRUE when there is an error in the sampling.	BOOL	TRUE or FALSE
	ExptErr	Export Error Flag	TRUE when there is an error in the export.	BOOL	TRUE or FALSE
	ErrCode	Error Cause Code	Shows the cause of the error occurred in TimeSeries. Refer to A-3-3 AI Function Modules, Category Name: _TSDB on page A-17 for the meaning of the values.	WORD	16#0000 to 16#FFFF
_TS	SDB_SmplStartCmd	Sampling Start Com- mand	TRUE when you start sampling of the TimeSeries.	ARRAY[031] OF BOOL*1*2	TRUE or FALSE
_T	SDB_SmplStopCmd	Sampling Stop Com- mand	TRUE when you stop sampling of the TimeSeries.	ARRAY[031] OF BOOL*1*2	TRUE or FALSE
T	SDB_ExptStartCmd	Export Start Command	TRUE when you start export of the TimeSeries.	ARRAY[031] OF BOOL*1	TRUE or FALSE
_TS	SDB_ExptStopCmd	Export Stop Command	TRUE when you stop export of the TimeSeries.	ARRAY[031] OF BOOL*1	TRUE or FALSE
T	SDB_ClearCmd	TimeSeries Clear Com- mand	TRUE when you clear data in the TimeSeries.	ARRAY[031] OF BOOL*1	TRUE or FALSE
T	SDB_SmplMode	TimeSeries Sampling Mode	Shows the mode of the defined TimeSeries. 0: Not used 1: Using	ARRAY[031] OF UINT*1	0 or 1
_T:	SDB_CreateCmd	TimeSeries Creation Command	Issue a command to recreate a TimeSeries. While the TSDB service status is idle, this flag can be switched from FALSE to TRUE. You can also recreate a TimeSeries by opening the Monitor/ Operation screen on Al Operator and selecting TimeSeries, and then pressing the Reconstruct Button	ARRAY[031] OF BOOL*1	TRUE or FALSE

Variable name Member name	Meaning	Function	Data type	Range of values
_TSDB_Version	TSDB Service Version	Shows the version of the TSDB service. The integer part of the version is stored in the element number 0. The fractional part of the version is stored in the element number 1. Example) If the TSDB function version is 1.10, 1 is stored in element number 0 and 10 is stored in element number 1.	ARRAY[01] OF USINT	0 to 99

^{*1.} The array element numbers correspond to the following:

A-2-3 Feature Value/Machine Learning Function

Feature Extraction Function

Variable name	Meaning	Function	Data type	Range of values
_FE_Status	Feature Extraction Service Status	Shows the status of the feature extraction serviceFE_STATUS_INITIALIZE: Initializing _FE_STATUS_LOAD: Loading _FE_STATUS_IDLE: Idle _FE_STATUS_RUN: Running _FE_STATUS_PARAME- TER_ERROR: Error	_eFE_STATUS	Depends on the data type.
_FE_Result	Feature Value	Shows the extracted feature value.	ARRAY[0127, 015] OF LREAL*1	Depends on the data type.
_FE_Enable	Feature Extraction Service Enable Command	Send a command to change the status of the feature extraction service. TRUE when you change the status to Running. When the AI Controller is in the RUN mode, the status changes to Running. FALSE when you change the status to Idle.	BOOL	TRUE or FALSE


^{*1.} The first dimension and the second dimension in the array correspond to the following on the Al Operator screen respectively:

^{0:} RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved

^{*2.} Do not write values to the element [2] and [3]. Element [2] indicates the feature value. Element [3] indicates the equipment event monitoring result. The Feature Value/Machine Learning Function starts and stops the processes.

[•] The first dimension: IDs displayed in the equipment event list.

[•] The second dimension: Feature Values displayed in the adopted variables and feature values. In the following screen example, _FE_Result[2,0] is maximum, _FE_Result[2,1], and _FE_Result[2,2] is the standard deviation for the feature values of equipment event *Equip. Event 3*.

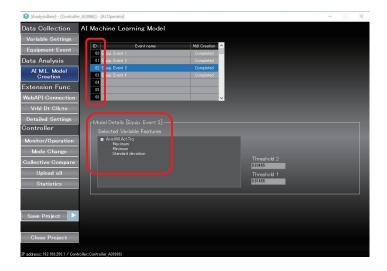


Machine Learning Function

	Variable name	Meaning	Function	Data type	Range of val-
	Member name	Meaning	runction	Buta type	ues
MLE Status		Machine Learning Service Status	Shows the status of the machine learning service. _MLE_STATUS_INITIALIZE: Initializing _MLE_STATUS_LOAD: Loading _MLE_STATUS_IDLE: Idle _MLE_STATUS_RUN: Running _MLE_STATUS_PARAME- TER_ERROR: Error	_eMLE_STA- TUS	Depends on the data type.
_M	LE_Result	Equipment Event Monitoring Result	Shows the equipment event monitoring result.	ARRAY[0127] OF _sMLE_RE- SULT*1	
	Level Judgment Result		Shows the level judgment result1: Judgment failed 0: Initial value (not tested) 1: Normal 2: Alarm level 1 3: Alarm level 2	INT	-1 to 3
	Score Equipment Event Monitoring Score		Shows the equipment event monitoring score. Judgment failed: -∞	LREAL	Depends on the data type.
I		Statistics on Equipment Event Monitoring Result	Shows the judgment statistic of the machine learning service. When the machine learning service enters the Idle state, the value of each member is 0.	ARRAY[0127] OF _sMLE_STA- TISTICS*1	

	Variable name	Meaning	Function	Data type	Range of val-
	Member name	Meaning	runction	Data type	ues
	Level1Count	Number of Level 1 Judgment Results	Shows the number of results judged as Normal.	UDINT	Depends on the data type.
	Level2Count	Number of Level 2 Judgment Results	Shows the number of results judged as Alarm level 1.	UDINT	Depends on the data type.
	Level3Count	Number of Level 3 Judgment Results	Shows the number of results judged as Alarm level 2.	UDINT	Depends on the data type.
	ErrorFrameCount	Number of Frames That Failed the Judgment Shows the number of fr which feature extraction in an error or judgment		UDINT	Depends on the data type.
	ErrorID Cause of the Last Failed Judgment for the Frame		Shows the cause of the last failed judgment for the frame. 1: Input data is invalid (Feature value calculation result is -∞, +∞, or not a number) 2: Frame omission due to exceeded judgment	DWORD	1 to 2
_M	LE_Enable	Machine Learning Service Enable Command	Send a command to change the status of the machine learning service. TRUE when you change the status to Running. FALSE when you change the status to Idle.	BOOL	TRUE or FALSE

^{*1.} Array element numbers indicate the ID of the equipment event. They correspond to the IDs of the equipment event list on the AI Operator.

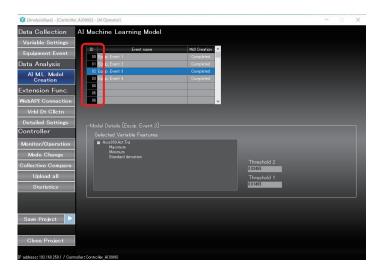

A-2-4 WebAPI Function

Variable name	Meaning	Function	Data type	Range of values
_WAC_Version	WebAPI Version	Shows the version of the WebA-PI package. The integer part of the version is stored in the element number 0. The fractional part of the version is stored in the element number 1. Example) If the WebAPI version is 1.10, 1 is stored in the element number 0 and 10 is stored in the element number 1.	ARRAY[01] OF USINT	0 to 99

A-3 Specifications for Individual Systemdefined Variables

The specifications for each system-defined variable are given as described below.

Variable name	This is the system-defined variable name. The prefix gives the category name.			Member name (for structures)	The member names are given for structure only.
Meaning	This is the meaning of the variable.			Global/local	Global: Global variable Local: Local varia- ble
Function	The function of the variable is described.				
Data type	The data type of the variable is given.			Range of values	The range of values that the variable can take is given.
R/W access	R: Read only, RW: Read/write	Retained	The Retain attribute of the variable is given.	Network Publish	The Network Publish attribute of the variable is given.
Usage in user program	Whether you can use the variable directly in the user program is specified.	Related instruc- tions	The instructions that are related to the variable are given. If <i>Usage in user program</i> is not allowed, the instructions to access the variable are given.		

A-3-1 System-defined Variables for the Overall Al Controller (No Category)

• Functional Classification: Storage

Variable name	_Card1Capacity					
Meaning	SD Memory Card S	torage Capacity		Global/local	Global	
Function	Specifies the total capacity of the inserted SD Memory Card (NX-series) or that of the Virtual SD Memory Card (NY-series). The unit is MiB. (1 MiB = 1,048,576 Byte) The value is updated every 60 seconds. If the SD PWR indicator is not lit, such as when an SD Memory Card is not inserted, the value is "0" (NX-series). If the Virtual SD Memory Card is disabled, the value is "0" (NY-series).					
Data type	UDINT			Range of values	Depends on the data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc- tions				

Variable name	_Card1Used						
Meaning	SD Memory Card S	SD Memory Card Storage Usage Global/local Global					
Function	Specifies the usage of the inserted SD Memory Card (NX-series) or that of the Virtual SD Memory Card (NY-series). The unit is MiB. (1 MiB = 1,048,576 Byte) The value is updated every 60 seconds. If the SD PWR indicator is not lit, such as when an SD Memory Card is not inserted, the value is "0" (NX-series). If the Virtual SD Memory Card is disabled, the value is "0" (NY-series).						
Data type	UDINT			Range of values	Depends on the data type.		
R/W access	R	Retained	Not retained.	Network Publish	Published.		
Usage in user program	Possible.	Related instructions					

Variable name	_Card1RestoreCmdTargetAicMLD*1				
Meaning	Al Machine Learning Model Transfer Flag			Global/local	Global
Function	TRUE when you specify the AI machine learning model as the transfer target for the restore operation with the system-defined variable. Always set this variable to TRUE for the restore with the system-defined variable.				
Data type	BOOL			Range of values	TRUE or FALSE
R/W access	RW	Retained	Retain	Network Publish	Published.
Usage in user	Possible.	Related instruc-			
program		tions			

^{*1.} This can be used for the NX-series only.

Variable name	_ExtendedStorage1Ready					
Meaning	Extended Storage1	Ready Flag		Global/local	Global	
Function	Specifies the usage status of the storage to which CSV files are exported from the Time Series Database Function. TRUE: Available FALSE: Not available					
Data type	BOOL			Range of values	TRUE or FALSE	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc- tions				

Variable name	_ExtendedStorage1	_ExtendedStorage1Capacity				
Meaning	Extended Storage1	Capacity		Global/local	Global	
Function	Specifies the total capacity of the storage to which CSV files are exported from the Time Series Database Function. The unit is MiB. (1 MiB = 1,048,576 Byte)					
Data type	UDINT			Range of values	Depends on the data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

R/W access

program

Usage in user

Variable name	_ExtendedStorage1	_ExtendedStorage1Used				
Meaning	Extended Storage1	Usage		Global/local	Global	
Function	l	of the storage to wh	ich CSV files are exp	orted from the Time	Series Database	
	Function.	4:D 4 040 570 D. 4-	`			
	,	⁄IiB = 1,048,576 Byte	?)			
	The value is update	d periodically.				
Data type	UDINT			Range of values	Depends on the	
	data type.				data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				
Variable name	_ExtendedStorage2	Ready ^{*1}				
Meaning	Extended Storage2	Ready Flag		Global/local	Global	
Function	Specifies the usage	status of the expand	led storage that is mo	ounted to the drive ba	ay A.	
	TRUE: Available					
	FALSE: Not availab	le				
Data type	BOOL			Range of values	TRUE or FALSE	

Retained

tions

Related instruc-

R

Possible.

Variable name	_ExtendedStorage2Capacity*1					
Meaning	Extended Storage2 Capacity			Global/local	Global	
Function	Specifies the total capacity of the expanded storage that is mounted to the drive bay A. The unit is MiB. (1 MiB = 1,048,576 Byte)					
Data type	UDINT			Range of values	Depends on the data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

Not retained.

Network Publish

Published.

^{*1.} This can be used for the NY-series only.

Variable name	_ExtendedStorage2Used*1					
Meaning	Extended Storage2 Usage			Global/local	Global	
Function Data type	Specifies the usage of the expanded storage that is mounted to the drive bay A. The unit is MiB. (1 MiB = 1,048,576 Byte) The value is updated periodically. UDINT Range of values Depends on the					
					data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

^{*1.} This can be used for the NY-series only.

A-3-2 Al Function Modules, Category Name: _AIC

^{*1.} This can be used for the NY-series only.

• Functional Classification: Version

Variable name	_AIC_Version					
Meaning	AIC Version Global/local GI				Global	
Function	Shows the version of the Al Controller package. The integer part of the version is stored in the element number 0. The fractional part of the version is stored in the element number 1. Example) If the unit version is 1.10, 1 is stored in element number 0 and 10 is stored in element number 1.					
Data type	ARRAY [01] OF U	SINT		Range of values	0 to 99	
R/W access	R	Retained	Not retained. Network Publish Published.			
Usage in user program	Possible.	Related instruc- tions				

A-3-3 Al Function Modules, Category Name: _TSDB

• Functional Classification: Time Series Database Function

Variable name	_TSDB_Version							
Meaning	TSDB Service Vers	ion		Global/local	Global			
Function	Shows the version of	of the TSDB service.						
	The integer part of the version is stored in the element number 0.							
	The fractional part of the version is stored in the element number 1.							
	Example) If the TSDB function version is 1.10, 1 is stored in element number 0 and 10 is stored in							
	element number 1.							
Data type	ARRAY [01] OF U	SINT		Range of values	0 to 99			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user	Possible.	Related instruc-						
program		tions						
Variable name	_TSDB_Status			Member name	.Run			
Meaning	Running			Global/local	Global			
Function	TRUE when the TS	DB service is in the r	running state.					
Data type	Structure: _sTSDB_	_STATUS, Member: I	BOOL	Range of values	TRUE or FALSE			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user	Possible.	Related instruc-	TimeSeries_Con	ntrolService				
program		tions						
Variable name	_TSDB_Status			Member name	.ldle			
Meaning	Idle			Global/local	Global			
Function	TRUE when the TS	DB service is in the i	dle state.					
Data type	Structure: _sTSDB_	STATUS, Member: I	300L	Range of values	TRUE or FALSE			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user	Possible.	Related instruc-	TimeSeries_Con	trolService				
program		tions						

Variable name	_TSDB_Status		_TSDB_Status					
Meaning	Error			Global/local	Global			
Function	TRUE when the TS	TRUE when the TSDB service is in the error state.						
Data type	Structure: _sTSDB	_STATUS, Member: I	BOOL	Range of values	TRUE or FALSE			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user	Possible.	Related instruc-	TimeSeries_Co	ntrolService	•			
program		tions						
Variable name	_TSDB_Status			Member name	.Shutdown			
Meaning	Shutdown			Global/local	Global			
Function	TRUE when the TS	DB service is in the	shutdown state.					
Data type	Structure: _sTSDB	_STATUS, Member: I	BOOL	Range of values	TRUE or FALSE			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user program	Possible.	Related instruc-	TimeSeries_Co	ntrolService				
1 - 3								
Variable name	_TSDB_Shutdown(Cmd						
Meaning	TSDB Service Shut	tdown Command		Global/local	Global			
Function	TRUE when you sh	ut down the TSDB so	ervice.					
Data type	BOOL			Range of values	TRUE or FALSE			
R/W access	RW	Retained	Not retained.	Network Publish	Published.			
Usage in user	Possible.	Related instruc-						
program		tions						
Variable name	_TSDB_TSName							
			Global/local	Global				
Meaning	TimeSeries Name							
Meaning Function	TimeSeries Name Stores a TimeSerie	s name.			Clobal			
	Stores a TimeSerie The array element	numbers correspond	•		Global			
	Stores a TimeSerie The array element on the RAW_DATA, 1: A	numbers correspond ANL_DATA, 2: FTR_[•		Ciobai			
	Stores a TimeSerie The array element	numbers correspond ANL_DATA, 2: FTR_[•	4 to 31: Reserved Range of values	Depends on the data type.			
Function	Stores a TimeSerie The array element on the RAW_DATA, 1: A	numbers correspond ANL_DATA, 2: FTR_[•		Depends on the			
Function Data type	Stores a TimeSerie The array element 0: RAW_DATA, 1: A ARRAY [031] OF 3	numbers correspond ANL_DATA, 2: FTR_[STRING(64)	DATA, 3: AIS_DATA	Range of values	Depends on the data type.			
Function Data type R/W access	Stores a TimeSerie The array element 0: RAW_DATA, 1: A ARRAY [031] OF	numbers correspond ANL_DATA, 2: FTR_I STRING(64) Retained	DATA, 3: AIS_DATA, Not retained.	Range of values	Depends on the data type.			
Function Data type R/W access Usage in user	Stores a TimeSerie The array element 0: RAW_DATA, 1: A ARRAY [031] OF	numbers correspond ANL_DATA, 2: FTR_[STRING(64) Retained Related instruc-	DATA, 3: AIS_DATA, Not retained.	Range of values	Depends on the data type.			
Function Data type R/W access Usage in user	Stores a TimeSerie The array element 0: RAW_DATA, 1: A ARRAY [031] OF	numbers correspond ANL_DATA, 2: FTR_[STRING(64) Retained Related instruc-	DATA, 3: AIS_DATA, Not retained.	Range of values	Depends on the data type.			
Function Data type R/W access Usage in user program	Stores a TimeSerie The array element 0: RAW_DATA, 1: A ARRAY [031] OF 3 R Possible.	numbers correspond ANL_DATA, 2: FTR_[STRING(64) Retained Related instructions	DATA, 3: AIS_DATA, Not retained.	Range of values Network Publish	Depends on the data type. Published.			
Function Data type R/W access Usage in user program Variable name	Stores a TimeSerie The array element 0: RAW_DATA, 1: A ARRAY [031] OF 3 R Possible. _TSDB_TSSta TimeSeries Creatio	numbers correspond ANL_DATA, 2: FTR_[STRING(64) Retained Related instructions	Not retained.	Range of values Network Publish Member name	Depends on the data type. Published.			
Function Data type R/W access Usage in user program Variable name Meaning	Stores a TimeSerie The array element or RAW_DATA, 1: A ARRAY [031] OF S R Possible. _TSDB_TSSta TimeSeries Creatio TRUE when the Time	numbers correspond ANL_DATA, 2: FTR_[STRING(64) Retained Related instructions n Flag	Not retained	Range of values Network Publish Member name	Depends on the data type. Published.			
Function Data type R/W access Usage in user program Variable name Meaning	Stores a TimeSerie The array element or RAW_DATA, 1: A ARRAY [031] OF S R Possible. _TSDB_TSSta TimeSeries Creatio TRUE when the Time The array element of the store of the	Retained Related instructions n Flag neSeries has already	Not retained. been created. to the following:	Range of values Network Publish Member name Global/local	Depends on the data type. Published.			
Function Data type R/W access Usage in user program Variable name Meaning	Stores a TimeSerie The array element or RAW_DATA, 1: A ARRAY [031] OF S R Possible. _TSDB_TSSta TimeSeries Creatio TRUE when the Time The array element or RAW_DATA, 1: A	Retained Related instructions n Flag Reserves has already numbers correspond	Not retained. been created. to the following: DATA, 3: AIS_DATA	Range of values Network Publish Member name Global/local	Depends on the data type. Published.			
Function Data type R/W access Usage in user program Variable name Meaning Function	Stores a TimeSerie The array element or RAW_DATA, 1: A ARRAY [031] OF S R Possible. _TSDB_TSSta TimeSeries Creatio TRUE when the Time array element or RAW_DATA, 1: A Structure: ARRAY [031]	Retained Related instructions n Flag neSeries has already numbers correspond ANL_DATA, 2: FTR_E	Not retained. been created. to the following: DATA, 3: AIS_DATA	Range of values Network Publish Member name Global/local 4 to 31: Reserved	Depends on the data type. Published. IsCreate Global			
Function Data type R/W access Usage in user program Variable name Meaning Function Data type	Stores a TimeSerie The array element 0: RAW_DATA, 1: A ARRAY [031] OF 3 R Possible. _TSDB_TSSta TimeSeries Creatio TRUE when the Tin The array element 0: RAW_DATA, 1: A Structure: ARRAY [Member: BOOL	Retained Related instructions n Flag neSeries has already numbers correspond ANL_DATA, 2: FTR_[Retained Related instructions	Not retained. been created. to the following: DATA, 3: AIS_DATA, TSSTA,	Range of values Network Publish Member name Global/local 4 to 31: Reserved Range of values	Depends on the data type. Published. IsCreate Global TRUE or FALSE			

					i		
Variable name	_TSDB_TSSta			Member name	.lsOpen		
Meaning	TimeSeries Open S	tatus Flag		Global/local	Global		
Function		TRUE when the TimeSeries is already opened.					
	1	numbers correspond	•	4 to 21: Bosoniod			
Data type		0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved Structure: ARRAY [031] OF _sTSDB_TSSTA,					
Data type	Member: BOOL	J51] OI _310DD_1	001A,	Range of values	INOL OF TALOE		
R/W access	R	Retained	Not retained.	Network Publish	Published.		
Usage in user	Possible.	Related instruc-					
program		tions					
Variable name	_TSDB_TSSta			Member name	.lsSmpl		
Meaning	Sampling Execution	Flag		Global/local	Global		
Function	·	ng is being executed					
	,	numbers correspond	•				
		NL_DATA, 2: FTR_D					
Data type	Structure: ARRAY [0	031] OF _sTSDB_T	SSTA,	Range of values	TRUE or FALSE		
R/W access	R	Retained	Not retained.	Network Publish	Published.		
Usage in user	Possible.	Related instruc-					
program		tions					
Maniahla mana	TODD TOOL-			Manchanasa	In Franck		
Variable name	_TSDB_TSSta			Member name	.IsExpt		
Meaning	Export Execution Flag			Global/local	Global		
		to to the control of the de-					
Function	TRUE when export	•	to the following:				
Function	TRUE when export The array element r	numbers correspond	•	4 to 31: Reserved			
Data type	TRUE when export The array element r 0: RAW_DATA, 1: A	numbers correspond .NL_DATA, 2: FTR_D	DATA, 3: AIS_DATA,	4 to 31: Reserved Range of values	TRUE or FALSE		
	TRUE when export The array element r 0: RAW_DATA, 1: A	numbers correspond	DATA, 3: AIS_DATA,		TRUE or FALSE		
	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [numbers correspond .NL_DATA, 2: FTR_D	DATA, 3: AIS_DATA,		TRUE or FALSE Published.		
Data type	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [r Member: BOOL	numbers correspond .NL_DATA, 2: FTR_C 031] OF _sTSDB_T	DATA, 3: AIS_DATA, 'SSTA,	Range of values			
Data type R/W access	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [r Member: BOOL R	numbers correspond .NL_DATA, 2: FTR_C31] OF _sTSDB_TRetained	DATA, 3: AIS_DATA, SSTA, Not retained.	Range of values			
Data type R/W access Usage in user	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [r Member: BOOL R	numbers correspond NL_DATA, 2: FTR_D D31] OF _sTSDB_T Retained Related instruc-	DATA, 3: AIS_DATA, SSTA, Not retained.	Range of values			
Data type R/W access Usage in user	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [r Member: BOOL R	numbers correspond NL_DATA, 2: FTR_D D31] OF _sTSDB_T Retained Related instruc-	DATA, 3: AIS_DATA, SSTA, Not retained.	Range of values			
Data type R/W access Usage in user program	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [t Member: BOOL R Possible. _TSDB_TSSta Export Record Exist	numbers correspond NL_DATA, 2: FTR_C D31] OF _sTSDB_T Retained Related instructions	Not retained.	Range of values Network Publish Member name Global/local	Published.		
Data type R/W access Usage in user program Variable name	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [I Member: BOOL R Possible. _TSDB_TSSta Export Record Exist TRUE when export	numbers correspond INL_DATA, 2: FTR_D D31] OF _sTSDB_T Retained Related instructions tence Flag is being executed an	Not retained d the record to be ex	Range of values Network Publish Member name Global/local	Published. IsExptRec		
Data type R/W access Usage in user program Variable name Meaning	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [t Member: BOOL R Possible. _TSDB_TSSta Export Record Exist TRUE when export The array element r	numbers correspond INL_DATA, 2: FTR_D D31] OF _sTSDB_T Retained Related instructions tence Flag is being executed an numbers correspond	Not retained. d the record to be exto the following:	Range of values Network Publish Member name Global/local cported exists.	Published. IsExptRec		
Data type R/W access Usage in user program Variable name Meaning	TRUE when export The array element r 0: RAW_DATA, 1: A Structure: ARRAY [I Member: BOOL R Possible. _TSDB_TSSta Export Record Exist TRUE when export The array element r 0: RAW_DATA, 1: A	numbers correspond INL_DATA, 2: FTR_D D31] OF _sTSDB_T Retained Related instructions tence Flag is being executed an	Not retained. d the record to be exto the following: DATA, 3: AIS_DATA,	Range of values Network Publish Member name Global/local cported exists.	Published. IsExptRec		

Network Publish

Published.

Retained

tions

Related instruc-

Not retained.

R/W access

program

Usage in user

R

Possible.

Variable name	_TSDB_TSSta		Member name	.OpenErr		
Meaning	Sampling Mode Op	en Error Flag		Global/local	Global	
Function	TRUE when an error occurred during TimeSeries open processing. The array element numbers correspond to the following: 0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved					
Data type	Structure: ARRAY [Member: BOOL	031] OF _sTSDB_T	SSTA,	Range of values	TRUE or FALSE	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc- tions				
Variable name	_TSDB_TSSta			Member name	.SmplErr	
Meaning	Sampling Error Flag	9		Global/local	Global	
Function	The array element r	s an error in the sam numbers correspond ANL_DATA, 2: FTR_[•	4 to 31: Reserved		
Data type	Structure: ARRAY [Member: BOOL	031] OF _sTSDB_T	SSTA,	Range of values	TRUE or FALSE	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc- tions				
Variable name	_TSDB_TSSta			Member name	.ExptErr	
Meaning	Export Error Flag			Global/local	Global	
Function	TRUE when there is	s an error in the exponumbers correspond	to the following:			
Data type	0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved Structure: ARRAY [031] OF _sTSDB_TSSTA, Member: BOOL Range of values TRUE or FA			TRUE or FALSE		
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc- tions				

Variable name	_TSDB_TSSta			Member name	.ErrCode	
Meaning	Error Cause Code			Global/local	Global	
Function	Specifies the cause of the error occurred in TimeSeries.*1 The array element numbers correspond to the following: 0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved					
Data type	Structure: ARRAY [0 Member: WORD	031] OF _sTSDB_T	SSTA,	Range of values	Depends on the data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc-				

^{1.} ErrorCode (Error Cause Code) is described below.

Err- Code	Event name	Description	Correction
4C00 hex	TSDB Serv- ice Not Start- ed	The TSDB service status is not Running.	Check to see if the TSDB service is <i>Running</i> on the Al Operator.
4C01 hex	Invalid TimeSeries Name	A value other than 'RAW_DATA', 'ANL_DATA', 'FTR_DATA', or 'AIS_DA- TA' was specified for the TimeSeriesName input variable in the time series database instruction.	Check <i>TimeSeriesName</i> input variable in the time series database instruction.
4C03 hex	Setting Error	 Any of the following occurred: A variable that does not exist in the Al Controller was downloaded from the Al Operator. An incorrect value is included in the settings of the Time Series Database Function. 	Download data to the Al Controller again in the following orders: Download a project from the Sysmac Studio Download the settings from the Al Operator Click the Reconstruct Button for the TimeSeries on the Al Operator.
4C05 hex	Exporting	The time series database instruction was executed while the target TimeSeries was being exported.	Execute the time series database instruction while the target TimeSeries is not being exported.
4C07 hex	Too Many TimeSeries	The number of TimeSeries that can be opened simultaneously, is exceeded.	Contact an engineer of OMRON.
4C08 hex	TimeSeries Open Failed	Opening the TimeSeries failed.	Check to see if the following storage is inserted properly and it is not write-protected. NX-series: SD Memory Card NY-series: Expanded storage in drive bay A
4C0B hex	TimeSeries Access Failed	Accessing the TimeSeries failed.	Check to see if the following storage is inserted properly and it is not write-protected. NX-series: SD Memory Card NY-series: Expanded storage in drive bay A
4C0C hex	Insufficient TimeSeries Resources	There is not sufficient resources to execute the time series database instruction.	Contact an engineer of OMRON.
4C0D hex	TSDB Service Control Disabled	While the TSDB service was in the <i>Error</i> or <i>Shutdown</i> status, the TimeSeries_ControlService instruction was executed as a <i>start command</i> or a <i>stop command</i> .	Execute the TimeSeries_ControlService instruction while the TSDB service is in the <i>Idle</i> or <i>Running</i> status.

Err- Code	Event name	Description	Correction
4C0E	Time Series	Sampling or export processing timed	Contact an engineer of OMRON.
hex	Database In-	out.	
	struction		
	Timeout		
4C12	TimeSeries	The TimeSeries cannot be opened be-	On the Al Operator, click the Reconstruct Button
hex	Corrupted	cause it is corrupted.	for the corrupted TimeSeries.
			Cycle the power supply to the Al Controller.
4C13	Invalid Oper-	Unauthorized operation was performed	Do not write values to the following system-defined
hex	ation	for the specified TimeSeries.	variables.
			_TSDB_SmplStartCmd[2]
			_TSDB_SmplStopCmd[2]
			_TSDB_SmplStartCmd[3]
			_TSDB_SmplStopCmd[3]
4C14	Insufficient	The storage to which the CSV file from	Check to see if CSV files in the AI Controller have
hex	Capacity in	the Al Controller is exported has run	been transferred to your computer on the Al Opera-
	Export Desti-	out of space.	tor or transferred to a web server with the WebAPI
	nation		Connection Function.

Variable name	_TSDB_SmplStartCmd					
Meaning	Sampling Start Command			Global/local	Global	
Function	TRUE when you start sampling of the TimeSeries.					
	The array element numbers correspond to the following:					
	0: RAW_DATA, 1: A	NL_DATA, 2: FTR_0	DATA, 3: AIS_DATA, 4	to 31: Reserved		
Data type	ARRAY [031] OF E	BOOL		Range of values	TRUE or FALSE	
R/W access	RW	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.*1	Related instruc-				
program		tions				

 $^{^{*}1. \}quad \text{However, do not change the value for $_$TSDB_SmplStartCmd[2]$ and $_$TSDB_SmplStartCmd[3]$.}$

Variable name	_TSDB_SmplStopCmd					
Meaning	Sampling Stop Command			Global/local	Global	
Function	TRUE when you stop sampling of the TimeSeries.					
	The array element numbers correspond to the following:					
	0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved					
Data type	ARRAY [031] OF E	BOOL		Range of values	TRUE or FALSE	
R/W access	RW	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.*1	Related instruc-				
program		tions				

^{*1.} However, do not change the value for _TSDB_SmplStopCmd[2] and _TSDB_SmplStopCmd[3].

Variable name	_TSDB_ExptStartCmd					
Meaning	Export Start Command			Global/local	Global	
Function	TRUE when you start export of the TimeSeries.					
	The array element numbers correspond to the following:					
	0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved					
Data type	ARRAY [031] OF E	300L		Range of values	TRUE or FALSE	
R/W access	RW	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

Variable name	_TSDB_ExptStopCmd					
Meaning	Export Stop Command			Global/local	Global	
Function	TRUE when you stop export of the TimeSeries.					
	The array element numbers correspond to the following:					
	0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved					
Data type	ARRAY [031] OF BOOL			Range of values	TRUE or FALSE	
R/W access	RW	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

Variable name	_TSDB_ClearCmd					
Meaning	TimeSeries Clear Command			Global/local	Global	
Function	TRUE when you clear data in the TimeSeries.					
	The array element numbers correspond to the following:					
	0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved					
Data type	ARRAY [031] OF BOOL			Range of values	TRUE or FALSE	
R/W access	RW	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

Variable name	TSDB_SmpIMode					
Meaning	TimeSeries Sampling Mode			Global/local	Global	
Function	Shows the mode of the defined TimeSeries.					
	0: Not used					
	1: Simple mode					
	The array element numbers correspond to the following:					
	0: RAW_DATA, 1: ANL_DATA, 2: FTR_DATA, 3: AIS_DATA, 4 to 31: Reserved					
Data type	ARRAY[031] OF UINT Range of values 0 or 1					
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

Variable name	_TSDB_CreateCmd						
Meaning	TimeSeries Creation Command Global/local Global						
Function	Issue a command to recreate a TimeSeries. While the TSDB service status is idle, this flag can be switched from FALSE to TRUE. You can also recreate a TimeSeries by opening the Monitor/Operation screen on Al Operator and selecting TimeSeries , and then pressing the Reconstruct Button. The array element numbers correspond to the following: 0: RAW DATA, 1: ANL DATA, 2: FTR DATA, 3: AIS DATA, 4 to 31: Reserved						
Data type	ARRAY[031] OF BOOL Range of values TRUE or F			TRUE or FALSE			
R/W access	RW	Retained	Not retained. Network Publish Published.				
Usage in user program	Possible.	Related instruc-			•		

A-3-4 Al Function Modules, Category Name: _FE

• Feature Extraction Function

Variable name	_FE_Enable						
Meaning	Feature Extraction Service Enable Command			Global/local	Global		
Function	Send a command to change the status of the feature extraction service. TRUE when you change the status to Running. FALSE when you change the status to Idle.						
Data type	BOOL			Range of values	TRUE or FALSE		
R/W access	RW	Retained	Not retained.	Network Publish	Published.		
Usage in user program	Possible.	Related instruc- tions					
Variable name _FE_Result							
Meaning	Feature Value			Global/local	Global		
Function	Shows the extracted feature value.						
Data type	ARRAY [0127, 015] OF LREAL			Range of values	Depends on the data type.		
R/W access	RW	Retained	Not retained.	Network Publish	Published.		
Usage in user program	Possible.	Related instructions					
Variable name FE Status							
Meaning	Feature Extraction Service Status Global/local Global						
Function	Shows the status of the Feature Extraction FunctionFE_STATUS_INITIALIZE: Initializing _FE_STATUS_LOAD: Loading _FE_STATUS_IDLE: Idle _FE_STATUS_RUN: Running _FE_STATUS_PARAMETER_ERROR: Error						
Data type	_eFE_STATUS			Range of values	Depends on the data type.		
R/W access	R	Retained	Not retained.	Network Publish	Published.		
Usage in user program	Possible.	Related instructions					

A-3-5 Al Function Modules, Category Name: _MLE

• Machine Learning Function

Variable name	_MLE_Enable					
Meaning	Machine Learning Service Enable Command			Global/local	Global	
Function	Send a command to change the status of the machine learning service. TRUE when you change the status to Running. FALSE when you change the status to Idle.					
Data type	BOOL			Range of values	TRUE or FALSE	
R/W access	RW	Retained	Not retained.	Network Publish	Published.	
Usage in user	Possible.	Related instruc-				
program		tions				

					T			
Variable name	_MLE_Result			Member name	.Level			
Meaning	Level Judgment Re			Global/local	Global			
Function	Shows the level judged: -1: Judgment failed 0: Initial value (not the strength of the strength) 1: Normal 2: Alarm level 1 3: Alarm level 2	-1: Judgment failed 0: Initial value (not tested) 1: Normal 2: Alarm level 1						
Data type	Structure: ARRAY [4 Member: INT	0127] OF _sMLE_R	RESULT	Range of values	-1 to 3			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user program	Possible.	Related instruc-						
Variable name	_MLE_Result			.Score				
Meaning	Equipment Event M	onitoring Score		Global/local	Global			
Function	Shows the equipme Judgment failed: -∞	Shows the equipment event monitoring score. Judgment failed: -∞						
Data type	Structure: ARRAY [0 Member: LREAL	0127] OF _sMLE_R	RESULT	Range of values	Depends on the data type.			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user program	Possible.	Related instruc- tions						
Variable name	_MLE_Status							
Meaning	Machine Learning S	Service Status		Global/local	Global			
Function	Shows the status of the Machine Learning Function. _MLE_STATUS_INITIALIZE: Initializing _MLE_STATUS_LOAD: Loading _MLE_STATUS_IDLE: Idle _MLE_STATUS_RUN: Running _MLE_STATUS_PARAMETER_ERROR: Error							
Data type	_eMLE_STATUS			Range of values	Depends on the data type.			
R/W access	R	Retained	Not retained.	Network Publish	Published.			
Usage in user program	Possible.	Related instruc-						

Variable name	_MLE_Statistics			Member name	.Level1Count		
Meaning	Number of Level 1 Judgment Results			Global/local	Global		
Function	Shows the number	Shows the number of results judged as Normal.					
Data type	Structure: ARRAY [0127] OF _sMLE_STATISTICS Member: UDINT			Range of values	Depends on the data type.		
R/W access	R	Retained	Not retained.	Network Publish	Published.		
Usage in user program	Possible.	Related instructions					

Variable name	_MLE_Statistics			Member name	.Level2Count	
Meaning	Number of Level 2	Judgment Results		Global/local	Global	
Function	Shows the number	of results judged as a	Alarm level 1.			
Data type	Structure: ARRAY [I	0127] OF _sMLE_S	STATISTICS	Range of values	Depends on the data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc- tions				
Variable name	_MLE_Statistics			Member name	.Level3Count	
Meaning	Number of Level 3	Judgment Results		Global/local	Global	
Function	Shows the number	of results judged as	Alarm level 2.	•		
Data type	Structure: ARRAY [Member: UDINT	0127] OF _sMLE_S	Range of values	Depends on the data type.		
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc-				
program		tions	<u> </u>			
Variable name	MLE Statistics			Member name	.ErrorFrameCount	
Meaning		That Failed the Judg	ment	Global/local	Global	
Function				ion resulted in an error or judgment failed.		
Data type		0127] OF _sMLE_S		Range of values	Depends on the data type.	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc-				
Variable name	_MLE_Statistics			Member name	.ErrorID	
Meaning	Cause of the Last F	ailed Judgment for th	ne Frame	Global/local	Global	
Function	1: Input data is inva	f the last failed judgm lid (Feature value ca due to exceeded judg	lculation result is -∞,	+∞, or not a number))	
Data type	Structure: ARRAY [Member: DWORD	0127] OF _sMLE_S	STATISTICS	Range of values	1 to 2	
R/W access	R	Retained	Not retained.	Network Publish	Published.	
Usage in user program	Possible.	Related instruc-				

A-3-6 Al Function Modules, Category Name: _WAC

• Functional Classification: WebAPI Connection Functions

Variable name	_WAC_Version	_WAC_Version								
Meaning	WebAPI Version Global/local Global									
Function	Shows the version of the WebAPI package. The integer part of the version is stored in the element number 0. The fractional part of the version is stored in the element number 1. Example) If the WebAPI version is 1.10, 1 is stored in the element number 0 and 10 is stored in the element number 1.									
Data type	ARRAY [01] OF U	SINT		Range of values	0 to 99					
R/W access	R	Retained	Not retained.	Network Publish	Published.					
Usage in user program	Possible.	Related instruc-								

A-4 Processing in the Data Collection, Data Analysis, and Data Utilization Phases


This section describes the processing executed in the Data Collection, Data Analysis, and Data Utilization Phases.

Use this information to understand the operational specifications of the AI Controllers.

A-4-1 Data Collection Phase

In the Data Collection Phase, the Time Series Database Function collects values of the frame variables, variable data, and subframe variables of each equipment event. They are collected in TimeSeries as analysis data. Up to 16 variable data and up to 6 subframe variables can be set per equipment event. Up to 128 equipment events can be registered.

For details on the format of *ANL-****.csv* files that are saved in the built-in RAM, refer to *A-5 CSV File Format* on page A-32.

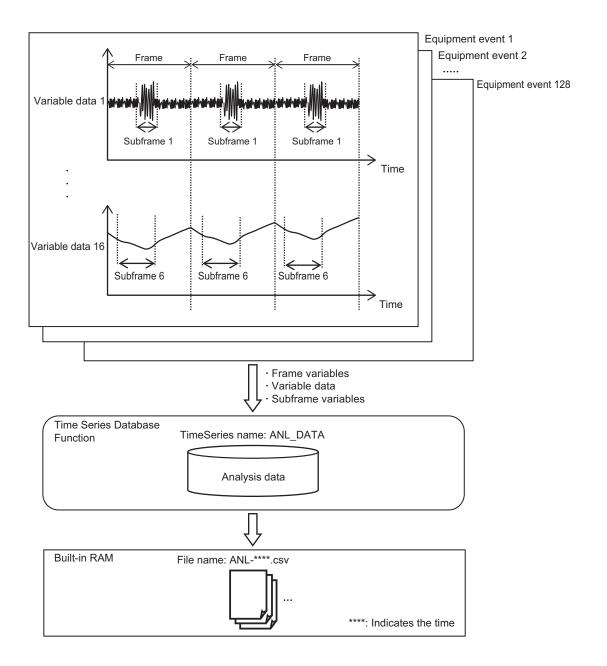

A-4-2 Data Analysis Phase

An engineer of OMRON generates the AI machine learning model from the analysis data. In this phase, an AI machine learning model is generated and downloaded to the AI Controller. The AI machine learning model is used in the Data Utilization Phase.

Some of the data included in the AI machine learning model is described below.

- · Frame variable name, variable data name, subframe variable name
- · Feature value calculation method
- · Data used for calculating equipment event monitoring score
- · Threshold 1, Threshold 2

A-4-3 Data Utilization Phase

In the Data Utilization Phase, the Feature Value/Machine Learning Function of the Al Controller uses the Al machine learning model and determines if any equipment event occur based on the variable data. The Feature Value/Machine Learning Function of the Al Controller executes processing as described below.

The Feature Extraction Function of the Al Controller executes processing as follows:

(1) Variable data acquisition

According to the AI machine learning model, the function determines variable data, frame variables, and subframe variables. The calculation interval of variable data is obtained from the values of frame variables and frame variables.

(2) Feature value calculation

According to the feature value calculation method that is set to the AI machine learning mode, it calculates the feature value from the calculation interval of variable data.

The feature value is calculated for each variable data. The calculated feature value is output to the Time Series Database Function.

The Machine Learning Function of the AI Controller executes processing as follows:

(3) Calculation of equipment event monitoring score

The function calculates the equipment event monitoring score that shows a difference from the normal value with the AI machine learning model.

The equipment event monitoring score is output to the Time Series Database Function.

(4) Level judgment


Based on the threshold values defined in the AI machine learning model, the equipment event monitoring scores are determined to Normal, Alarm level 1, or Alarm level 2.

The equipment event monitoring result is output to the Time Series Database Function.

The following is an example of outputting feature values and equipment event monitoring results from the two variable data. To simplify the process, this section explained only two feature values, but you can set up to 16 feature values to each equipment event.

For details on the format of *FTR*-****.csv and *AIS*-****.csv files that are saved in the built-in RAM, refer to *A-5 CSV File Format* on page A-32.

Make sure to check if equipment events can be detected in this phase. If the events can not be detected, perform the Data Collection Phase or Data Analysis Phase again.

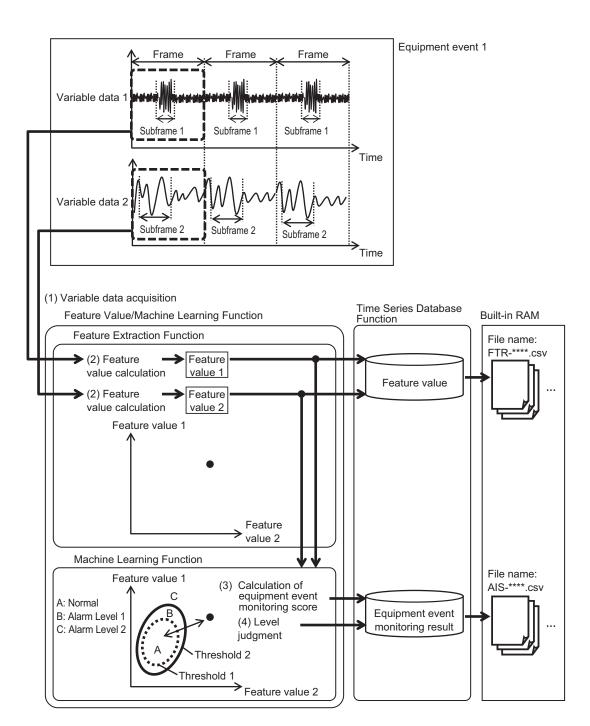

Note In a precise sense, the equipment event monitoring scores and threshold values do not represent the distance between two points on the two-dimensional coordinates.

To simplify the process, this example uses them as a distance from the normal position.

A-5 CSV File Format

The formats of CSV files exported by the Time Series Database Function are described below.

A-5-1 Variable Data File (RAW-***.csv)

The formats of variable data (CSV files) exported by the Time Series Database Function are described below.

	Index	Time Stamp (Time format)	Time Stamp (Nano- sec- onds format)	Re- served 1	Re- served 2	Re- served 3	Re- served 4	Variable data 1		Variable data 1024
Header row*1	indx	tmstmp	tmstmp2	schcnt	schcnt2	sid	sidx	"Varia- ble name of variable data 1"		"Variable name of variable data 1024"
First re- cord	Index value	Time Stamp value	Time Stamp value	Counter value	Counter value	Integer value	Index value	Value of variable data 1		Value of variable data 1024
Second record :	Same as above	Same as above	Same as above	Same as above	Same as above	Same as above	Same as above	Same as above	:	Same as above :

^{*1.} The specified text string is always output to indx through sidx on the header row.

- · Reserved 1 through 4 are used by the system.
- Up to 1024 sets of variable data can be used.
- indx (index) will increment by one (in decimal notation) for each sampling performed in TimeSeries. You can check the index value to find the omitted collection data.
- The Time Stamp (Time format) is output in the format of "yyyy-MM-dd hh:mm:ss.000000" including the microseconds part.
- The Time Stamp (Nanoseconds format) is output as the elapsed time from 1970/01/01 00:00:00 in the units of nanoseconds.
- · CR+LF indicates a line feed.
- Variable data is output in the following formats based on the data type. For array variables, each element of the array is output to a column.

Data type	Type name in IEC1131-3	Output format
Boolean	BOOL	"0" or"1"
Bit string	BYTE, WORD	Decimal notation
	DWORD, LWORD	
Integer	SINT, INT, DINT, LINT	Decimal notation
	USINT, UINT, UDINT,	
	ULINT	

Data type	Type name in IEC1131-3	Output format
Real number	REAL	Real number or exponent (Example: -12.0, 0.0, -1.34e-12,
		1.0e+6)
	LREAL	Real number or exponent (Example: -12.0, 0.0, -1.34e-12,
		1.0e+6)
Date	DATE	yyyy-MM-dd (Example: 2016-11-22)
Time of day	TIME_OF_DAY	hh:mm:ss.000000000 (Example: 15:37:42.123456789)
Date and time	DATE_AND_TIME	yyyy-MM-dd hh:mm:ss.000000000
		(Example: 2016-11-22 15:37:42.123456789)
Duration	TIME	Decimal notation. The unit is in milliseconds. Six decimal pla-
		ces are specified.
		(Example: 123.456789)

A-5-2 Analysis Data File (ANL-***.csv)

The formats of analysis data (CSV files) exported by the Time Series Database Function are described below.

	Index	Time Stamp (Time for- mat)	Time Stamp (Nanosec- onds for- mat)	Reserved 1	Reserved 2	Reserved 3	Reserved 4	~
Header	indx	tmstmp	tmstmp2	schcnt	schcnt2	sid	sidx	~
row*1								
First re-	Index value	Time	Time	Counter	Counter	Integer val-	Index value	~
cord		Stamp val-	Stamp val-	value	value	ue		
		ue	ue					
Second	Same as	Same as	Same as	Same as	Same as	Same as	Same as	~
record	above	above	above	above	above	above	above	
:	:	:	:	:	:	:	:	~

~	Frame variable 1		Frame variable n	Subframe variable 1		Subframe variable m	~
~	"Variable name of frame variable 1"		"Variable name of frame variable n"	"Variable name of subframe variable 1"		"Variable name of subframe variable m"	~
~	Value of frame variable 1		Value of frame variable n	Value of subframe variable 1		Value of subframe variable m	~
~	Same as above		Same as above	Same as above		Same as above	~
~	:	:	:	:	:	:	~

~	Label variable 1		Label variable p	Variable data 1		Variable data q
~	"Variable name of label variable 1"		"Variable name of label variable p"	"Variable name of variable data 1"		"Variable name of variable data q"
~	Value of label varia- ble 1		Value of label varia- ble p	Value of variable da- ta 1		Value of variable da- ta q
~	Same as above		Same as above	Same as above		Same as above
~	:	:	:	:	:	:

^{*1.} The specified text string is always output to indx through sidx on the header row.

- Frame variables, subframe variables, label variables and variable data are sorted in the order of the equipment event numbers.
- If a same frame variable, subframe variable, label variable, or variable data is specified in multiple equipment events, they are not recorded duplicately.
- · Reserved 1 through 4 are used by the system.
- indx (index) will increment by one (in decimal notation) for each sampling performed in TimeSeries. You can check the index value to find the omitted collection data.
- The Time Stamp (Time format) is output in the format of "yyyy-MM-dd hh:mm:ss.000000" including the microseconds part.
- The Time Stamp (Nanoseconds format) is output as the elapsed time from 1970/01/01 00:00:00 in the units of nanoseconds.
- · CR+LF indicates a line feed.
- Variables are output in the following formats based on the data type.

Data type	Type name in IEC1131-3	Output format
Boolean	BOOL	"0" or"1"
Bit string	BYTE, WORD DWORD, LWORD	Decimal notation
Integer	SINT, INT, DINT, LINT USINT, UINT, UDINT, ULINT	Decimal notation
Real num- ber	REAL	Real number or exponent (Example: -12.0, 0.0, -1.34e-12, 1.0e+6)
	LREAL	Real number or exponent (Example: -12.0, 0.0, -1.34e-12, 1.0e+6)
Date	DATE	yyyy-MM-dd (Example: 2016-11-22)
Time of day	TIME_OF_DAY	hh:mm:ss.000000000 (Example: 15:37:42.123456789)
Date and time	DATE_AND_TIME	yyyy-MM-dd hh:mm:ss.000000000 (Example: 2016-11-22 15:37:42.123456789)
Duration	TIME	Decimal notation. The unit is in milliseconds. Six decimal places are specified. (Example: 123.456789)

A-5-3 Feature Value File (FTR-****.csv)

The formats of feature value data (CSV files) exported by the Time Series Database Function are described below.

	Index	Time Stamp (Time for- mat)	Time Stamp (Nanosec- onds for- mat)	Reserved 1	Reserved 2	Reserved 3	Reserved 4	~
Header	indx	tmstmp	tmstmp2	schcnt	schcnt2	sid	sidx	~
row*1								
First re-	Index value	Time	Time	Counter	Counter	Integer val-	Index value	~
cord		Stamp val-	Stamp val-	value	value	ue		
		ue	ue					
Second	Same as	Same as	Same as	Same as	Same as	Same as	Same as	~
record	above	above	above	above	above	above	above	
:	:	:	:	:	:	:	:	~

~	Equipment event 0					
~	FeatureGroupIdx	Equipment event 0_"feature extraction output frame variable name"	_FE_Result[0,0]		_FE_Result[0,15]*2	
~	0	Equipment event 0_"value of the feature extraction output frame variable"	Feature value		Feature value	
~	Same as above	Same as above	Same as above		Same as above	
~	:	:	:	:	·	

 Equipment event 127*3					
 FeatureGroupIdx	Equipment event 127_"feature extraction output frame variable name"	_FE_Result[127,0]		_FE_Result[127,15]* ²	
 127	Equipment event 127_"value of the feature extraction output frame variable"	Feature value		Feature value	
 Same as above	Same as above	Same as above		Same as above	
 :	:	:	:	:	

^{*1.} The specified text string is always output to indx through sidx on the header row.

- Reserved 1 through 4 are used by the system.
- indx (index) will increment by one (in decimal notation) for each sampling performed in TimeSeries. You can check the index value to find the omitted collection data.
- The Time Stamp (Time format) is output in the format of "yyyy-MM-dd hh:mm:ss.000000" including the microseconds part.
- The Time Stamp (Nanoseconds format) is output as the elapsed time from 1970/01/01 00:00:00 in the units of nanoseconds.
- · CR+LF indicates a line feed.

If multiple equipment events are registered, the Feature Value/Machine Learning Function outputs results of all the equipment events to the Time Series Database Function (feature value file: FTR-****.csv) when any of the equipment event frame switches.

A-5-4 Equipment Event Monitoring Result File (AIS-***.csv)

The formats of equipment event monitoring result files (CSV files) exported by the Time Series Database Function are described below.

^{*2.} The same number of feature values set on the Al Operator is output to an CSV file.

^{*3.} The same number of equipment events set on the Al Operator is output to an CSV file.

	Index	Time Stamp (Time for- mat)	Time Stamp (Nanosec- onds for- mat)	Reserved 1	Reserved 2	Reserved 3	Reserved 4	~
Header row*1	indx	tmstmp	tmstmp2	schcnt	schcnt2	sid	sidx	~
First re-	Index value	Time Stamp val- ue	Time Stamp val- ue	Counter value	Counter value	Integer val- ue	Index value	~
Second record	Same as above	Same as above	Same as above	Same as above	Same as above	Same as above	Same as above	~

~	Equipment event 0					
~	EquipmentEventIdx	Equipment event 0_"machine learning output frame variable name"	_MLE_Result[0] .level	_MLE_Result[0] .score		
~	0	Equipment event 0_"value of the machine learning output frame variable"	Level judgment result	Equipment event monitoring score		
~	Same as above	Same as above	Same as above	Same as above		
~	:	:	:	:	Ī	

 Equipment event 127*2						
 EquipmentEventIdx Equipment event 127_"machine learning output frame variable name"		_MLE_Result[127] .level	_MLE_Result[127] .score			
 127	Equipment event 127_"value of the machine learning output frame variable"	Level judgment result	Equipment event monitoring score			
 Same as above	Same as above	Same as above	Same as above			
 :	:	:	:			

^{*1.} The specified text string is always output to indx through sidx on the header row.

- Reserved 1 through 4 are used by the system.
- indx (index) will increment by one (in decimal notation) for each sampling performed in TimeSeries. You can check the index value to find the omitted collection data.
- The Time Stamp (Time format) is output in the format of "yyyy-MM-dd hh:mm:ss.000000" including the microseconds part.
- The Time Stamp (Nanoseconds format) is output as the elapsed time from 1970/01/01 00:00:00 in the units of nanoseconds.
- CR+LF indicates a line feed.

^{*2.} The same number of equipment events set on the Al Operator is output to an CSV file.

If multiple equipment events are registered, the Feature Value/Machine Learning Function outputs results of all the equipment events to the Time Series Database Function (equipment event monitoring result: AIS-****.csv) when any of the equipment event frame switches.

A-6 Version Information

This section describes the relationship between the unit versions of Al Controllers and each software version.

A-6-1 Version Information for NX-series AI Controllers

This following table gives the relationship between the unit versions of NX-series AI Controllers and the corresponding versions for each software.

Unit version of Al Controller	Corresponding version of Sys- mac Studio	Version of the Al Controller soft- ware (Al Operator, Al Viewer)
Ver.1.21 ^{*1}	Ver.1.29	Ver.1.00
Ver.1.18	Ver.1.25	Ver.1.00

^{*1.} There is no NX-series AI Controller with unit version 1.19 or later and unit version earlier than 1.21.

A-6-2 Version Information for NY-series AI Controllers

This following table gives the relationship between the unit versions of NY-series Al Controllers and the corresponding versions for each software.

Unit version of Al Controller	Corresponding version of Sysmac Studio	Version of the Al Controller soft- ware (Al Operator, Al Viewer)	Industrial PC Support Utility	Rescue Disk Crea- tor
Ver.1.21*1	Ver.1.29	Ver.1.00	Ver.1.1.1545	Ver.1.1.2004.01000 00040
Ver.1.18	Ver.1.25	Ver.1.00	Ver.1.1.1541.0	Ver.1.1.2004.01000 00040

^{*1.} There is no NY-series AI Controller with unit version 1.19 or later and unit version earlier than 1.21.

A-6-3 Specifications When Not Using the Sysmac Studio Version That Corresponds to the Unit Version of the Al Contoller

The specifecations when you do not use the Sysmac Studio version that corresponds to the unit version of Al Controller are given in this section.

Using Sysmac Studio Version 1.24 or Lower

You cannot use the Al Controller with Sysmac Studio version 1.24 or lower.

Using a Lower Version of Sysmac Studio

If you use a lower version of the Sysmac Studio, you can use only the functions of the unit version of the Al Controller that corresponds to the Sysmac Studio version.

Example: Unit version of Al Controller: 1.21

Sysmac Studio version: 1.25

Unit version 1.18 of the AI Controller corresponds to Sysmac Studio version 1.25. Therefore, you can use only the functions that are supported by unit version 1.18 of the AI Controller. You cannot use functionality that was added for unit version 1.21 or later of the AI Controller.

Using an Al Controller with an Earlier Unit Version

If you use an AI Controller with an earlier version, select the unit version of the used AI Controller or an earlier unit version in the Select Device Area of the Project Properties Dialog Box on the Sysmac Studio. The unit version that you selected is the project unit version of the project. You can use only the functions that are supported by the project unit version.

Example: Unit version of Al Controller: 1.18

Sysmac Studio version: 1.29

Unit version 1.21 of the AI Controller corresponds to Sysmac Studio version 1.29. However, the used AI Controller is unit version 1.18, so select version 1.18 as the version in the Select Device Area of the Project Properties Dialog Box.

If you select version 1.18 as the version in the Select Device Area of the Project Properties Dialog Box, you can use only the functions that are supported by project unit version 1.18. You cannot use functionality that was added for unit version 1.21 or later of the Al Controller.




Additional Information

Project Unit Version for Projects

- With Sysmac Studio version 1.02 or higher, you can select the unit version in the Select Device Area of the relevant dialog boxes.
- You can select any unit version that is the same as or earlier than the unit version of the Al Controller. For example, if the unit version of the Al Controller is 1.21, select either 1.18 or 1.21.
- The Sysmac Studio will treat the project unit version as the unit version for the AI Controller.
 For example, if the project unit version is 1.18, you can use only the functionality for unit version 1.18 on the Sysmac Studio.
- You can transfer a project to the Sysmac Studio if the project unit version is the same as or earlier than the unit version of the destination AI Controller.
- Refer to the Sysmac Studio Version 1 Operation Manual (Cat. No. W504) for details on the Select Device Area of the relevant dialog boxes.

Appendices



Index

Index

Numerics	equipment event	
	equipment event monitoring result	
_AIC_Version (AIC Version) A-6, A-17	Equipment Event Monitoring ResultA	
_Card1Capacity (SD Memory Card Storage Capacity)	Equipment event monitoring result file	
	equipment event monitoring score	27
_Card1RestoreCmdTargetAicMLD (AI Machine Learning	Event code 8-7 – 8	-15
Model Transfer Flag)A-7, A-15	Event name 8-7 – 8	-15
_Card1Used (SD Memory Card Storage Usage) A-7, A-15	Expanded Storage Available8	3-18
_ExtendedStorage1Capacity (Extended Storage1 Capacity).	Expanded Storage Data Corrupted8	-18
A-7, A-15	Expanded Storage Life8	3-17
_ExtendedStorage1Ready (Extended Storage1 Ready Flag)	Export Start Command	-22
	Export Started8	
_ExtendedStorage1Used (Extended Storage1 Usage)	Export Stop Command	
A-7, A-16	Export Stopped8	
_ExtendedStorage2Capacity (Extended Storage2 Capacity).	Extended Storage1 CapacityA-7, A	
	Extended Storage1 Ready Flag A-7, A	
_ExtendedStorage2Ready (Extended Storage2 Ready Flag)	Extended Storage1 Usage	
	Extended Storage2 Capacity	
_ExtendedStorage2Used (Extended Storage2 Usage)	Extended Storage2 Ready Flag	
xterided storage2 usage)	Extended Storage2 Usage	
	Exterided Storage2 Osage A-o, A	I C
_FE_Enable (Feature Extraction Service Enable Command)	F	
	<u> </u>	
_FE_Result (Feature Value)	FE_Enable (Feature Extraction Service Enable Commar	nd)
_FE_Status (Feature Extraction Service Status)A-10, A-24		
_MLE_Enable (Machine Learning Service Enable Com-		
mand)	_FE_Result (Feature Value)A-10, A	
_MLE_Result (Equipment Event Monitoring Result) A-11	_FE_Status (Feature Extraction Service Status)A-10, A	
_MLE_Statistics (Statistics on Equipment Event Monitoring	feature extraction output frame variables	
Result)	Feature Extraction Service Enable Command A-10, A	
_MLE_Status (Machine Learning Service Status). A-11, A-25	Feature Extraction Service Started8	
_WAC_Version (WebAPI Version) A-13	Feature Extraction Service Status	
(TimeSeries Name)	Feature Extraction Service Stopped8	
	Feature Extraction Service TimeSeries Write Error8	
A	Feature Extraction Setting Changed	
	Feature Extraction Setting Error8	
Al machine learning model	feature value	
Al Machine Learning Model Transfer FlagA-7, A-15	Feature Value A-10, A	24
Al Operator	feature value calculation method	. 27
Al Predictive Maintenance Library27	Feature value file	
Al Viewer27	Feature Value/Machine Learning Function	
AIC27	File Deletion Failed8	-45
AIC Version	File Upload Failed8	
Analysis data file28	File Upload Succeeded 8	-49
	frame	28
C		
	1	
Control Export Status 5-8		
Control Sampling Status5-6	Insufficient TimeSeries Resources	i-50
Control TSDB Service Status5-2	Isolation Forest	. 27
D	L	
Directory Access Failed8-44	Level Judgment ResultA	25
_		
E		

TimeSeries ControlSampling......5-6 M TimeSeries ControlService (TSDB Service Operation Commachine learning output frame variables......27 mands)......5-2 Machine Learning Service Enable Command A-12, A-24 TSDB Service Control Disabled...... 8-51 Machine Learning Service Setting Changed...... 8-41 Machine Learning Service Setting Error.....8-38 TSDB Service Memory Allocation Failed......8-22 Machine Learning Service Started...... 8-42 TSDB Service Shutdown.....8-30 TSDB Service Shutdown Command...... A-8, A-18 TSDB Service Started...... 8-29 Machine Learning Service Stopped.....8-41 Machine Learning Service TimeSeries Write Error......8-40 TSDB Service Startup Failed.....8-21 MLE Enable (Machine Learning Service Enable Com-TSDB Service Stopped.....8-29 MLE Statistics (Statistics on Equipment Event Monitoring TSDB ClearCmd (TimeSeries Clear Command).. A-9, A-23 _TSDB_CreateCmd (TimeSeries Creation Command)......... _MLE_Status (Machine Learning Service Status). A-11, A-25 TSDB ExptStartCmd (Export Start Command).....A-9, A-22 P TSDB ExptStopCmd (Export Stop Command)..... A-9, A-23 _TSDB_ShutdownCmd (TSDB Service Shutdown Com-PLC System Processing Error.....8-34, 8-39 mand)......A-8, A-18 TSDB SmplMode (TimeSeries Sampling Mode).. A-9, A-23 R TSDB SmplStartCmd (Sampling Start Command)..... TSDB SmplStopCmd (Sampling Stop Command).....A-9, A-22 S TSDB Status (TSDB Service Status)......A-8, A-17 _TSDB_TSName (TimeSeries Name)......A-8, A-18 _TSDB_TSSta (TimeSeries Status)...... A-8, A-18 Sampling Started......8-30 _TSDB_Version (TSDB Service Version)......A-10, A-17 Sampling Stop Command.......A-9, A-22 Sampling Stopped......8-31 SD Memory Card Storage Capacity...... A-6, A-14 SD Memory Card Storage Usage......A-7, A-15 server certificate......27 Statistics on Equipment Event Monitoring Result.. A-11, A-25 W subframe......27 WAC......27 T WebAPI Connection Function......27 WebAPI Connection Service Certificate Imported......8-50 Time Series Database Function......27 WebAPI Connection Service Root Certificate Expiration No-Time Series Database Setting Error.....8-21 Timeout Occurred......8-25 WebAPI Connection Service Setting Error......8-43 WebAPI Connection Service Setting Updated...... 8-49 TimeSeries Clear Command...... A-9, A-23 WebAPI Connection Service Started.....8-48 WebAPI Connection Service Stopped......8-48 TimeSeries Creation Failed......8-19 WebAPI Connection Service System Processing Error...8-44 TimeSeries Deletion Failed.....8-19 TimeSeries Error.....8-23 Write Protection Key......A-2 TimeSeries Name......A-8 TimeSeries Open Failed......8-24 TimeSeries Record Addition Failed Lost...... 8-27 TimeSeries Record Addition Request Lost.....8-26 TimeSeries Record Export Failed......8-20 TimeSeries Sampling Mode......A-9, A-23 TimeSeries Setting Update Failed......8-22 TimeSeries Setting Updated.....8-32 TimeSeries Status...... A-8, A-18 TimeSeries Time Backward Counter Overflow......8-28

TimeSeries Time Index Overflow......8-28
TimeSeries ControlExport......5-8

Index

OMRON Corporation **Industrial Automation Company**

Kyoto, JAPAN

Contact: www.ia.omron.com

Regional Headquarters OMRON EUROPE B.V.

Wegalaan 67-69, 2132 JD Hoofddorp The Netherlands Tel: (31)2356-81-300/Fax: (31)2356-81-388

OMRON ASIA PACIFIC PTE. LTD.

No. 438A Alexandra Road # 05-05/08 (Lobby 2),
Alexandra Technopark,
Singapore 119967
Tel: (65) 6835-3011/Fax: (65) 6835-2711

OMRON ELECTRONICS LLC

2895 Greenspoint Parkway, Suite 200 Hoffman Estates, IL 60169 U.S.A. Tel: (1) 847-843-7900/Fax: (1) 847-843-7787

OMRON (CHINA) CO., LTD.
Room 2211, Bank of China Tower,
200 Yin Cheng Zhong Road,
PuDong New Area, Shanghai, 200120, China
Tel: (86) 21-5037-2222/Fax: (86) 21-5037-2200

Authorized Distributor:

© OMRON Corporation 2018-2019 All Rights Reserved. In the interest of product improvement, specifications are subject to change without notice.

Cat. No. W594-E1-02