


**CX-*One***

***FA Integrated Tool Package***

# ***CX-One Introduction Guide***

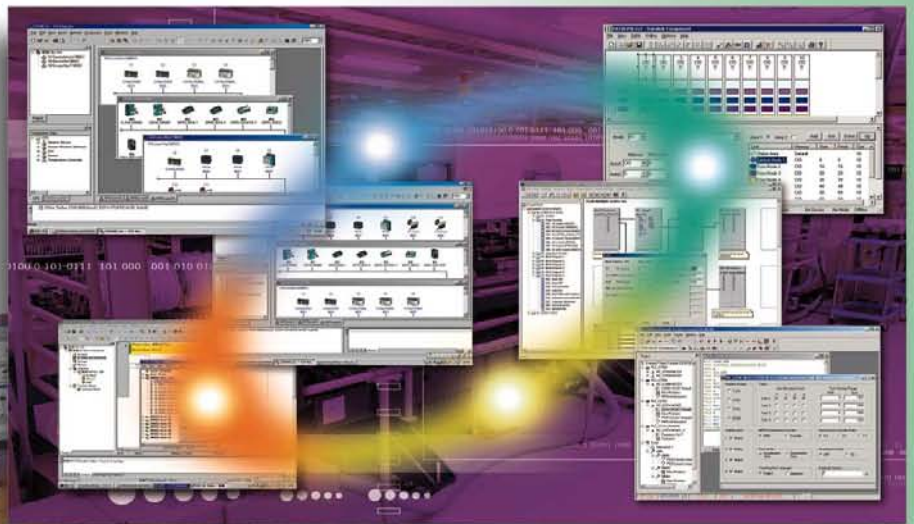

## Introduction

- Please be sure to read and understand Precautions and Introductions in *CX-One Setup Manual (W463-E1)*, *CX-Programmer Operation Manual(W446-E1)* and *CX-Integrator Operation Manual (W464-E1)* before using the product.
- This Guide describes the basic operation procedure of CX-Programmer. Refer to the Help or the Operation Manual of the PDF file for detailed descriptions.
- To read the PDF files, you need Adobe Reader, a free application distributed by Adobe Systems.
- The screen views used in this guide may be different from the actual view, and be subject to change without notice.
- The product names, service names, function names, and logos described in this guide are trademarks or registered trademarks of their respective companies.
- The symbols (R) and TM are not marked with trademarks and registered trademarks in this guide respectively
- The product names of the other companies may be abbreviated in this guide.
- Microsoft product screen shots reprinted with permission from Microsoft Corporation.

## Chapter 1 Overview and Installation of CX-One

|  |     |
|--|-----|
| 1. What is CX-One? .....               | 1-1 |
| 2. Features of CX-One .....            | 1-1 |
| 3. Integrated Simulation .....         | 1-2 |
| 4. CX-One Installation Procedure ..... | 1-4 |

## Chapter 2 Example of PLC System Construction by CX-One

|  |      |
|--|------|
| Workflow in This Chapter .....                         | 2-1  |
| 1. Design  |      |
| 1-1. Starting CX-Programmer .....                      | 2-2  |
| 1-2. Creating Unit Configuration .....                 | 2-3  |
| 1-3. Setting CPU Bus Units and Special I/O Units ..... | 2-5  |
| 1-4. Checking I/O Assignment .....                     | 2-9  |
| 1-5. Programming .....                                 | 2-10 |
| 1-6. Offline Debug .....                               | 2-12 |
| 1-7. Saving a Project .....                            | 2-13 |
| 2. Online Debug on a Machine                           |      |
| 2-1. Reading a Project .....                           | 2-14 |
| 2-2. Online Connection to PLC .....                    | 2-15 |
| 2-3. Transferring to a Machine .....                   | 2-16 |
| 2-4. Program Debug .....                               | 2-21 |
| 3. Start-Up / Adjustment On-site                       |      |
| 3-1. Program Modification .....                        | 2-23 |
| 3-2. Unit Parameter Change .....                       | 2-25 |

## Chapter 3 Example of PLC Network System Construction by CX-One

|  |      |
|--|------|
| Workflow in This Chapter .....               | 3-1  |
| 1. PLC Network Start-Up                      |      |
| 1-1. PLC Start-Up .....                      | 3-2  |
| 1-2. DeviceNet Start-Up .....                | 3-6  |
| 1-3. NT Link Start-Up .....                  | 3-8  |
| 1-4. Controller Link Start-Up .....          | 3-10 |
| 1-5. CompoWay/F Start-Up .....               | 3-12 |
| 1-6. Saving System Configuration .....       | 3-15 |
| 2. Adjustment On-site                        |      |
| 2-1. System Configuration Verification ..... | 3-17 |
| 2-2. Controller Link Diagnosis .....         | 3-19 |
| 2-3. Checking CompoNet Network .....         | 3-20 |
| 3. Servo/Inverter Settings                   |      |
| 3-1. DeviceNet Connection .....              | 3-22 |
| 3-2. RS232C Connection .....                 | 3-23 |



# **Chapter 1**

## **Overview and Installation of CX-One**

**CX-One**

## 1. What is CX-One?

CX-One is an FA Integrated Tool Package that integrates Support Software for OMRON's PLC and other Components.

To construct an FA System based mainly on PLC, traditionally it was necessary to purchase and install individual Support Software compatible with each Unit, start the software individually, and then connect to PLC and individual Components.

Installation of this FA Integrated Tool Package "CX-One" on a personal computer allows integrated operation from setup of OMRON's CPU Bus Units and Special I/O Units (SIOU) and Components to network start-up/monitoring and improving efficiency of PLC System start-up.

## 2. Features of CX-One

- CX-One allows integrated management of Support Software for OMRON's PLC/Components.
  - Installation on only one personal computer allows a user to handle Support Software for OMRON's products.
  - Only one licensing key is required to install all Support Software.
  - It allows integrated management of one save location for files created by Support Software.
- Support Software dedicated to CPU Bus Units and Special I/O Units can be started on the I/O Table.
  - The appropriate dedicated Support Software can be automatically started by specifying a registered Unit in the I/O Table (Unit configuration table attached to a PLC). In addition, setup information such as PLC model can be passed to the dedicated Support Software at start-up, allowing easier switching between Support Software.
- The following functions are available by the introduction of the ID information file (CPS) for OMRON Components.
  - Setup of CPU Bus Units and Special I/O Units without manual setting and address recognition. (Parameter and selection item names as well as available range of setup are automatically displayed)
  - CPU Bus Units and Special I/O Units setting on personal computer and data on actual PLC (CPU Unit ) can be verified online, and unmatched item/readout data is displayed graphically.
  - Unit configuration is displayed on the I/O Table based on Unit model.
  - Device type on the network can be checked for its Unit model, allowing exact verification of network configuration.

### What is CPS?

CPS (Component and network Profile Sheet) is definition information of CS/CJ series Unit/Components in CX-One. It is provided as a CPS file (XML format file).

CX-One recognizes CS/CJ series Unit by information in this CPS file. CPU Bus Units and Special I/O Units setting is created based on this CPS file.

### 3. Integrated Simulation

#### Integrated Simulation Overview:

Integrated Simulation is a function of CX-One that simultaneously tests interoperability between the ladder program and PT (touch panel) and checks screen operation on the computer.

#### Earlier Versions:

Operation checks had to be performed separately on the ladder program and PT (touch panel) screens. In addition, the program had to be downloaded to the devices.

#### Using Integrated Simulation:


Provides an interoperability check between the ladder program and touch panel screens.

- Operation can be verified before actual devices such as the PLC and PT (touch panel) are installed and wired, so software quality can be improved in the design stage.
- Time can be saved by eliminating the tasks up to downloading the screen data from the computer to the PT.
- The operation of both the PLC and PT (touch panel) can be verified simultaneously in the computer, which greatly reduces the time required for debugging and equipment downtime during improvements.

**Simulation of the PLC – PT (touch panel) system can be started easily, with one click of an icon.**

Ladder program


Touch panel screen

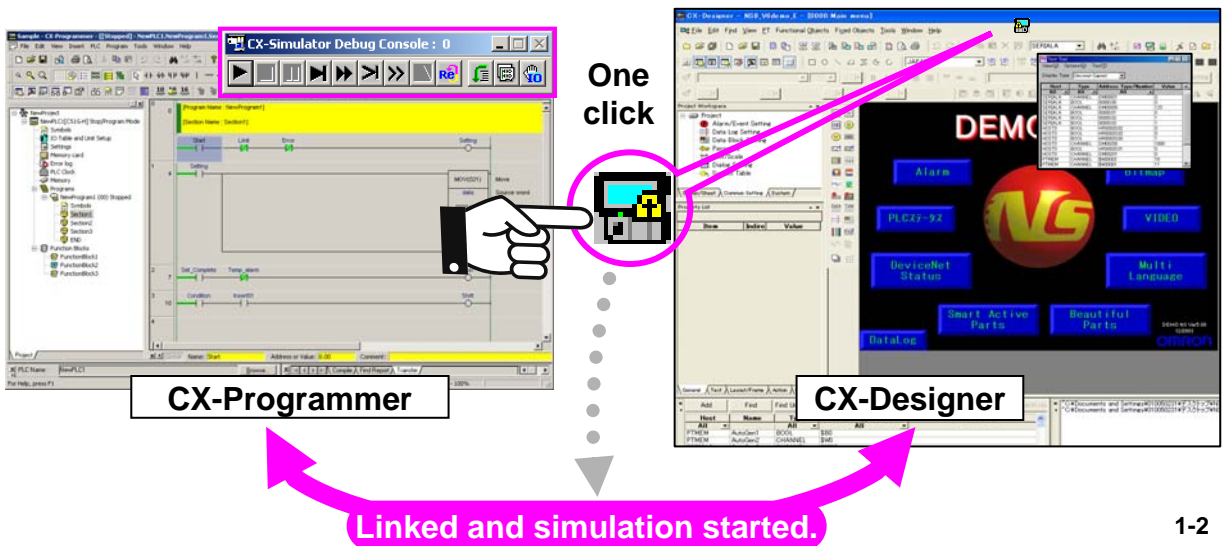


## Integrated Simulation Procedure

Use the following procedure to execute an integrated simulation of the ladder program and PT (touch panel) screen. For details, refer to the *CX-Designer Operation Manual* and *CX-Programmer Operation Manual*.

1. Create the screen data in the CX-Designer.

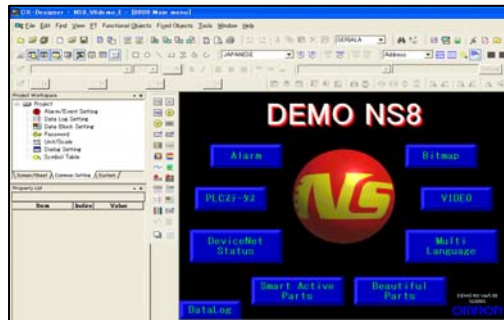

2. Click the  icon or select **Tools – Integrated Simulation**. The PLC-PT Integrated Simulation Dialog Box will be displayed.

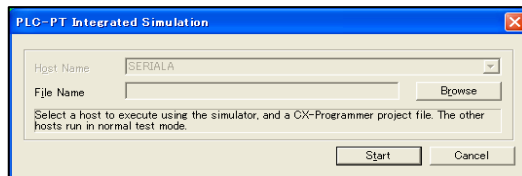

3. Click the **Browse** Button and select the desired ladder program (XCP) file.

4. Click the **Start** Button. The PLC-PT Integrated Simulation will start automatically.

5. The test window will be displayed.

The Test Tool Window will list all of the communications addresses being used in the displayed screen. For example, when “Host SERIAL A” is connected to the CX-Simulator, the CX-Simulator value is reflected in the SERIAL A communications address. (The values can also be changed.)



| Host    | Type    | Address | Type/Number | Value |
|---------|---------|---------|-------------|-------|
| All     | All     | All     |             |       |
| SERIALA | CHANNEL | DM00001 |             | 0     |
| SERIALA | BOOL    | 0000000 |             | 0     |
| SERIALA | CHANNEL | DM00000 |             | 123   |
| SERIALA | BOOL    | 0000001 |             | 0     |
| SERIALA | BOOL    | 0000002 |             | 1     |
| SERIALA | BOOL    |         |             |       |

**Test Tool**



## 4. CX-One Installation Procedure

Before installing the CX-One, you must:


- Terminate all Windows programs
- Uninstall previous versions of Support Software (such as CX-Programmer) if already installed.
- Installation takes about 15 to 45 minutes depending on your personal computer.
- To change/modify/delete CX-One after installation, refer to the PDF manual “CX-One Setup Manual”, Chapter 2 “Installation and Uninstallation”.

### Installing CX-One

**In case of the installing procedure by DVD-ROM:**

Insert CX-One installation disk (DVD-ROM) into your personal computer’s DVD-ROM drive. [Choose Setup Language] dialog box is displayed. By default the OS language installed on your personal computer is automatically selected.

Check if the language is appropriate, then click the [OK] button.

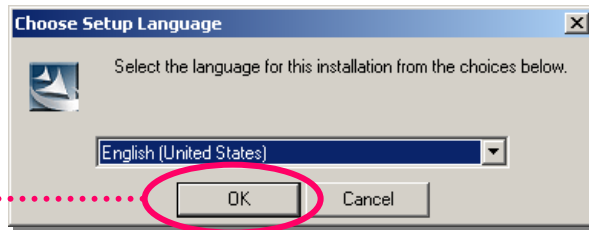


Click [OK]


The CX-One splash screen is displayed and CX-One installation starts.

Uninstall older version of tools such as PLC Tools (PLC System setting and I/O Table), CX-Server, and CX-Programmer if they have been installed.

Always click [OK]

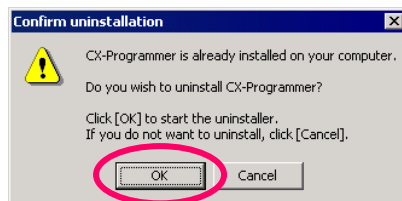


Uninstalling CX-Programmer

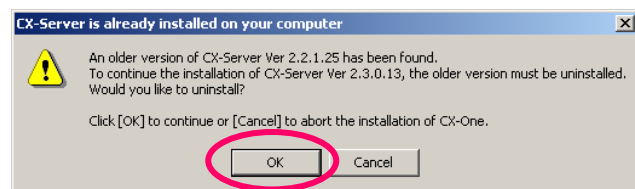

Uninstalling CX-Server

CX-One setup wizard starts.

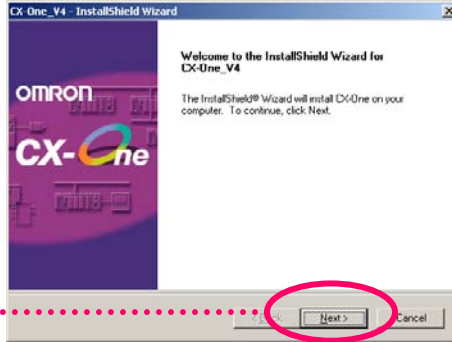

Click [Next]

The [License Agreement] dialog box is displayed.


Read the software license agreement carefully. If you agree with all items, select the [I accept the terms of the license agreement] radio button and click the [Next] button.



Select the radio button

Click [Next]


The [User information] dialog box is displayed.

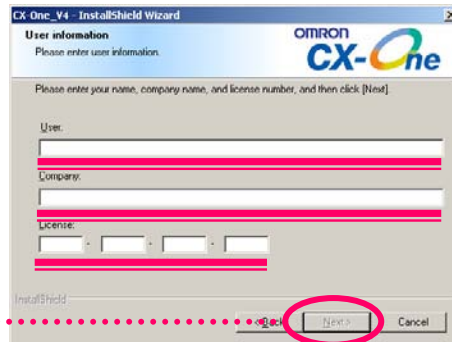

Enter [User], [Company], [License] (product serial number of CX-One)


Click [Next]

The [Regional Information] dialog box is displayed.

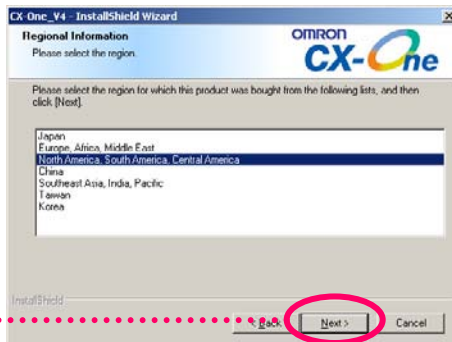

Select the [region] in which the software was purchased

Click [Next]




Select an installation folder, then click [Next]

Select the radio button [Complete]


Click [Next]

Read the message and click [Next]


The [Installation Folder Selection] dialog box and [Setup Type] dialog box are displayed.

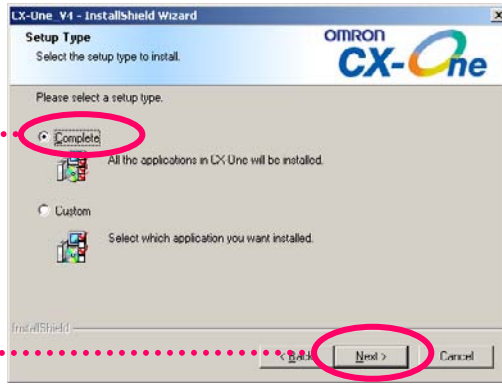

By selecting [Custom], you can individually select and install Support Software.

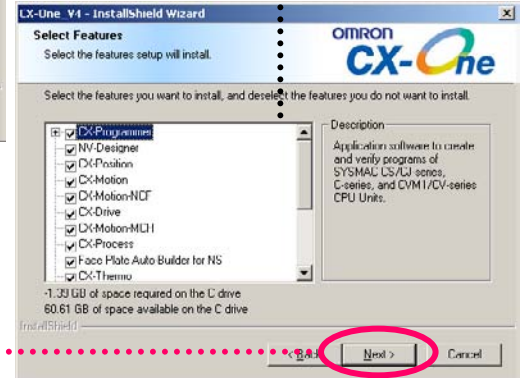

The [Choose Destination Location of OMRON FB Library], [Select Program Folder], and [Ready to Install the Program] dialog boxes are displayed.

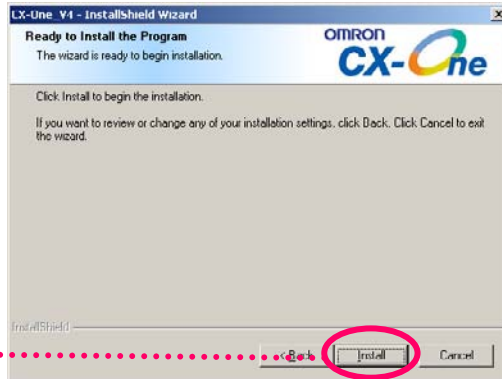

Click [Install]



CX-One installation is starts.

During the installation, the [OMRON USB driver Installation Wizard], [WinPcap Setup Wizard], and [Direct Ethernet Connection: Network Card Selection] dialog boxes are displayed. Continue with the installation procedure according to the messages displayed by the Installation Wizard.

A dialog box (right) is displayed. Click the [Finish] button to finish the installation wizard.

Installation is complete. (When it is necessary to restart the personal computer, a restart confirmation dialog box appears.)


Click [Finish]

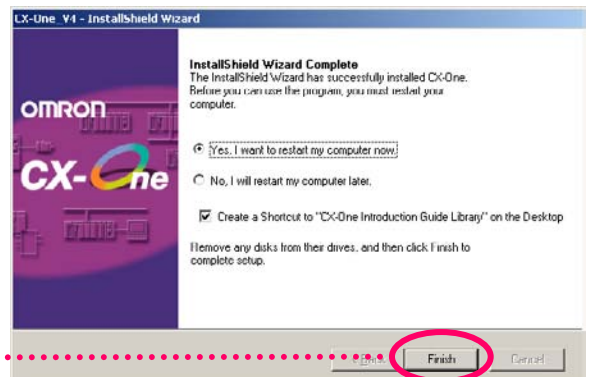

## Online Registration

If the personal computer that the software has been installed on has an Internet connection, you can proceed to online user registration.

After installation has been completed the [Online Registration] dialog box is displayed.

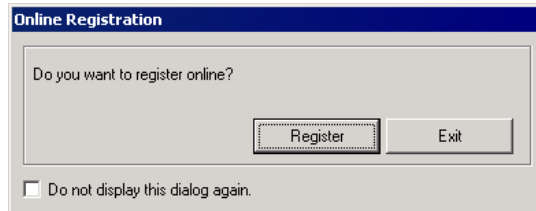

If you click the [Register] button, your Web browser connects to "OMRON's CX-One Web site".(\*1) (\*2)

\*1: If you click the [Exit] button to cancel online registration, the [Online Registration] dialog box is displayed every time the CX-One Support Software is started.

\*2: If you do not have an Internet connection, or you do not want to register online, fill out and send the user registration card that comes with the product.

# **Chapter 2**

## **Example of PLC System Construction by CX-One**


**CX-One**

# Example of PLC System Construction by CX-One


## Workflow in This Chapter

This chapter describes an example of PLC System construction from design, online debugging on the actual machine, and start-up/adjustment on-site as shown below.

CX-Programmer is used for ladder program creation and CPU Bus Units and Special I/O Units (SIOU) setting, while CX-Designer is used for indicator screen generation. Also, a program simulation Support Software CX-Simulator is used as a debugging example.

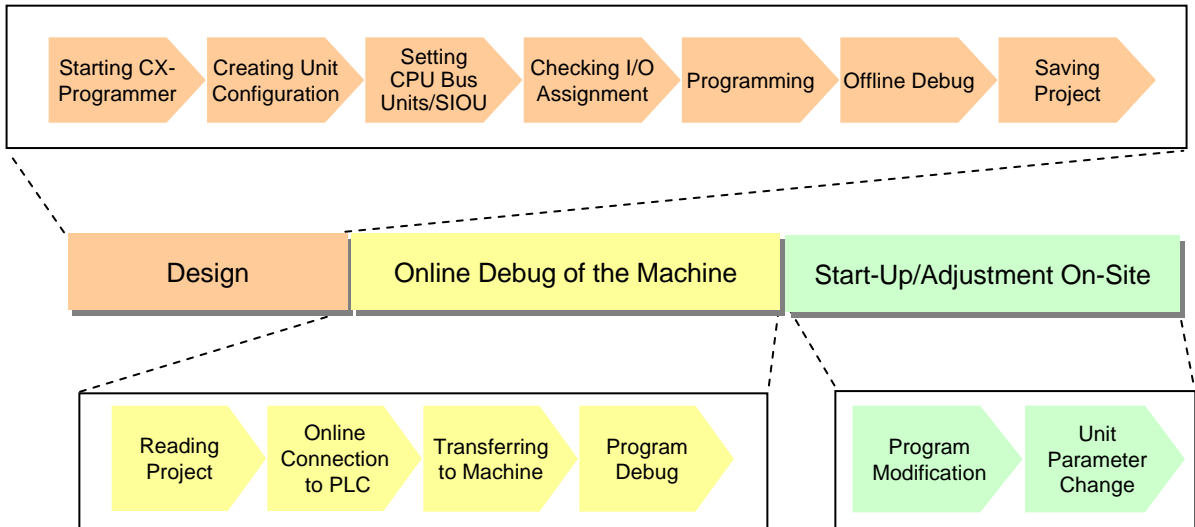


## System Configuration

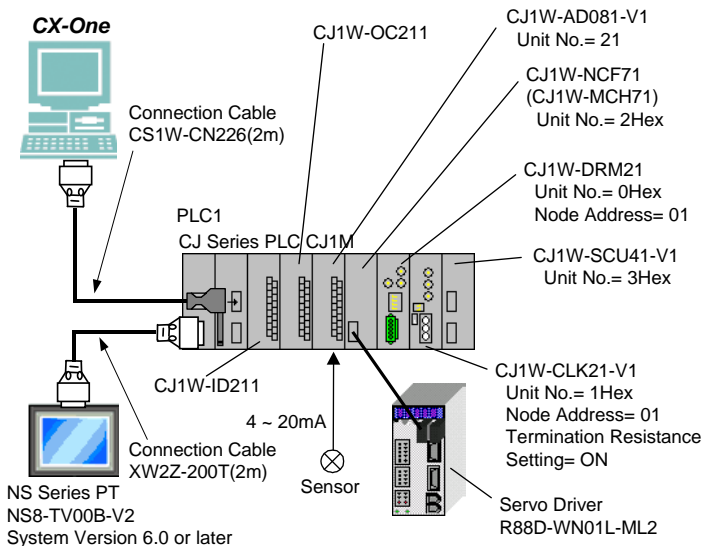

| Unit Name                                    | Model                    | Specifications  |
|--|--------------------------|---|
| Power Unit                                   | CJ1W-PA202               |   |
| CPU Unit                                     | CJ1M-CPU13               | 640 points, 20K steps   |
| DC Input Unit                                | CJ1W-ID211               |   |
| Transistor Output Unit                       | CJ1W-OC211               |   |
| Analog Input Unit                            | CJ1W-AD081-V1            | 4 analog inputs (Each point selectable from 1~5V, 0~5V, 0~10V, -10~10V, 4~20mA) |
| Position Control Unit<br>Motion Control Unit | CJ1W-NCF71<br>CJ1W-MCH71 | Maximum control: 16 axis<br>Maximum control: 30 axis                            |
| DeviceNet Master Unit                        | CJ1W-DRM21               |   |
| ControllerLink Unit                          | CJ1W-CLK21               |   |
| Serial Communications Unit                   | CJ1W-SCU41-V1            |   |
| Servo Driver                                 | R88D-WN01L-ML2           |   |
| NS Series PT                                 | NS8-TV00B-V2             | 8 inches TFT  |

Below is an example of a System that has CJ1M CPU Unit with basic input/output Unit as well as analog input Unit and NCF Unit to perform the following functions:


- 4~20mA input from a sensor
- Configure a servo driver connected to the NFC Unit.




Starting CX-Programmer

### Starting CX-Programmer


From the [Start] menu, select [Programs] > [OMRON] > [CX-One] > [CX-Programmer] > [CX-Programmer] to start CX-Programmer. (Or select [All Programs] > [OMRON] > [CX-One] > [CX-Programmer] > [CX-Programmer])

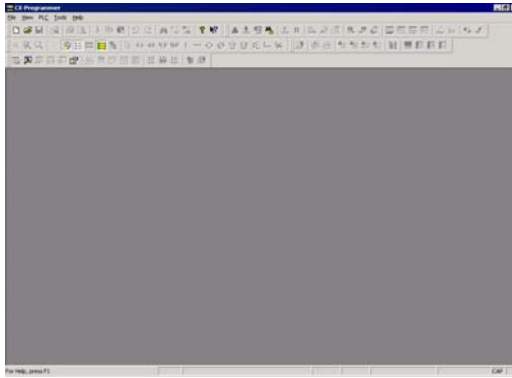

Click this button to create a new CX-Programmer project.

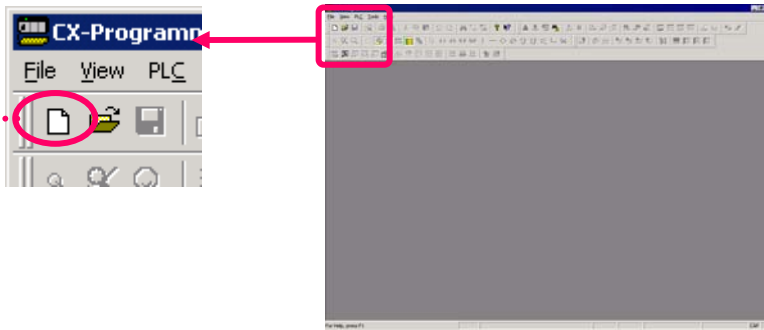


Creating a New Project




Dedicated Support Software for each Unit can be started, succeeding communications settings from CX-Programmer. You will not have to set up communications using dedicated Support Software if you set up communications here.


Click [v] and select PLC model.

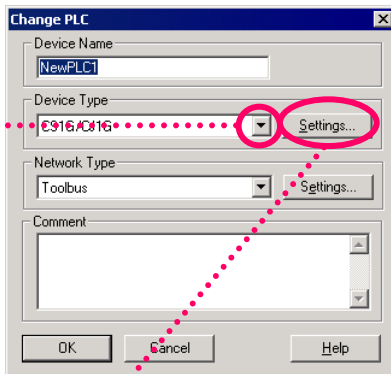

Left-click

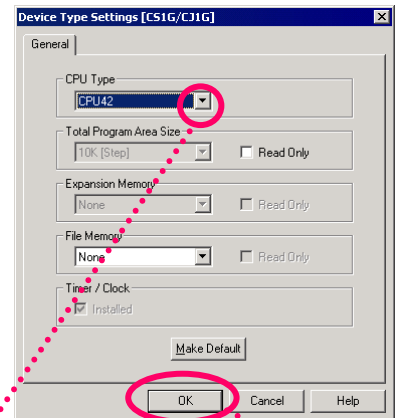

Click [v] and select CPU type.




Select a PLC model from the following to use Function Blocks.  
 CJ2H, CJ2M, CJ1H-H, CJ1G-H, CJ1M, CS1H-H, CS1G-H,  
 CP1H, CP1L, CP1L-E


Click [OK] and determine CPU type.  
**2-2**

### Creating Unit Configuration

Start the I/O Table/Unit setup function.


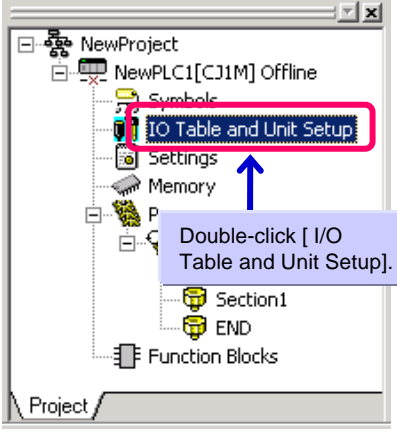


When you select [Option] > [Consumption(mA)] from the menu, you can check the width and current consumption after PLC Unit configuration. (Width indication is available only for SYSMAC CJ Series, CP1H Series.)

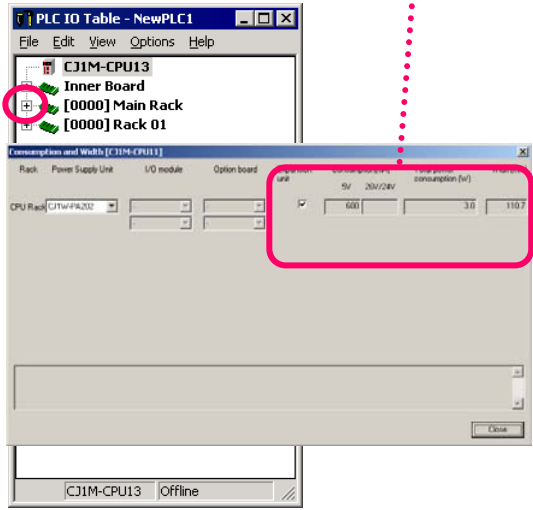

Double-click [ I/O Table and Unit Setup]

Right-click Empty Slot, select [Add Unit] and determine CPU type. Then select [General Purpose Analog I/O] from Unit selection window.

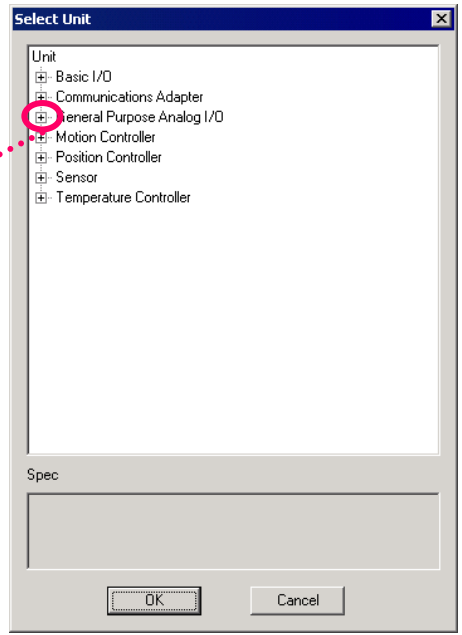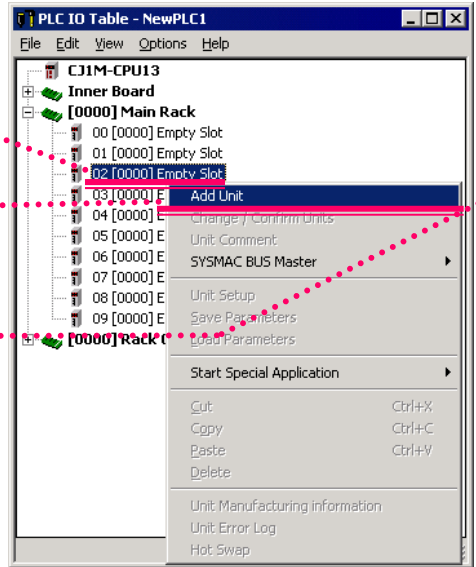


Right-click

Select [Add Unit]

Click + symbol on analog I/O




Select Unit Type.

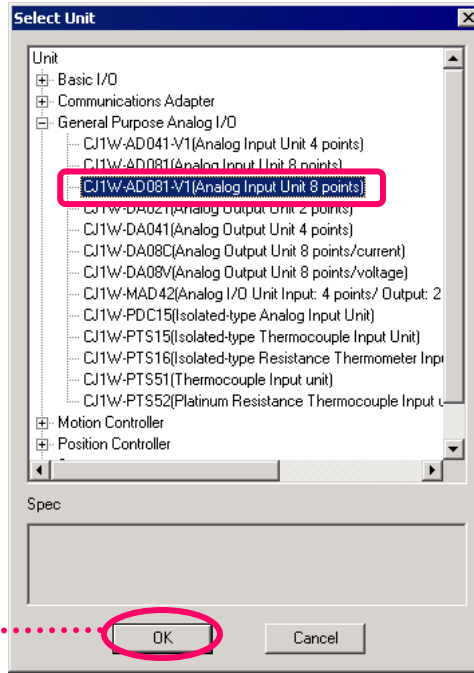


Click

OK





Select Unit and Number.

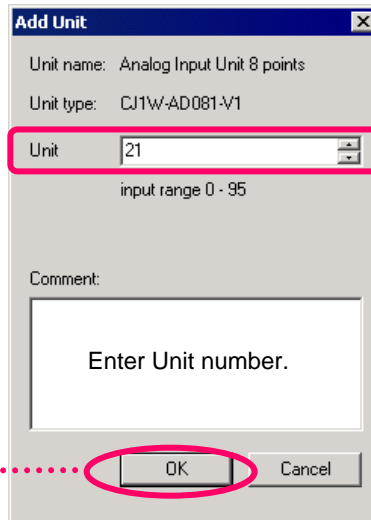


Click

OK






The Analog Unit is registered to the I/O Table as shown below. Set up the next analog Unit's parameter.

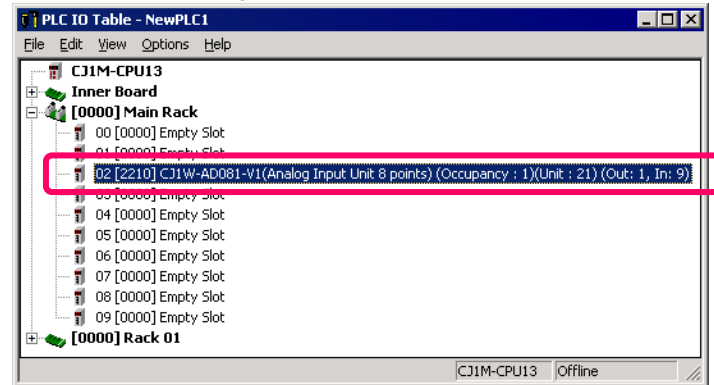

Double-click the analog Unit


The Analog Unit Setup Screen is displayed.

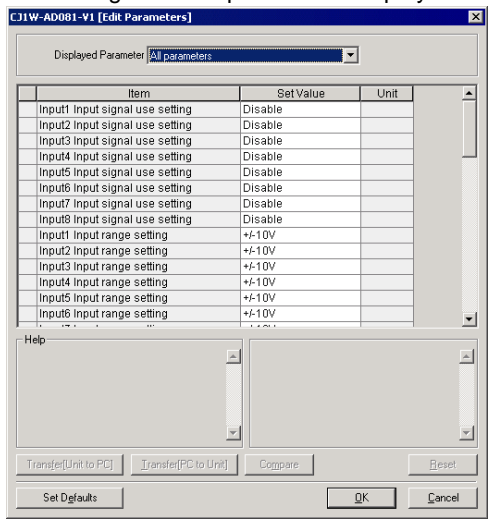

**CPU Bus Units and Special I/O Units Setting Function**  
 Traditionally, initial CPU Bus Unit and Special I/O Unit settings were made by referring to documentation to calculate DM address from the Unit number and entering a hexadecimal number. Now you can set it using the pull-down menu in the CX-Programmer's I/O Table. Easy setup/transfer/verification operations are available from the integrated parameter settings screen as shown below, without recognizing addresses (this function uses CPS function of CX-One previously described).

### Setting CPU Bus Units and Special I/O Units

For example, specify input number designation and range.

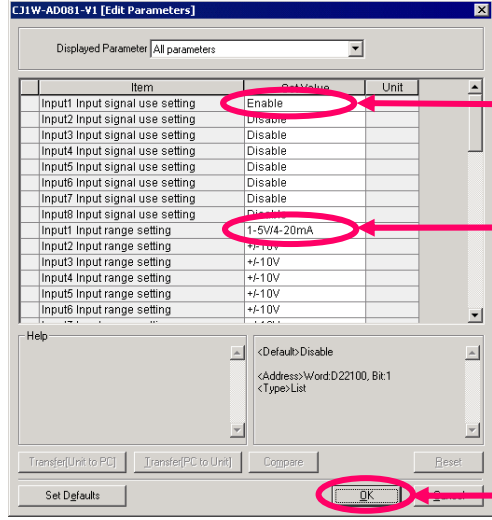

Select [Enable] for input No.1 usage designation.

Select [1~5V/4~20mA] for input No.1 range setting.

Click the [OK] button.

Unit parameter setting

## NCF Unit and Servo Driver Connected to the NCF Unit Setup

As with Analog Unit registration, register the NCF Unit (CJ1W-NCF71).  
 The NCF Unit resides within a position control Unit.  
 Next, start CX-Motion-NCF using [Start with Settings Inherited].

When opening a stored project file after starting the dedicated tool, select [Start Only].  
 If [Start with Setting Inherited] is selected, a new project is created.



Right-click NCF Unit



Point [Start Special Application]



Click [Start with Settings Inherited]


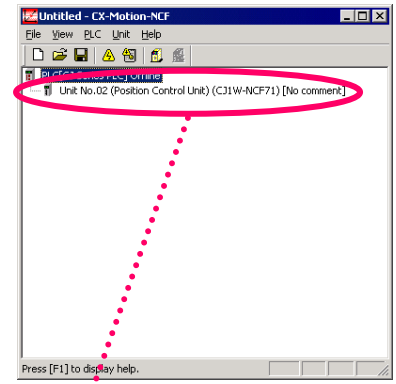
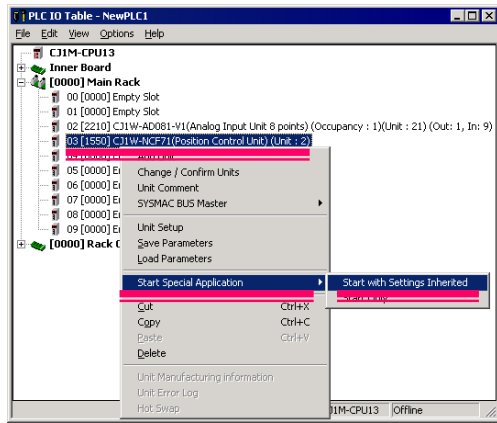


Displayed with NCF Unit registered.

Double-click NCF Unit



Click

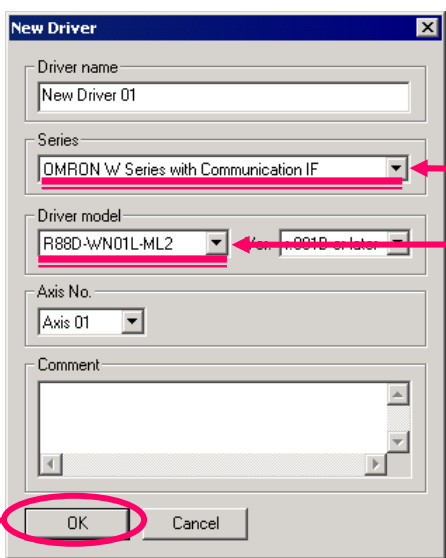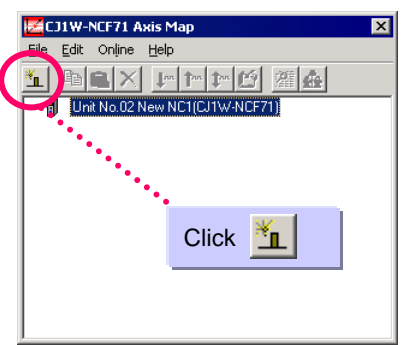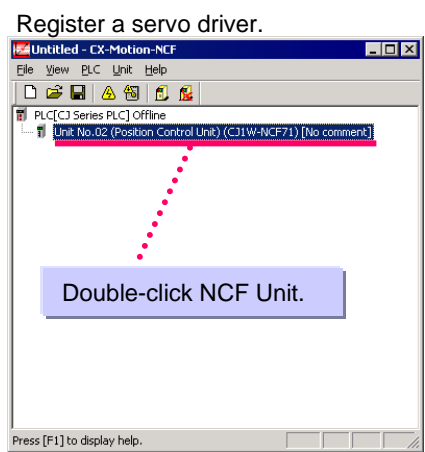


Select OMRON W series (with communications function).

Select R88D-WN01L-ML2.


Click

Double-click NCF Unit

Edit NCF Unit parameters.

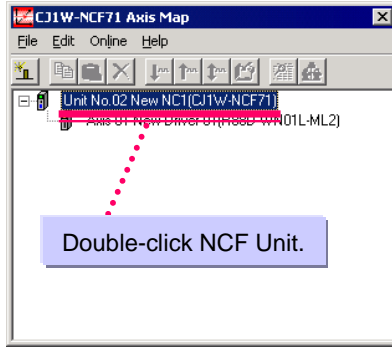


Double-click NCF Unit.

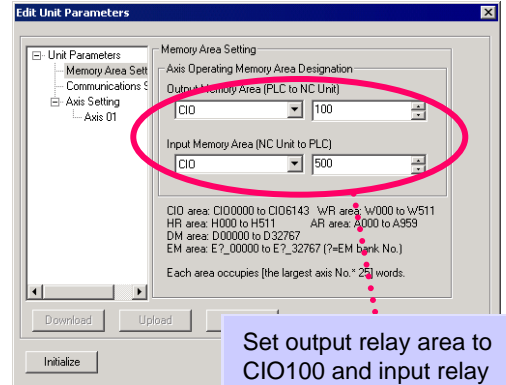


Set output relay area to CIO100 and input relay area to CIO500.

Select [Communications Setting]

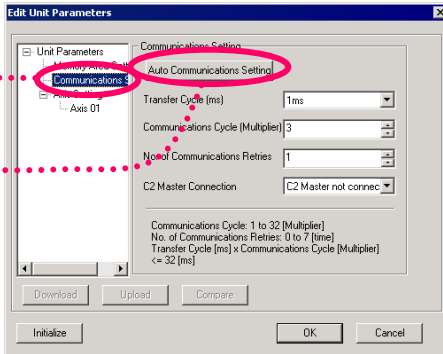

Click Auto Communications Setting

Select [Axis 01].


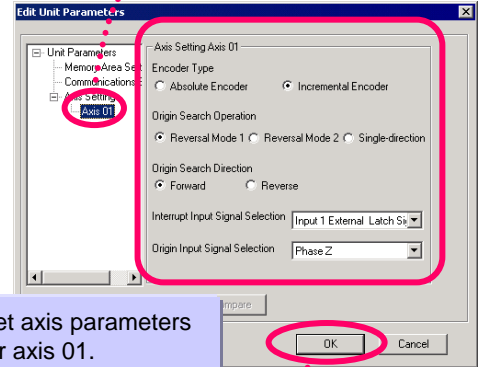


Set axis parameters for axis 01.

Click OK

Edit servo parameters.


Double-click the servo driver

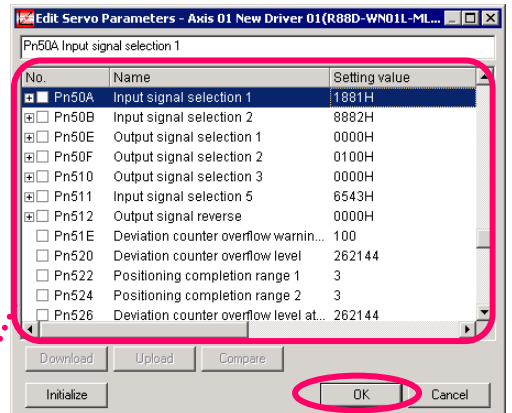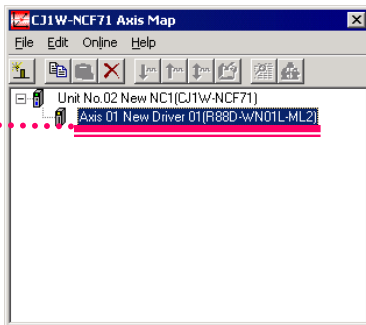

Set servo parameters for axis 01 as shown below.

- Pn50A(input signal selection 1): 2881
- Pn50B(input signal selection 2): 8883
- Pn511(input signal selection 5): 6541

Click OK



### Using the MCH Unit

When using the MCH Unit (CJ1W-MCH71) instead of the NCF Unit, use the following settings. As with Analog Unit, register the MC Unit to the I/O table. The MCH resides within the Motion Controller. Then start CX-Motion-MCH using [Start with Settings Inherited].

When opening a stored project file after starting the dedicated tool, select [Start Only]. If [Start with Setting Inherited] is selected, a new project is created.

Right-click MCH Unit



Point [Start Special Application]



Select [Start with Setting Inherited]




Add task, axis, program, and CAM data




Edit position data, parameters, program, and CAM data




Save the project

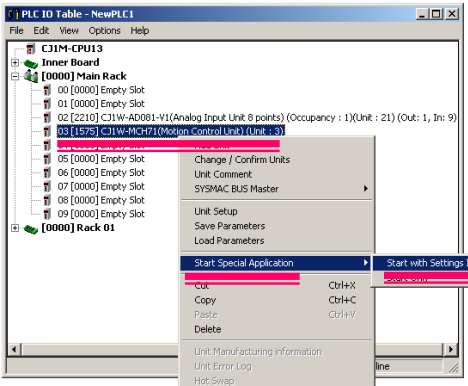

Start the MCH Unit as registered.

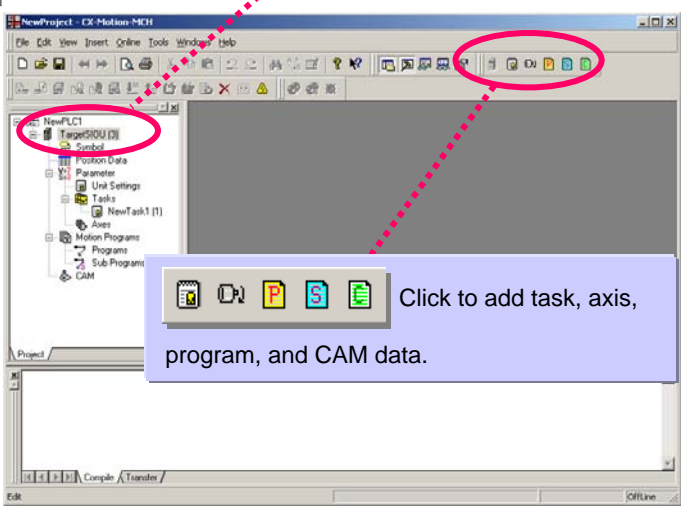


Click to add task, axis, program, and CAM data.

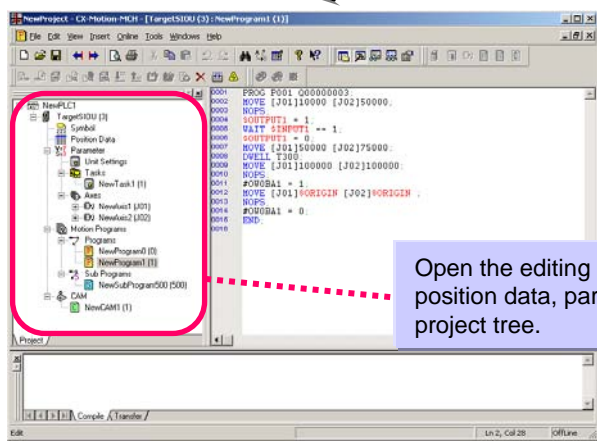

Open the editing screen to edit data by double-clicking position data, parameter, program, or CAM data on the project tree.


Click and save the project to file.



## Checking I/O Assignment

As with Analog Unit registration, register the IN and OUT Units.


Register basic I/O Unit

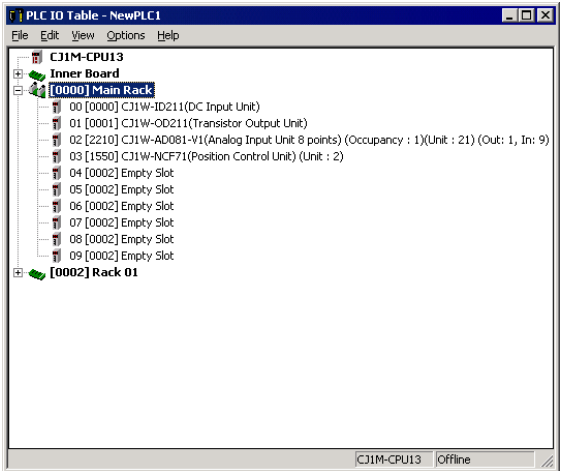

In this example, CJ1W-ID211 and CJ1W-OD211 are selected as IN and OUT Units respectively.

By registering Units to the I/O Table, you can check I/O assignment status.

Check I/O assignment

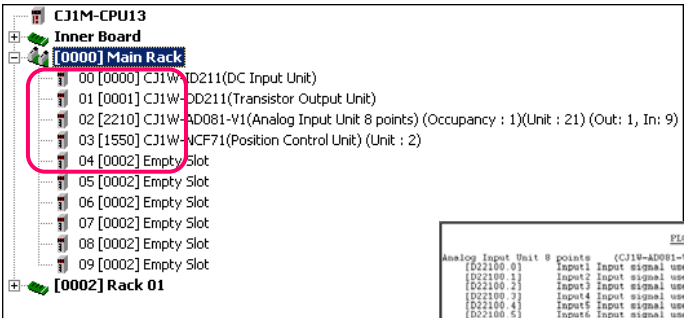


PLC I/O Table - NewPLC1

| Address   | Unit                       | Assignment  |
|-----------|----------------------------|---|
| D22100.0  | Input1                     | Input signal use setting <Enable(0Hex)>                                   |
| D22100.1  | Input2                     | Input signal use setting <Disable(0Hex)>                                  |
| D22100.2  | Input3                     | Input signal use setting <Disable(0Hex)>                                  |
| D22100.3  | Input4                     | Input signal use setting <Disable(0Hex)>                                  |
| D22100.4  | Input5                     | Input signal use setting <Disable(0Hex)>                                  |
| D22100.5  | Input6                     | Input signal use setting <Disable(0Hex)>                                  |
| D22100.6  | Input7                     | Input signal use setting <Disable(0Hex)>                                  |
| D22100.7  | Input8                     | Input signal use setting <Disable(0Hex)>                                  |
| D22101.0  | Input1                     | Input range setting <-5V4-70k(0Hex)>                                      |
| D22101.2  | Input2                     | Input range setting <+-10V(0Hex)>   |
| D22101.4  | Input3                     | Input range setting <+-10V(0Hex)>   |
| D22101.6  | Input4                     | Input range setting <+-10V(0Hex)>   |
| D22101.8  | Input5                     | Input range setting <+-10V(0Hex)>   |
| D22101.10 | Input6                     | Input range setting <+-10V(0Hex)>   |
| D22101.12 | Input7                     | Input range setting <+-10V(0Hex)>   |
| D22101.14 | Input8                     | Input range setting <+-10V(0Hex)>   |
| D22102.0  | Input1                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22102.2  | Input2                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22102.4  | Input3                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22102.6  | Input4                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22102.8  | Input5                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22102.10 | Input6                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22102.12 | Input7                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22102.14 | Input8                     | Mean value processing setting <Mean value processing for 2 buffers(0Hex)> |
| D22118.0  | Operation mode             | Operation mode setting <Normal mode(0Hex)>                                |
| D22118.8  | Conversion time/resolution | Conversion time/resolution setting <1ms/4000(0Hex)>                       |
| C102210.0 | Input1                     | Peak value hold <Not used(0Hex)>  |
| C102210.1 | Input2                     | Peak value hold <Not used(0Hex)>  |
| C102210.2 | Input3                     | Peak value hold <Not used(0Hex)>  |
| C102210.3 | Input4                     | Peak value hold <Not used(0Hex)>  |
| C102210.4 | Input5                     | Peak value hold <Not used(0Hex)>  |
| C102210.5 | Input6                     | Peak value hold <Not used(0Hex)>  |
| C102210.6 | Input7                     | Peak value hold <Not used(0Hex)>  |
| C102210.7 | Input8                     | Peak value hold <Not used(0Hex)>  |

In addition, you can check addresses assigned to actual I/O with a print out.

This I/O assignment information can also be checked by IQ indication (IN:I, OUT:Q) during ladder programming.

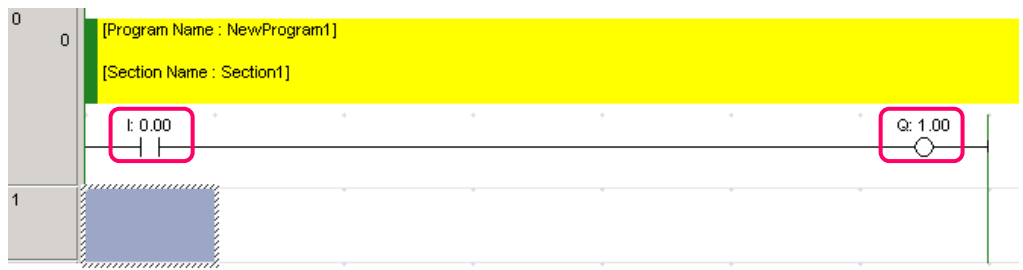


## Programming

This section describes programming with Library (OMRON Standard Libraries) that allows easier connection to OMRON's Components. OMRON Standard Libraries is a group of Components provided by OMRON, which can be categorized into two types; FB Components (OMRON FB Library) to be used for a ladder program and SAP Components (Smart Active Parts Library) to be used for an indicator.

● NCF Unit Programming with OMRON FB Library

Servo motor (axis 1) connected to Unit number 0 NCF is moved to position 2000 (command Unit) with speed of 2000 (command Unit/s) by relative move command.

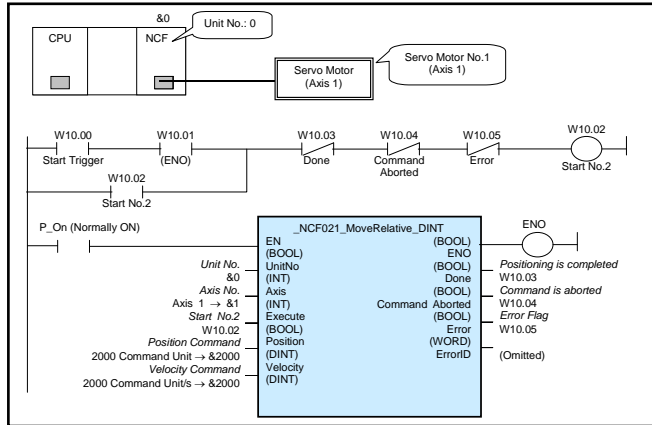

Right-click from Function Blocks





Select a folder from [Omronlib] > [Position Controller] > [NCF]




Select OMRON FB Library "\_NCF021\_MoveRelative\_DINT12.cfx"




Enter "MoveRelative" for instance name. Then create a ladder program

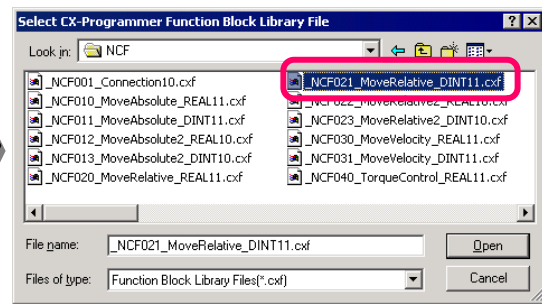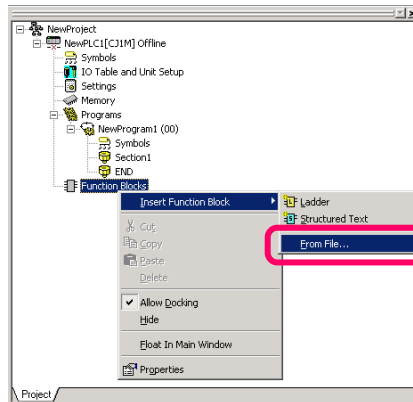

Call the selected OMRON FB Library on the ladder, then enter its name (instance name) (in this example, "MoveRelative"). Then create a ladder program as shown below.

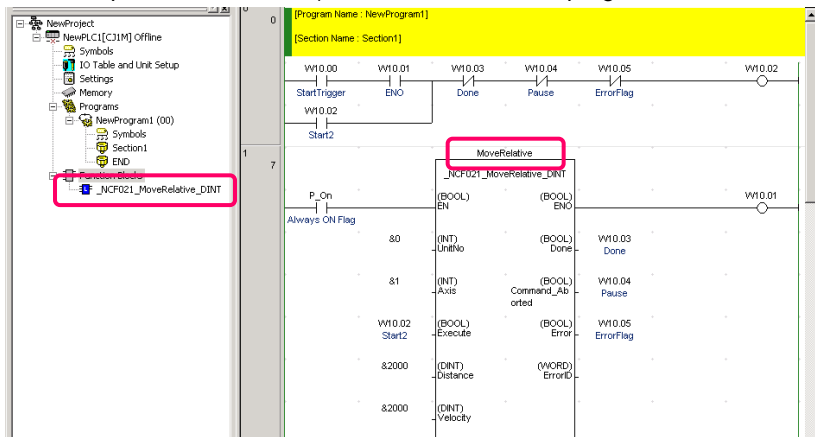

OMRON FB Library is a collection of Components that OMRON provides as a Function Block to use functions of OMRON's Units for PLC and FA Components much easier on a PLC program. \* For details, see *FunctionBlock StructuredText Introduction Guide*, Chapter 1.




## How to use Smart Active Parts

This section describes how to use Smart Active Parts. In this example, NCF Smart Active Parts “Adjust Operation” is used.



From [Start] menu, select [Programs] > [OMRON] > [CX-One] > [CX-Designer] > [CX-Designer Ver.□] to start CX-Designer. (Or select [All Programs] > [OMRON] > [CX-One] > [CX-Designer] > [CX-Designer Ver.□].) Select [NS8-TV0[]-V2] and [System Version 6.0] or later.

See Library

Select [Library] from the [Tools] menu




Place Smart Active Parts on the screen.

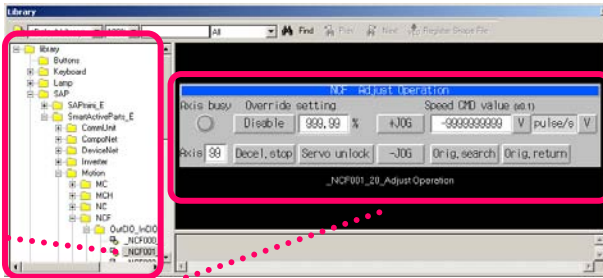


1. Select SAP - SmartActiveParts\_E - Motion - NCF - OutCIO\_InCIO folder
2. Select \_NCF001\_xx \_Adjust Operation (Check the Title)

3. Drag & drop it on the screen.





4. The selected Smart Active Parts are displayed on the screen.

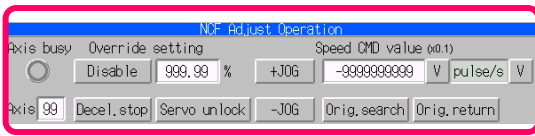




Setup Smart Active Parts

1. Double-click
2. Set 4 to the Destination Unit No.
3. Click [OK]

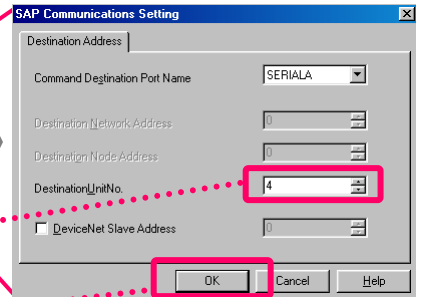

Smart Active Parts Setting is complete

Setup is completed at 100%

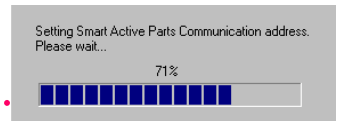

4. Communication address is automatically calculated according to the corresponding Unit.


Refer to Page 2-13 “Saving Project” for details.



Save the Project.





## Offline Debug

This section describes how to debug a program using CX-Simulator, a ladder simulation tool, without the PLC. Additionally, Switch Box Utility is used as a virtual input tool.

Click  (Simulator connection button)

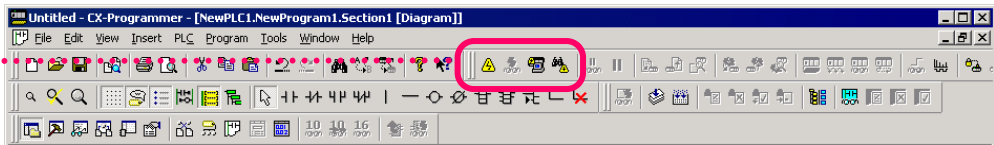

Program transfer starts.

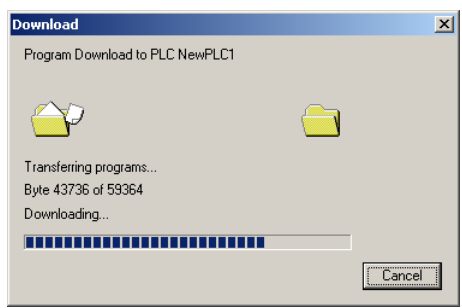


Screen when online

CX-Simulator debug console is starts

Starting Switch Box Utility  
Select [Tools] > [SwitchBox Utility]

Run PLC

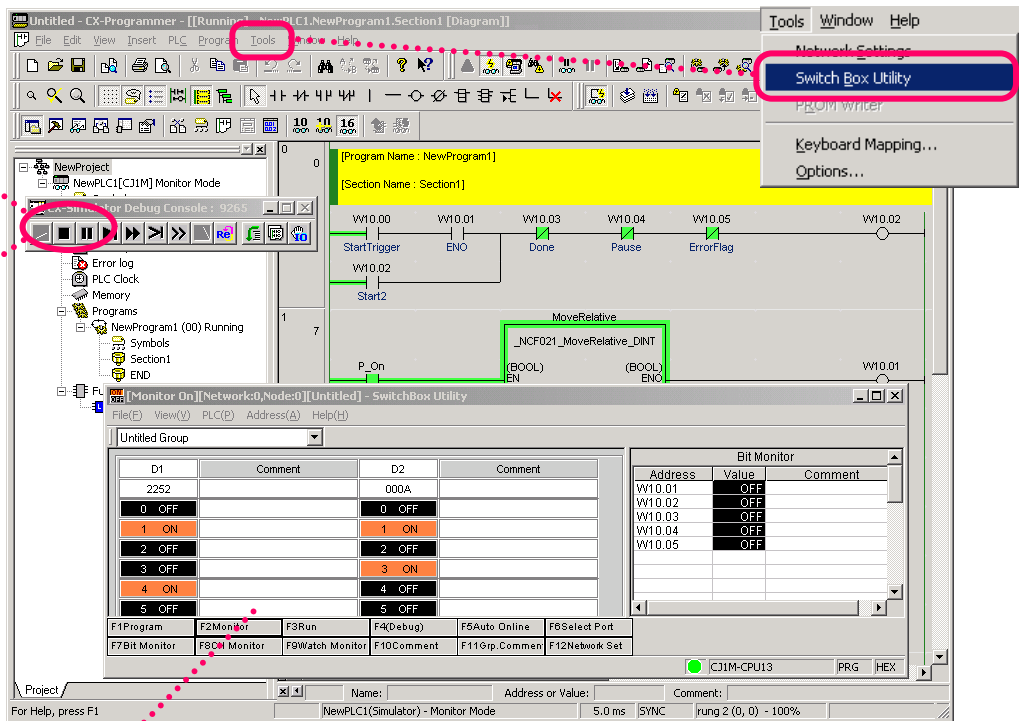



Switch Box Utility  
It is useful not only for virtual input by simulator but also for debugging while checking the PLC's wiring or setting the DM and other initial values.

## Saving a Project


Saving a CX-Programmer file

Unit setting, Unit parameter setting, and programs using the CX-Programmer can be saved all at once.

From the [File] menu, select [Save As...]

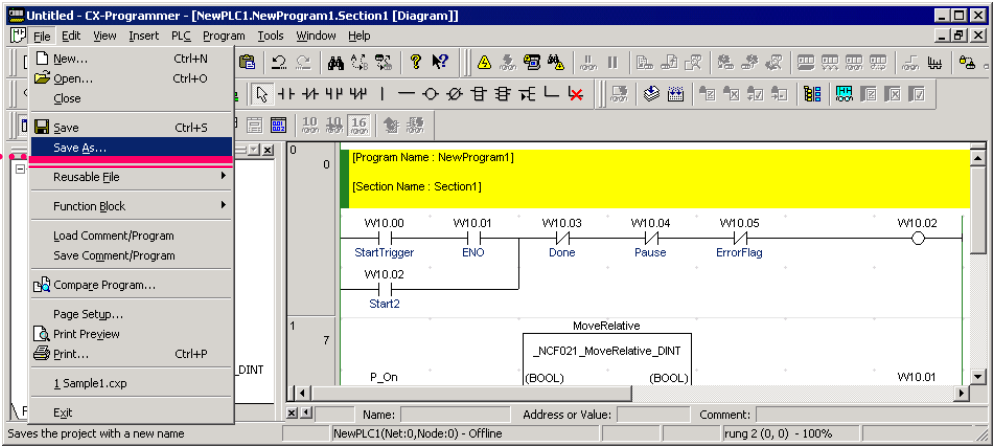


Save it with a name. In this example save as "Sample1".

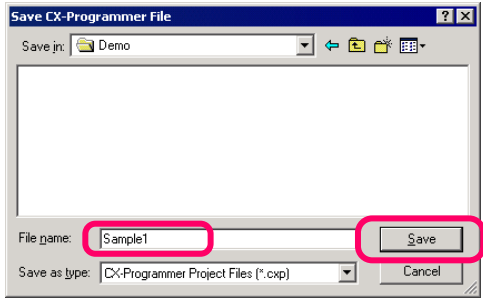


Saving CX-Designer and CX-Motion-NCF/MCH files

Created data can be saved for CX-Designer and CX-Motion-NCF/MCH. Save CX-Motion-NCF as "Sample2.mnf" (CX-Motion-MCH as "Sample5.mnh"), and CX-Designer as "Sample3.ipp".


Saving screen for CX-Motion-NCF

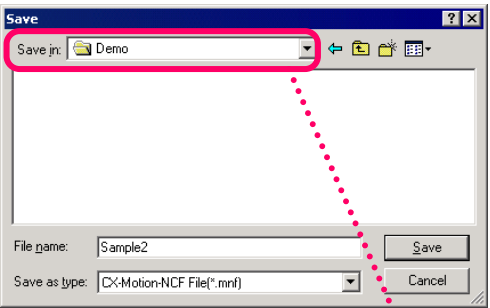

Saving screen for CX-Designer

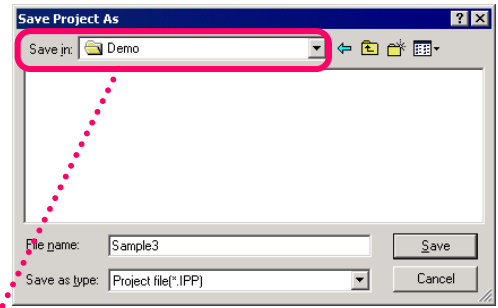

If you run a dedicated Support Software such as CX-Motion-NCF or CX-Designer when CX-Programmer is started, the same default folder location as that of CX-Programmer is used for reading and saving files. It allows easier CX-One Support Software file management.



This section describes connection to the machine, transfer of programs, creating Unit settings offline, and how to debug.



### Reading a Project

From [File] > [Open], select the file name "Sample1"



or  
Click



Use CX-Programmer to read the project "Sample1" saved in the previous section.



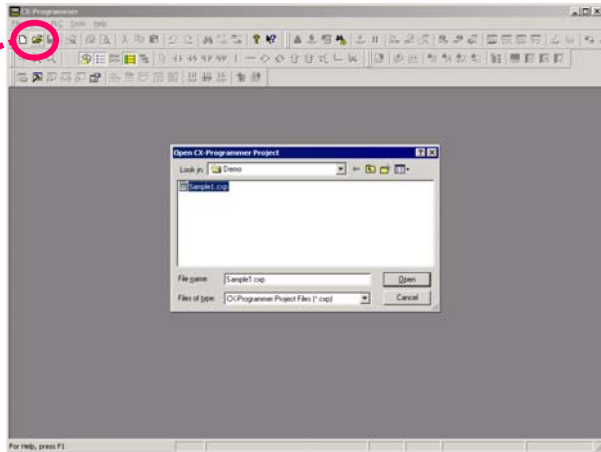


Ladder program "Sample1" is retrieved.

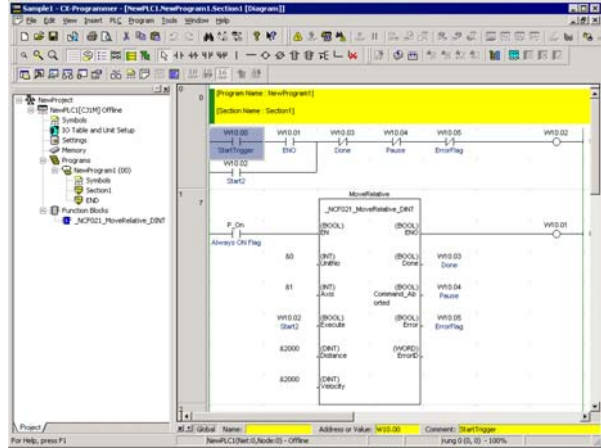

In I/O Table Unit setting function, the Unit parameter setting configured in the previous section is also retrieved.

Double-click the I/O Table Unit setting

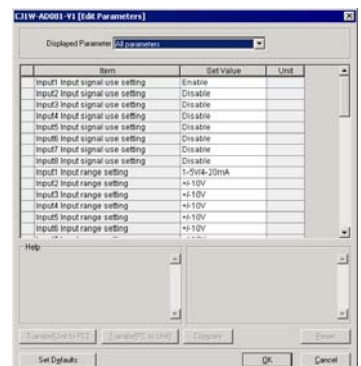
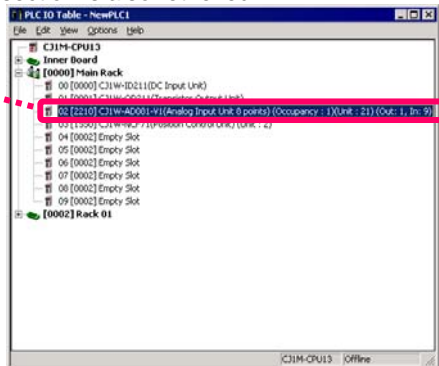





## Online Connection to PLC

Verify that PLC model and communications setting created offline and the actual PLC are correct.


Double-click PLC

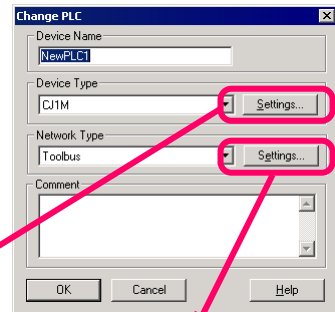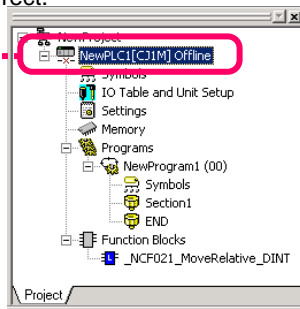

Check PLC model.

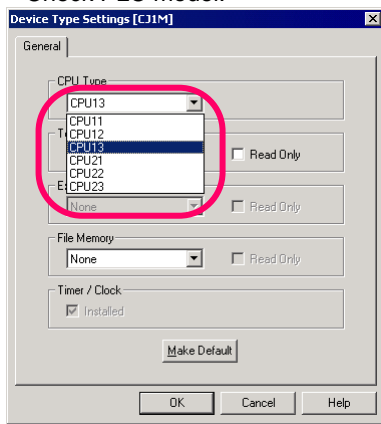

Check communications setting.

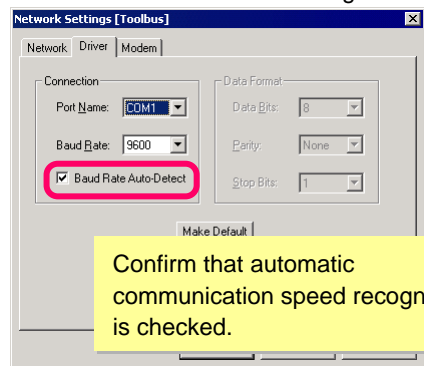


Confirm that automatic communication speed recognition is checked.

Click




(Online connection button)

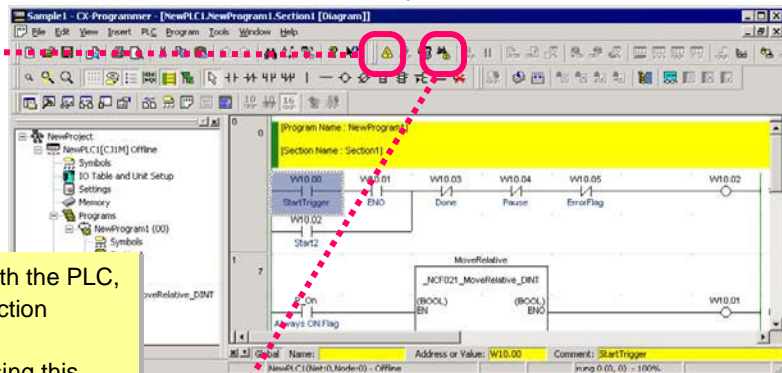

If a connection cannot be established with the PLC, you can use the automatic online connection function.

Save your current project data before using this function because it clears project data being edited. When USB conversion cable (CS1W-CIF31) is used for connection, specify the COM port number of the USB port used.

(Automatic online connection button)

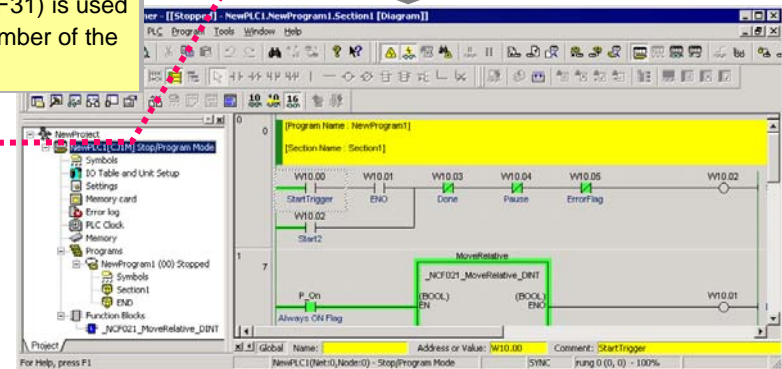

## Transferring to the Machine

Transfer programs and Unit setting parameters created by offline project to the PLC. In this example, data is sent at the same time to various Units using the batch transfer function.


[Data to be sent]

CPU Unit: Ladder program and PLC System setting data, I/O Table data



CPU Bus Units and Special I/O Units:

AD Unit: Range setting of inputs (1~5v / 4~20mA mode)

Select [PLC] > [Transfer] > [To PLC]

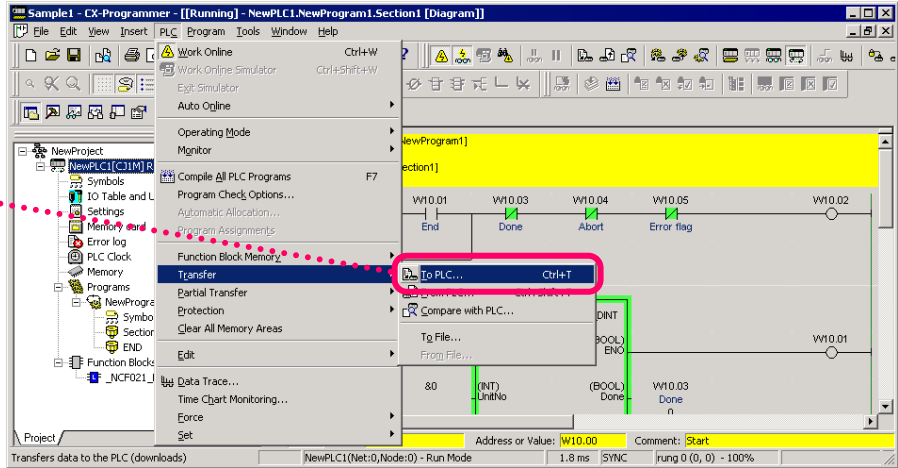


Click [Transfer All]

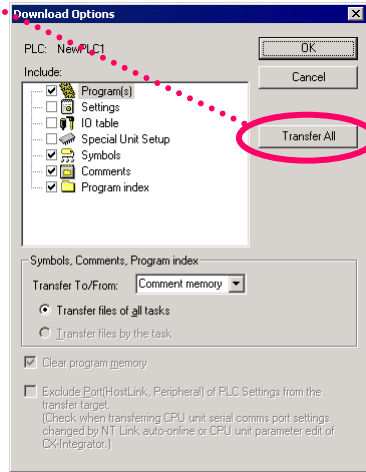

Click [Yes].


Program transfer starts.

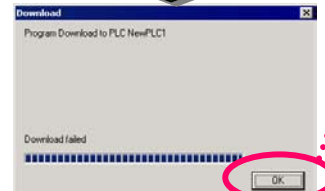


Click [OK].

Next Page

Program and configuration data are transferred at the same time to CPU Bus Units and Special I/O Units.

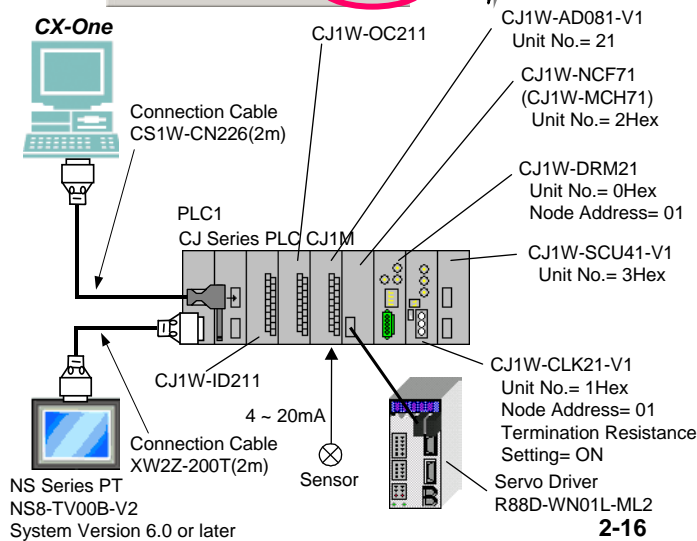

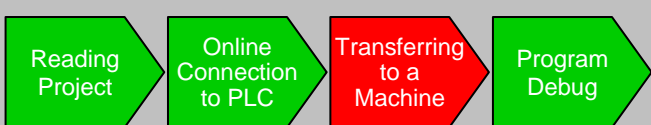

Then data is sent at the same time to NCF Unit and the servo driver connected to NCF Unit.

[Data to be sent]

NCF Unit: Common parameters, axis parameters

Servo Driver: Servo parameters

From CX-Programmer, display the I/O Table, then start CX-Motion-NCF by [Start Only].



Right-click NCF Unit



Point [Start Special Application]



Click [Start Only]

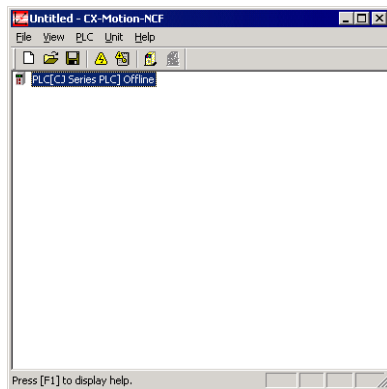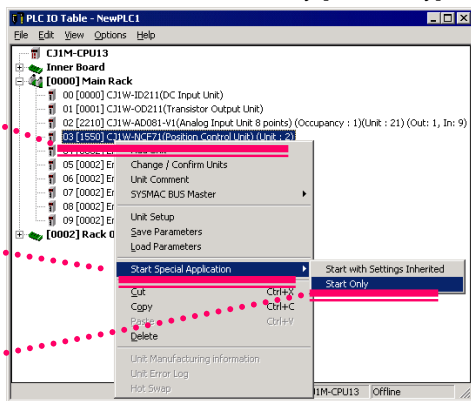

Open a saved project and transfer all NCF Unit and servo driver parameters.

To prevent a servo driver operation using a ladder program, you must set the PLC to PROGRAM mode.




Click



Select "Sample2.mnf"





Click

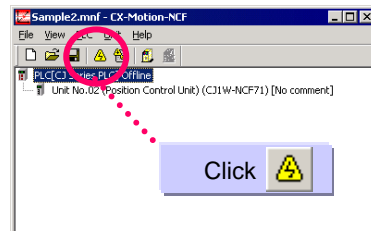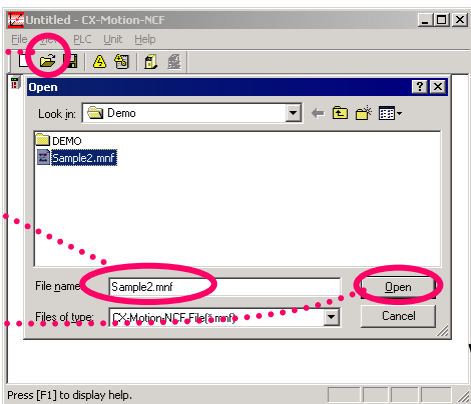



If it does not go online, click and check the communications setting between the personal computer and PLC.

Double-click NCF Unit

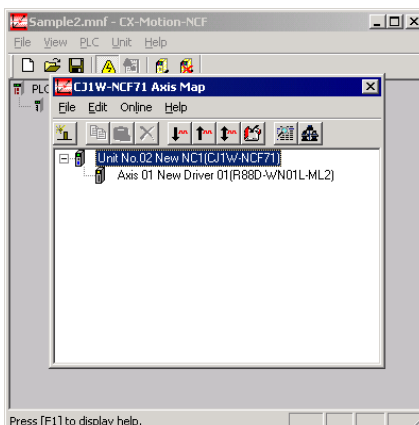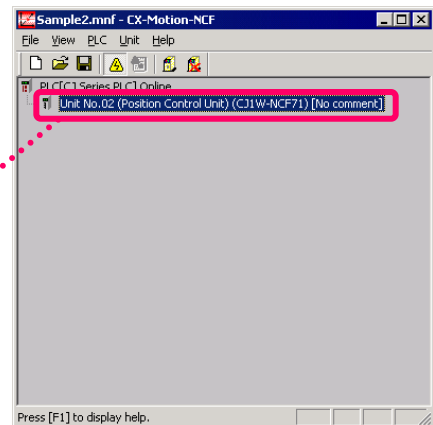

Click 

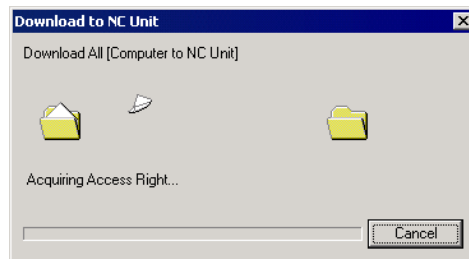
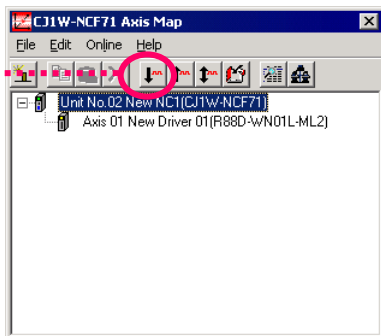


The Unit restart confirmation screen will be displayed during data transfer. Click the [OK] button after confirming safety. Also, in the case of communication was not established between the NCF Unit and the servo driver, confirm the axis number and restore power to the NCF Unit and servo driver.

When parameter transfer is completed, confirm that communications is performed normally and has not resulted in an error.

Monitor the NCF Unit. Confirm consistent scan list (axis configuration) and communications status and that no axis or common Unit error has resulted.



Click 

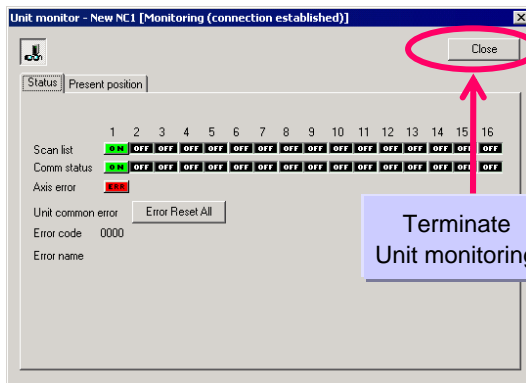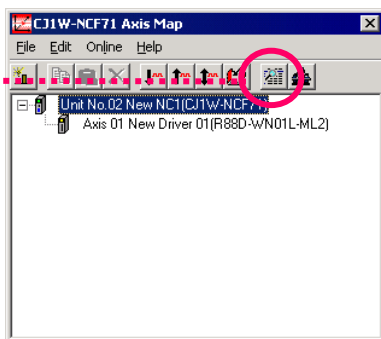


Terminate Unit monitoring.

Next, perform jog operation. Carefully read the displayed cautions, then perform the operation. To perform jog operation, it is required to establish a connection, servo lock, and jog setting.

Click [Online] > [Test Run]

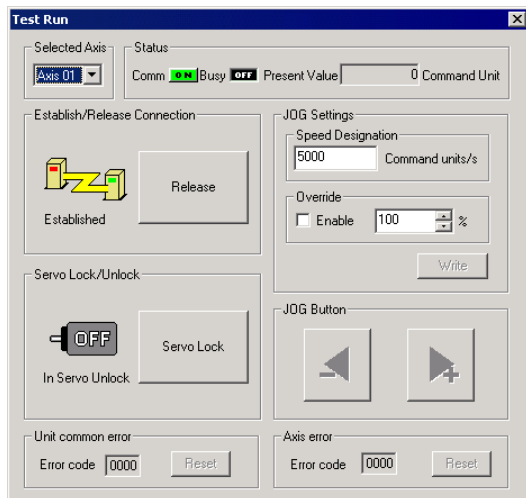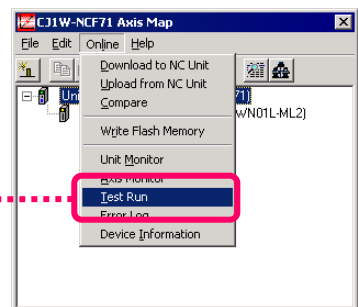

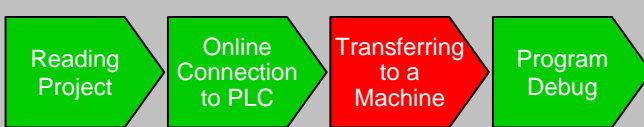

When using the MCH Unit, transfer data from the CX-Motion-MCH to the MCH Unit and servo driver connected to the MCH Unit.

[Data to be transferred]

MCH Unit: parameter, position data, program, CAM data.

Servo driver: servo parameter

Display the I/O table from CX-Programmer and start CX-Motion-MCH with [Start Only]. (Refer to NCF Unit for starting from the I/O table.)

Open the saved project and transfer Unit parameter, position data, program, CAM data, and servo driver parameters to the MCH Unit.

To prevent a servo driver operation using a ladder program, you must set the PLC to PROGRAM mode.

Click

Select file .mnh

Click [Open]



Click

Click

Select [All Data]


Select [With Servo Parameter]

Click [OK]

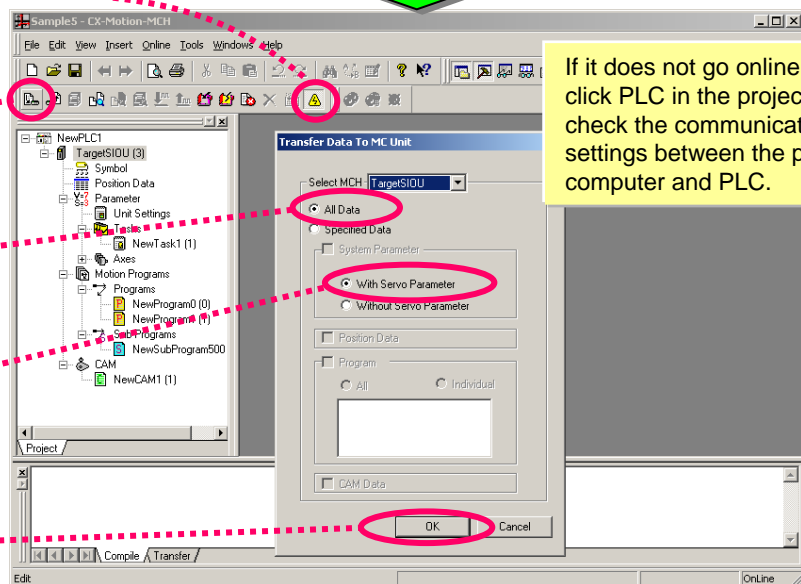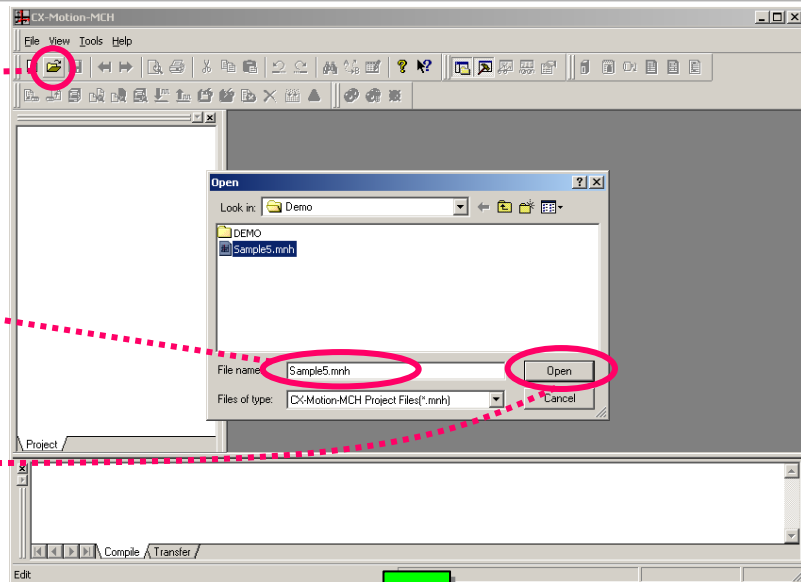

The Unit restart confirmation screen will be displayed during data transfer. Click the [OK] button after confirming safety. Also, in the case of communication was not established between the MCH Unit and the servo driver, confirm the axis number and restore power to the MCH Unit and servo driver.



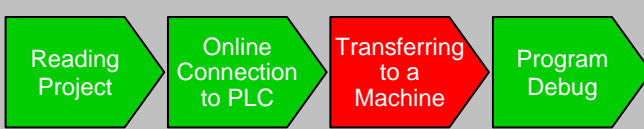

## Transferring NS screen data


This section describes how to transfer screen data to the NS through PLC without changing cables.

From [Start] menu, select [Programs] > [OMRON] > [CX-One] > [CX-Designer] > [CX-Designer Ver.□] to start CX-Designer. (Or select [All Programs] > [OMRON] > [CX-One] > [CX-Designer] > [CX-Designer Ver.□].) Open a project saved in the previous section.

Select [Transfer]-[Transfer[To PT...]] from the [PT] menu.

Start NS transfer program

Click on **Setting**

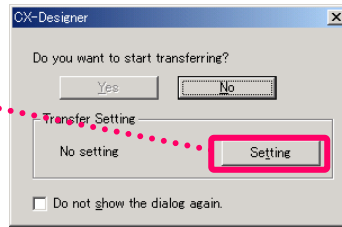


\*Communication between the NS and the PLC must be established before transferring screen data through PLC without changing cables.

If "Connecting..." is displayed at the right bottom of the screen, use Auto Connection (See Chapter 3 1-3 "Setup NT Link") to connect the NS and the PLC before starting the following procedure.


If the communication between the NS and the PLC has already been established, you do not need to perform the operation described above.

Setup communication route

Check "Pass thru PLC" in the Comm. Method window

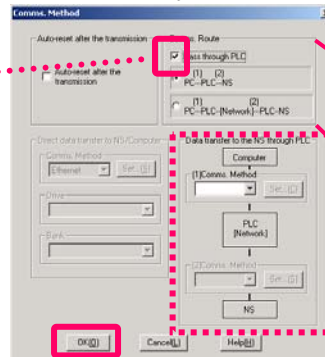



Check "Pass thru PLC" to activate the "PC → PLC → NS" route setting.



Select PC - PLC - NS.

Select Serial (Toolbus)


Setup "Data transfer to the NS through PLC".



Set the serial port COM No. for PC → PLC connection. Then, press OK.



Select NT Link

Press each setting button.




Enter NS Unit No. Then, press OK.

Transfer screen data

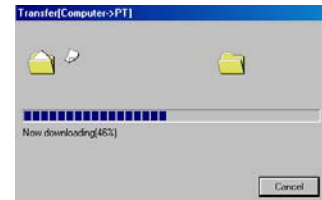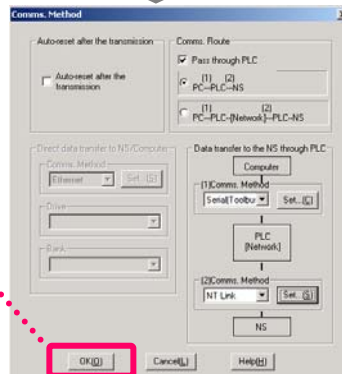

Screen data transfer is complete at 100%.

Click OK to start transfer

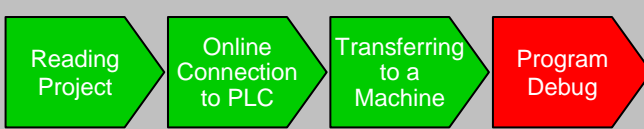



### Program Debug

Transfer programs and Unit setting parameters created by an offline project to the PLC. In this example, data is sent at the same time to various Units using the batch transfer function.


### Monitoring

Monitor ON/OFF status of contacts and coils.

Click

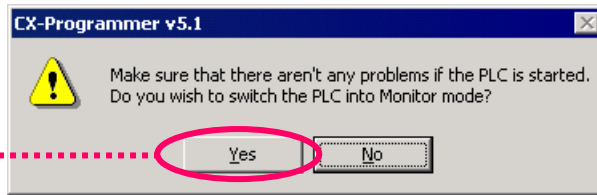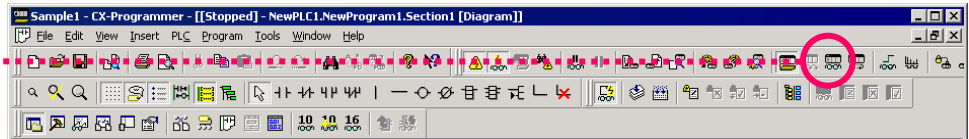


Click [Yes]



... ON/OFF of monitoring

## Monitoring -2 Changing the Current Parameter Value

Change the current value of contact or channel through conductive monitoring.

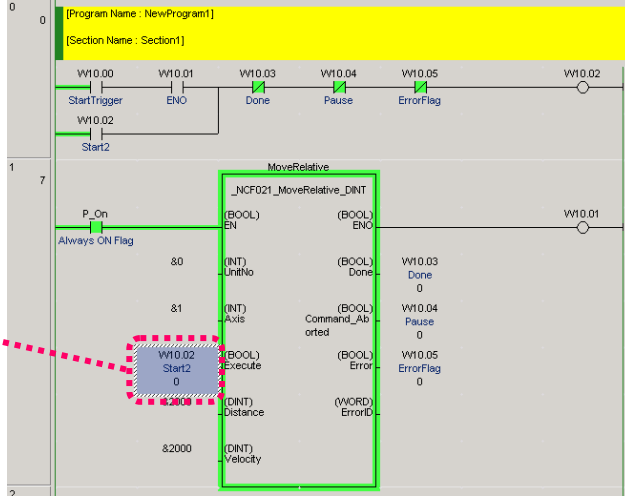


Move the cursor to D100 of input parameters

Right-click, then select [Set/Reset (S)] > [Value (V)] from the pull-down menu

or

Double-click

Or





Change current value of the input parameter.

The "Set New Value" dialog box is shown. It has a title bar with "Set New Value" and a close button. The "Address" field contains "W10.02". The "Data type" dropdown is set to "BOOL". The "Value" field contains "1". Below the value field, there is a display area showing "0, 1 (OCH)". The "Set" button is circled in red.

Click

Ensure to add "#" (hexadecimal/BCD) or "&" (decimal) to the left of the value.

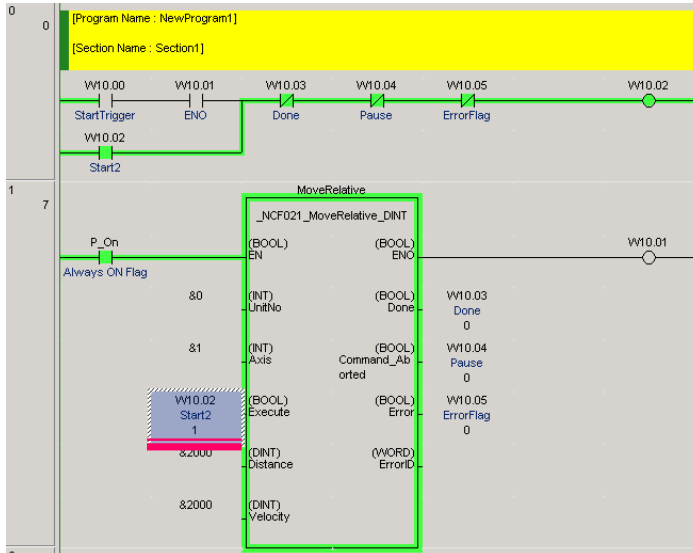

## Online Program Modification (Online Edit)

Move the cursor on the circuit you want to modify

You can use drag-and-drop to specify more than one circuit at the same time



Select [Program] > [Online Edit] > [Start]

Shortcut [Ctrl]+[E]





Move the cursor on the contact you want to modify and double-click





Select [Program] > [Online Edit] > [Transfer Change]

Shortcut [Ctrl]+[Shift]+[E]

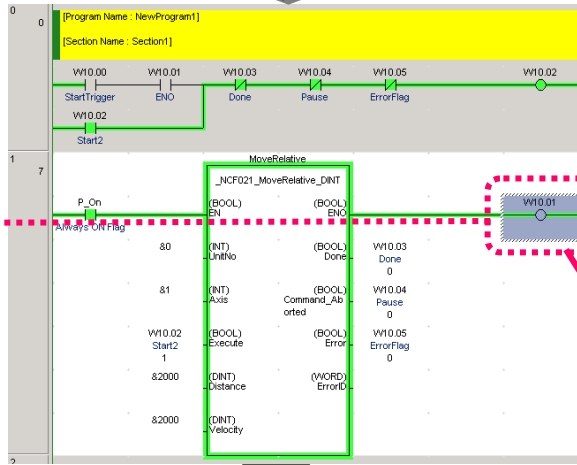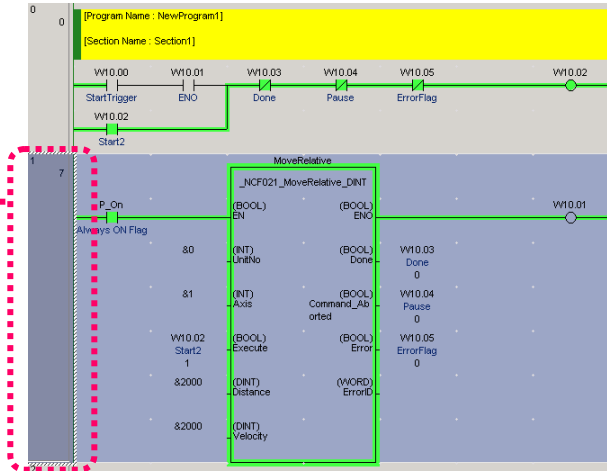

Double-click

Enter the contact number you want to modify (W20.01 in a circuit example).

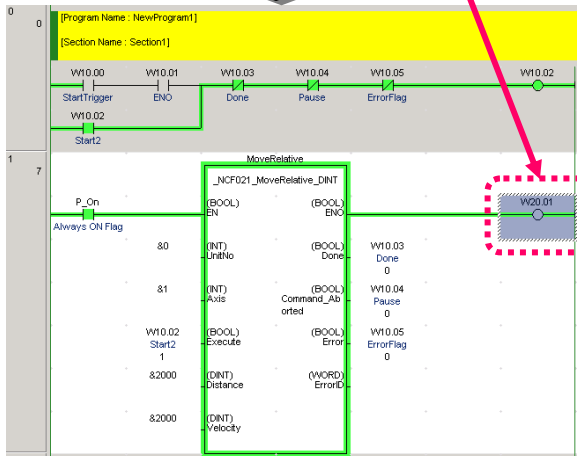


## Verifying Program

After modification on-site, you can verify it with the designed program and display the differences graphically. This allows for easier checking of the parts modified on-site.

1. Read the designed program. In this example, read "Sample1". Then connect online.

Click   
(Online connection button)

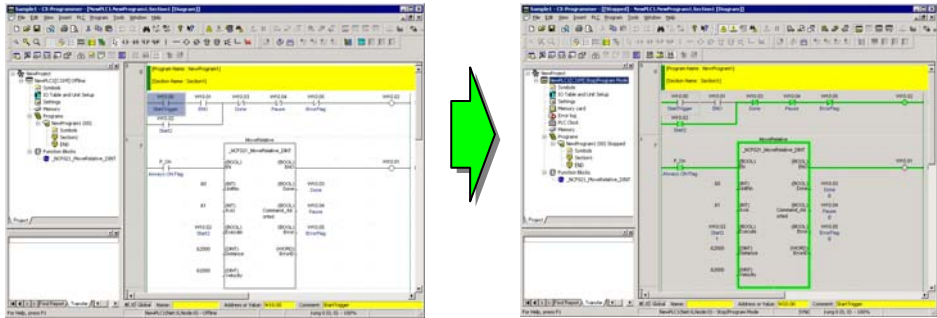


2. Select verification.

Select [PLC] > [Transfer]  
> [Compare with PLC]


Click [OK]

Click [OK]

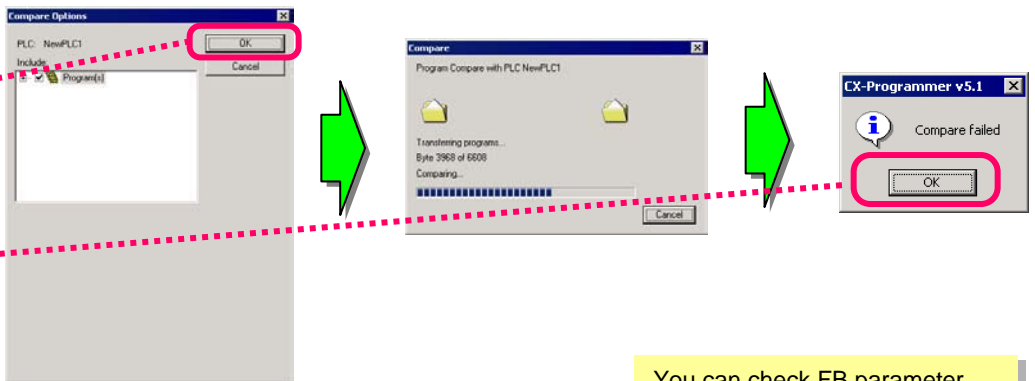

3. Display the verification result.

Select [Section1] and  
click [Detail View]

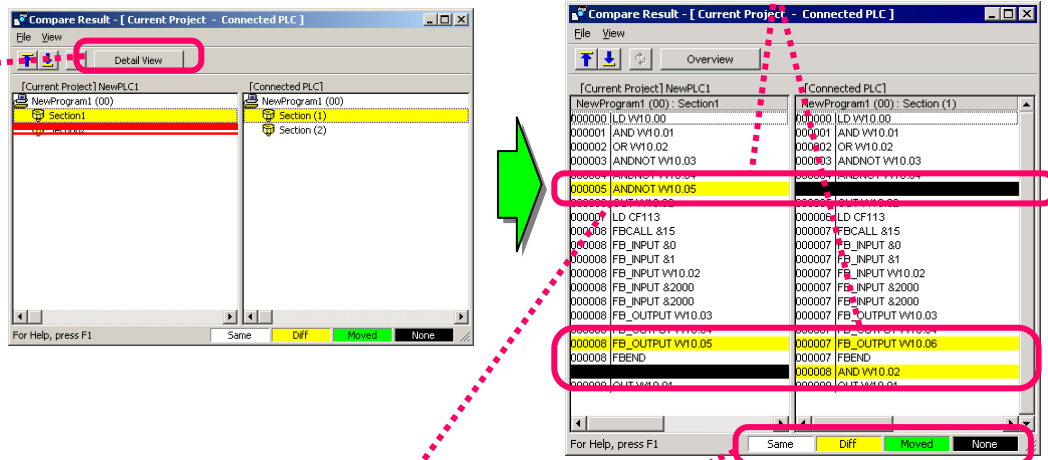

You can check FB parameter differences.

You can check ladder contact address differences.

In addition, you can check add, delete, and move contacts, coils, and apply instructions.

## Unit Parameter Change and Verification



After modification on-site, you can verify it with the designed Unit parameter and display the differences graphically. This allows for easier checking of the parts modified on-site.

1. Read the designed program. In this example, read "Sample1".  
Then connect online. (If you have already read it in the previous section's operation, this is not required)

Open the I/O Table/ Unit setting, then double-click the AD Unit.

Click [I/O Table/Unit  
Setting]



Double-click the  
registered AD Unit

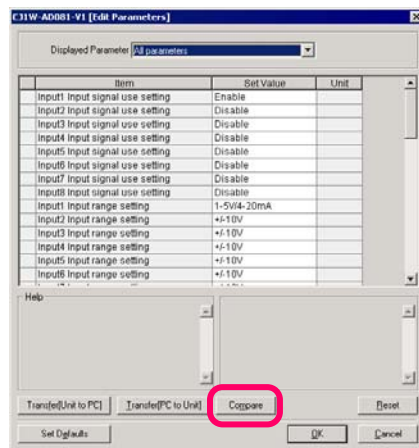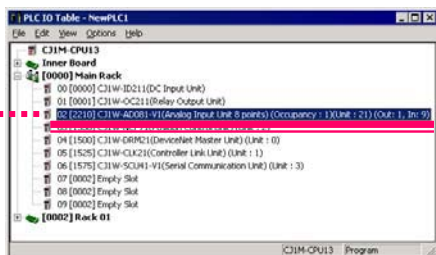

Click [Compare] button

2. Click the [Compare] button.


Now you can see the difference between the designed Unit parameters and the configured parameters in the machine.

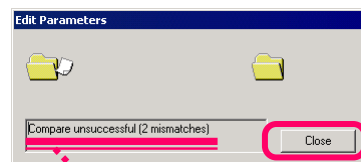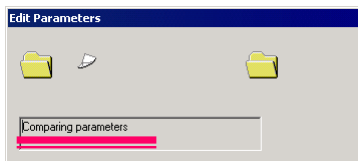

Click Close

You can check the  
number of unmatched  
items.

3. Unmatched detail differences can also be checked.

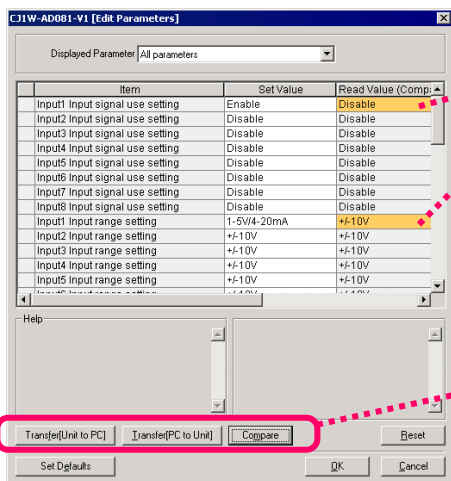

Unmatched items are  
shown in orange.

After checking the  
unmatched details, Unit  
parameters can be easily  
modified.

**You have now completed Chapter 2: Example of PLC System Construction by CX-One.  
The next chapter describes PLC network construction flow.**

**Chapter 3**  
**Example of PLC Network**  
**System Construction by**  
**CX-One**


**CX-One**

# Example of PLC Network System Construction by CX-One

## Workflow in This Chapter

This chapter describes an example of PLC network System construction from start-up to reassembly and on-site adjustment as shown below.

This chapter mainly describes how to start up the System using CX-Integrator, an integrated start-up Support Software for various PLC networks.

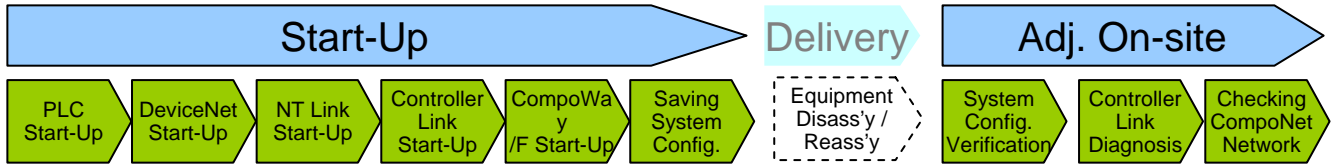


### Start-Up

- Describes details from assembly and wiring of PLC System to program download for a trial run.
- Target of Start-Up  
Aims at removing the cause of errors from a PLC and to turn off all of red LEDs that indicate errors for any component of the PLC System.
- Saving the entire system configuration after completing start-up is recommended. You can utilize it for system adjustment on-site after delivery to reduce the adjustment period.

### Adj. On-site

- Describes details from disassembly of a system for which the trial run, delivery, and reassembly on-site as well as operation check have been completed.
- Target of Adjustment On-site
  - 1) Confirm that no error will occur in its electrical system in the same system configuration as that before delivery.
  - 2) Confirm that no discrepancy will be found in Controller Link network settings by connecting to a network on-site.
  - 3) Though CompoNet network is characterized by tool-less easy start-up, using the tool can shorten the time required to check the wiring.

## System Configuration

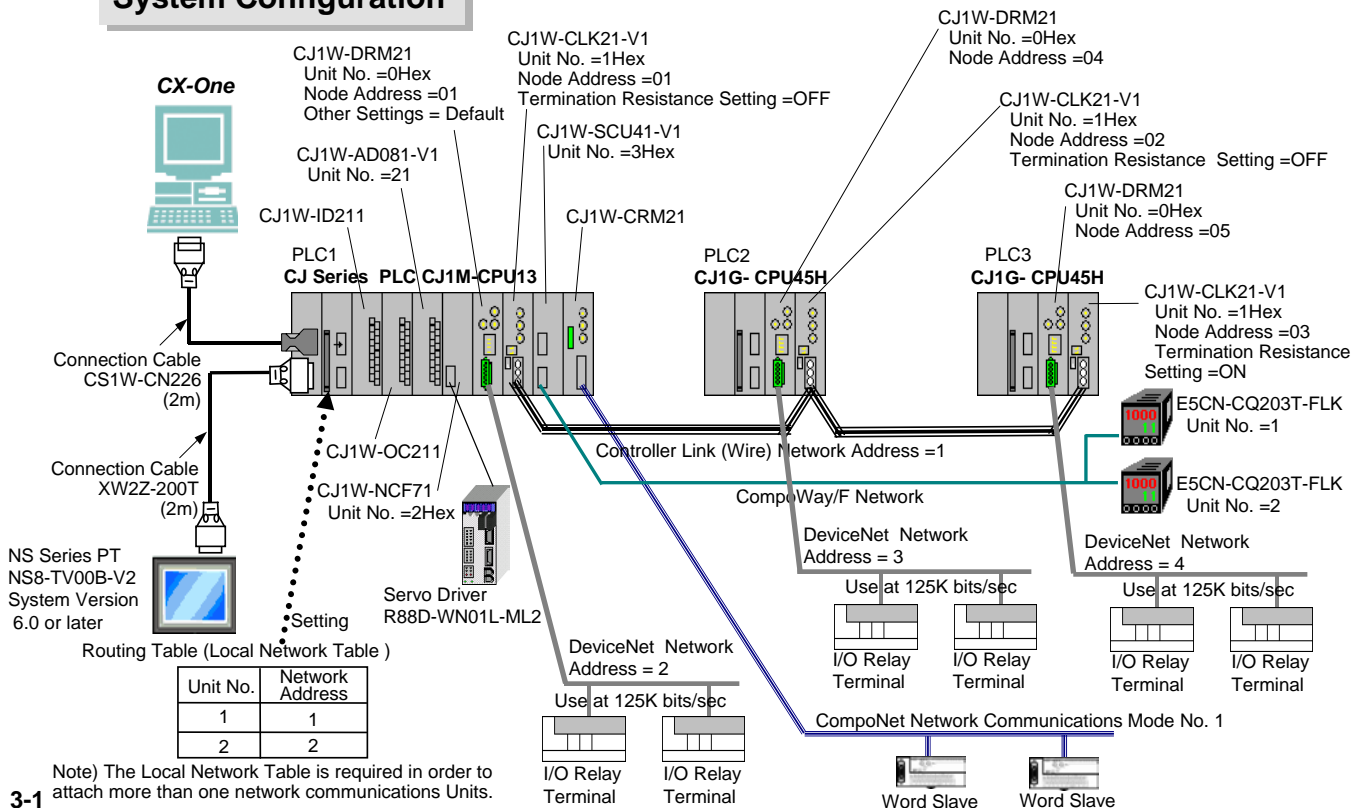






## PLC Network Start-Up

### Online Connection to PLC (Automatic Online Connection)



1. From the [Start] menu, select [Programs] > [OMRON] > [CX-One] > [CX-Integrator] > [CX-Integrator] to start CX-Integrator. (Or select [All Programs] > [OMRON] > [CX-One] > [CX-Integrator] > [CX-Integrator])

Starting CX-Integrator

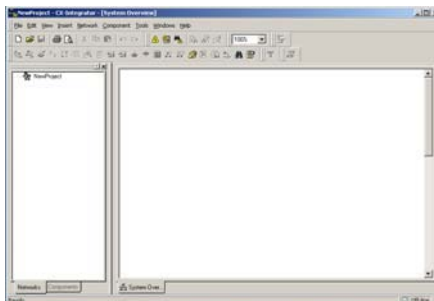


CX-Integrator starts and automatically connects online.

Click


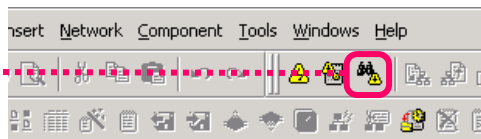


Select a serial port.  
When USB conversion cable (CS1W-CIF31) is used for connection, specify the COM port number of the USB port used.

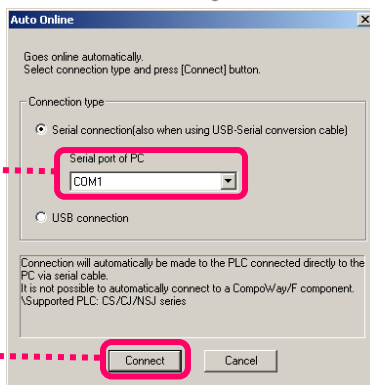

**(Important)**  
This operation is used for online connection to any PLC hereinafter. Unless described otherwise, use this operation to connect online.

Select a serial port, then click [Connect]

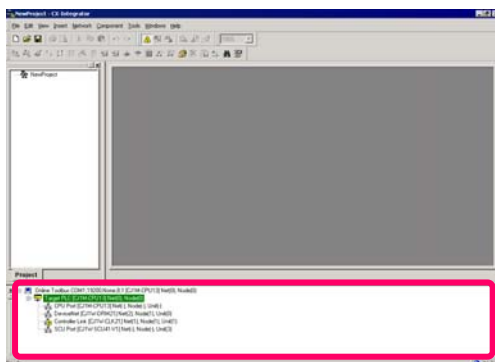


All communications Units and ports of a connected PLC are automatically displayed in the online connection information window.






## Checking PLC Error

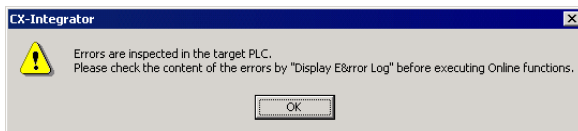

(1) Remove the cause of the PLC error, then make it available to run.


Move the cursor on the PLC and right-click

Select [Error Log]

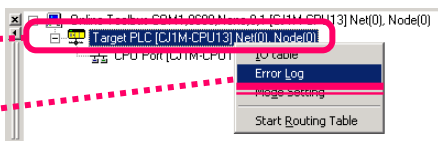

(2) Check the PLC error.

Examples of IO settings error and CPU Bus Units and Special I/O Units number overlap error are shown below.

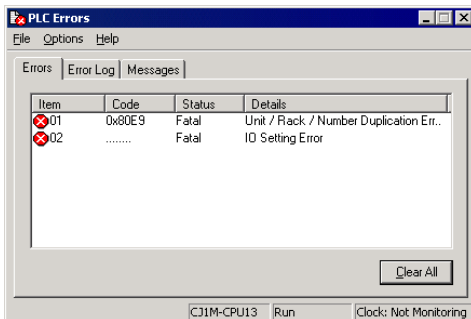

You can check an error in a CPU Unit and error history. (You can use the same function in the error history of CX-Programmer's online screen)






(3) Solve the cause of error.

You must solve the problem through the following procedure:


- Set the PLC to PROGRAM mode (in which you can change settings).
- Change the rotary switch of the CPU Bus Units and Special I/O Units (make sure that it does not overlap).
- Create the I/O Table.

- Set the PLC to PROGRAM mode.


From step (1) above, select [Mode Setting] then [Program] mode, and click the [Set] button.

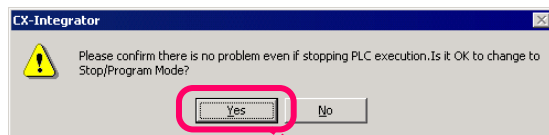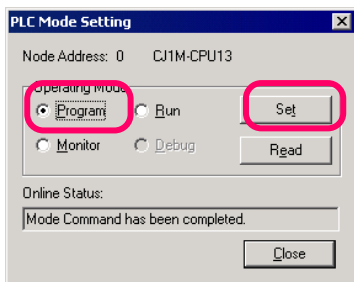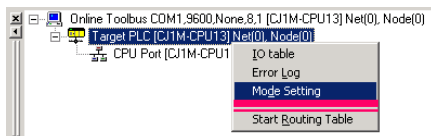



Click [Yes].








- To change the Unit number, change the rotary switch of CPU Bus Units and Special I/O Units and restart power.




- Check if any error occurs in the PLC (CPU Bus Units and Special I/O Units number overlap error should be solved).

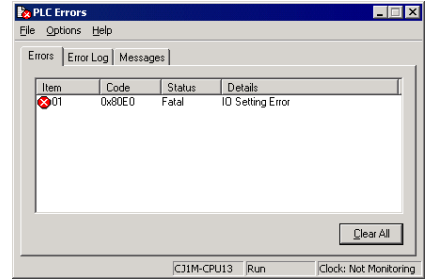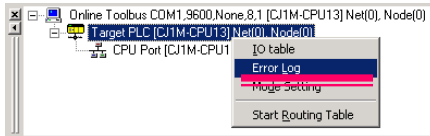


- Create the I/O Table.

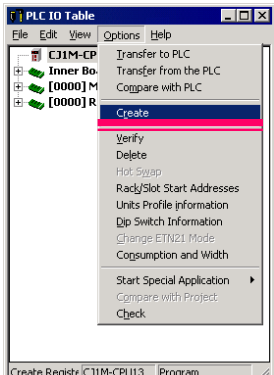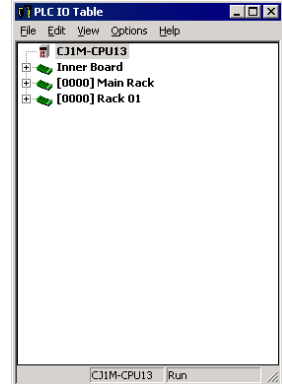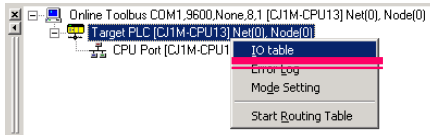



Click [Yes].

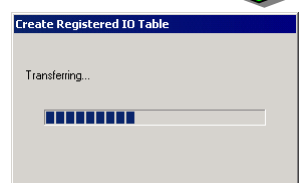

The I/O Table is created and Unit configuration is displayed.

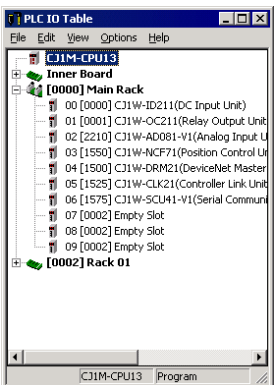


- Check if any error occurs in the PLC (all errors should be solved).

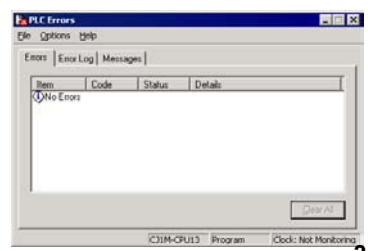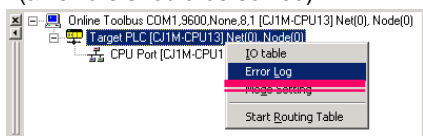





## Confirming the Routing Table is not Configured

(1) Check that Routing Table is not configured.

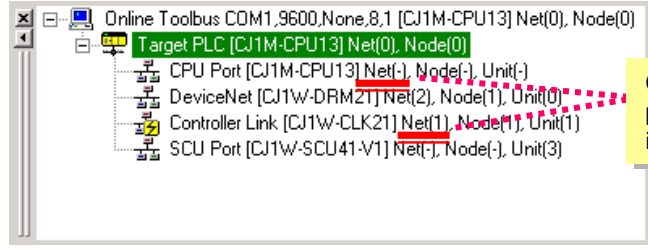


Check Routing Table presence. If the Routing Table is not configured, create one.

(2) Configure the Routing Table.

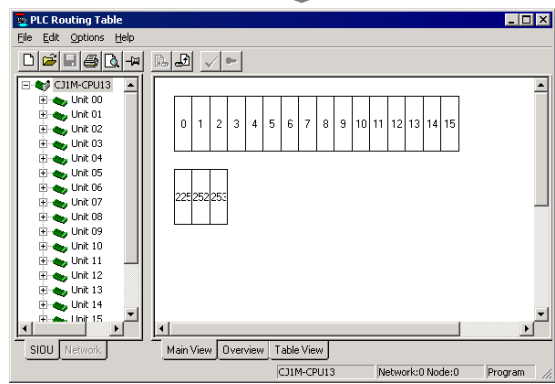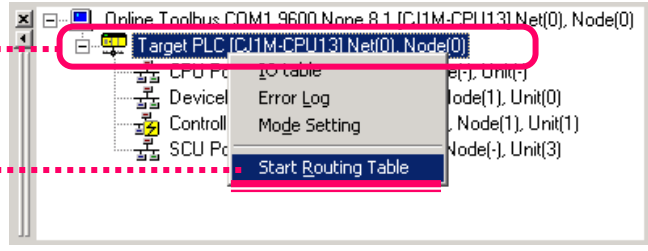

(3) Edit the Routing Table and transfer to [PLC].

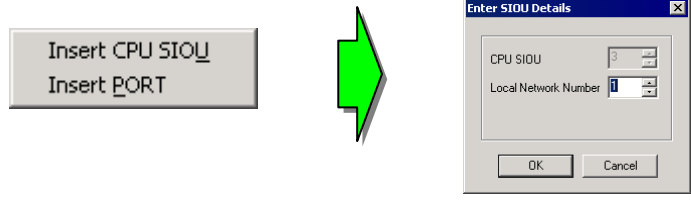

Set the Routing Table as shown below:

- Assign a network number to a Unit number.
- A Unit number can be checked on the online information window.
- Assign a network number to each network.

The Controller Link network number is same for other PLCs.

(4) Check if the error is solved.

- Re-connect to the PLC.
- All errors should be solved and no error messages should be displayed.
- The network number is displayed on the communications Unit.

Re-connect to a PLC with CX-Integrator

Move the cursor on the PLC and right-click

Select [Start Routing Table]

Right-click and select local network (Unit) [Insert CPU SIOU] or local network (port) [Insert PORT]



Enter its local network number, then click [OK]

Reconnecting CX-Integrator


## DeviceNet Start-Up

**Remove DeviceNet communications errors and establish communications.**



- ⇒ Check DeviceNet Unit's 7SEG indication and ON state of MS/NS LED.
- ⇒ Check Slave Unit configuration trough CX-Integrator.

**Create a scan list of DeviceNet and determine the memory map.**

- (1) Connect to PLC online, then connect to DeviceNet through the online connection information window.

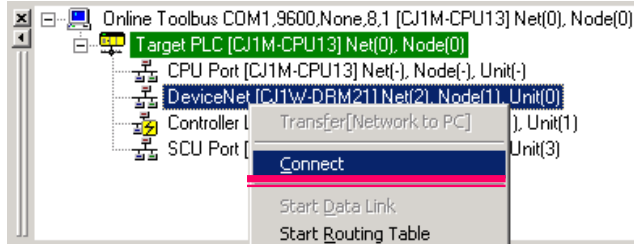


- (2) Next, upload the network configuration information of DeviceNet.

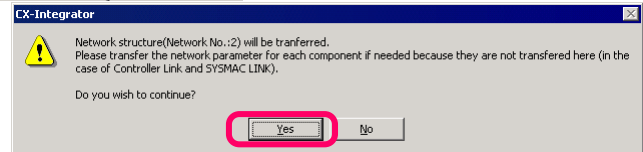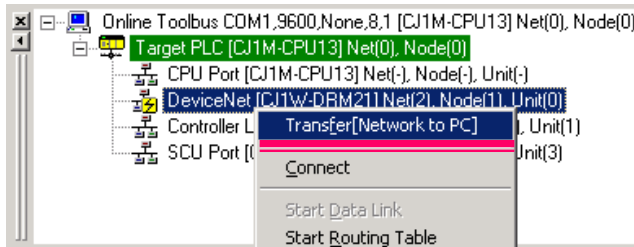

In this example, although one Master Unit (node number #01) and two Slave Units (node number #02, #03) are actually connected, assume in this start-up example that one Slave Unit (#03) is not connected due to disconnection.

- (3) After transfer is confirmed, connected devices on the current DeviceNet network are displayed as shown below.

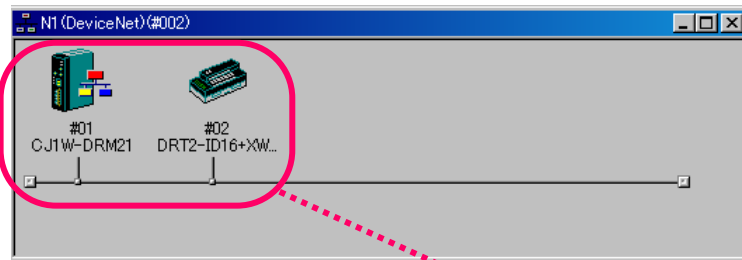

Check if a Slave device on the remote I/O communications actually wired is recognized. Master Unit (#01) and Slave Unit (#02) are recognized, while another Slave Unit (03) is not recognized.


Right-click a DeviceNet Unit under Target PLC in the online connection information window, then select [Connect]




Right-click on the Master Unit icon and select [Monitor] to display the device monitor screen. Select [Status] tab

(4) Check the error on the device monitor screen.

You can check the Slave status on the device monitor screen as well.




Slave Unit (#02) is recognized, while the other Slave Unit (03) is not recognized.

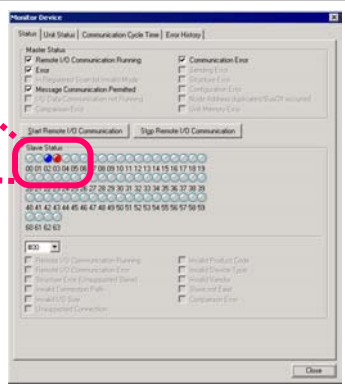

(5) Wire Slave Unit (#03) correctly.

(6) Re-upload the network configuration information of DeviceNet.

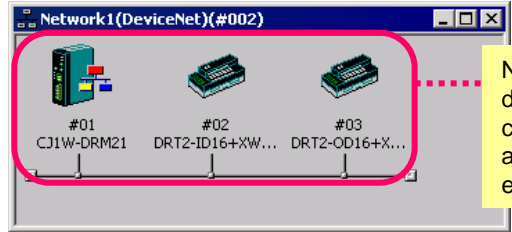


Now it can be confirmed that Slave devices on the remote I/O communications have been recognized and communications have been established.

(7) Configure DeviceNet remote I/O communications (free assignment) and register the Slave to the Master.


Double-click a Master Unit (CJ1W-DRM21) icon

Click twice

Click the [OK] button

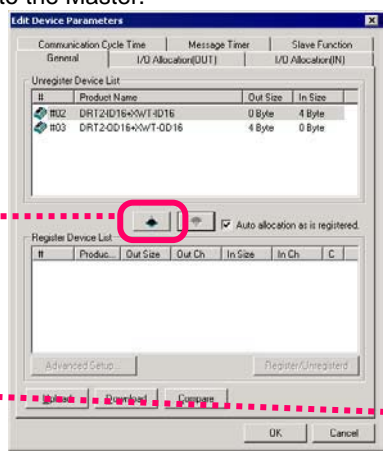

Two Slaves are now registered to the Master.

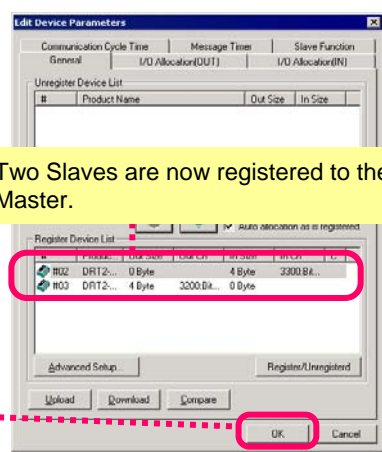


Right-click the Master Unit and select [Parameters] > [Edit]

Edit the parameters, then click the [OK] button

Select [Network] > [Transfer [PC to Network]]

(8) Configure assignment of Slaves to areas of a CPU Unit. If necessary, configure the Slave parameters as well.

<Master Unit parameter edit dialog box>

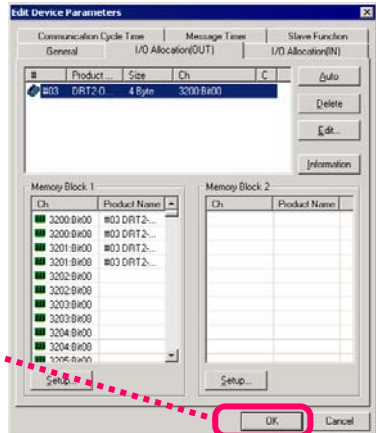

(9) Start remote I/O communication.




## NT Link Start-Up

Remove NT Link communication errors and establish communications.

- ⇒ Release NS Connecting . . . message.
- ⇒ Check NS configuration through CX-Integrator.



- (1) Connect to PLC online, then connect to a CPU Unit through the online connection information window.

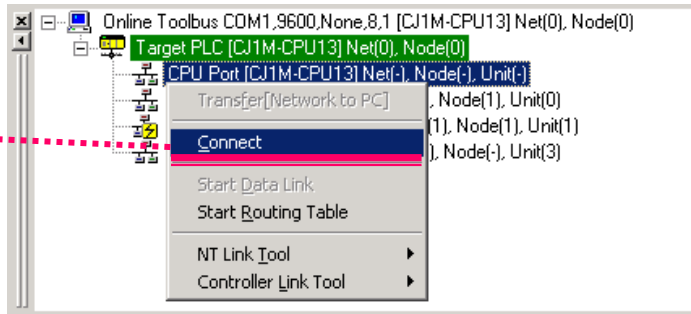


Right-click a CPU Unit under a connection target PLC in the online connection information window, then select [Connect]



- (2) Select in the order from upper link port to NT link.

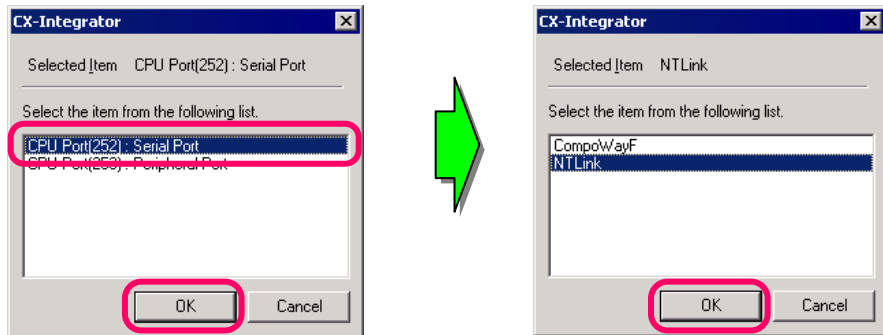


- (3) Next, select [NT Link Tool] > [NTLink Auto Online Setting] from the CPU Unit.

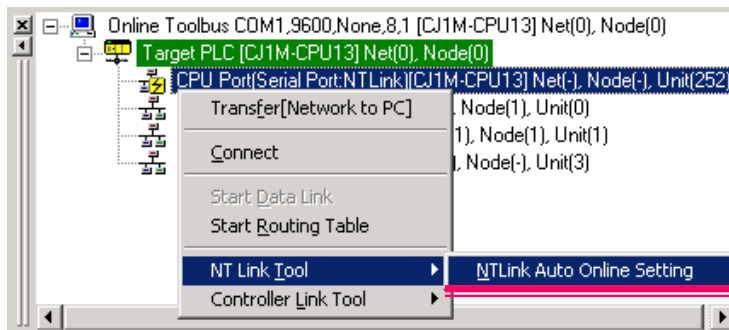


Automatic NT Link connection function is used to automatically connect NS series PT and PLC via serial connection (NT Link). Connection is automatically performed by overwriting the PLC serial communication port settings by adjusting to NS series PT settings.




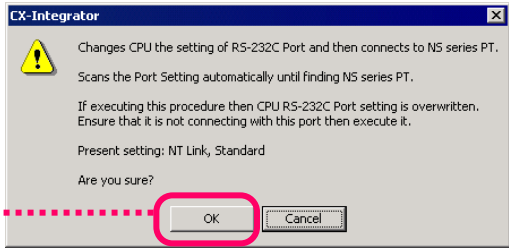


Click [OK]



(4) Check the CPU DIP switch.  
 • Follow the on screen instructions to change the DIP switch.

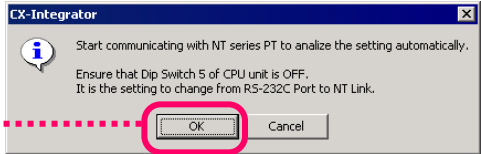


Click [OK]





(5) Screen message Connecting . . . is now cleared.


(6) Next, upload the network configuration information of NT Link.

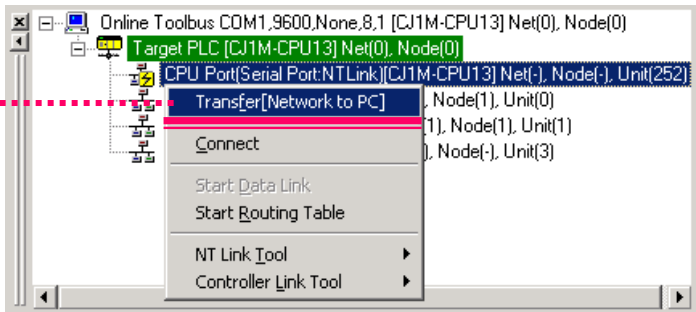


Select [Transfer [Network to PC]]

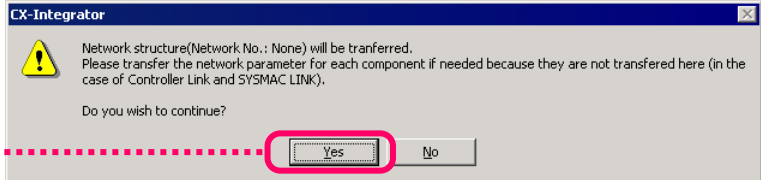

Click [Yes]



(7) After the transfer is confirmed, connected devices on the current NT Link network are displayed as shown below.

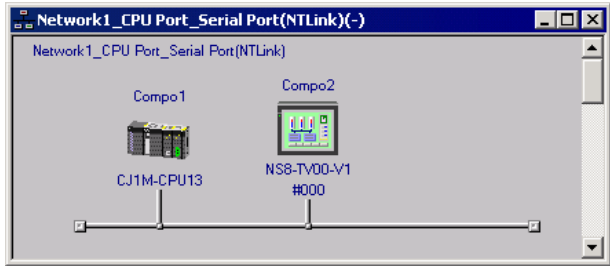







## Controller Link Start-Up

Remove Controller Link communications errors and establish communications.  
 ⇒ ON state of Controller Link Master Unit's INS LED  
 ⇒ Check Controller Link configuration through CX-Integrator.


- (1) Connect to PLC online, then connect to Controller Link Unit through the online connection information window.

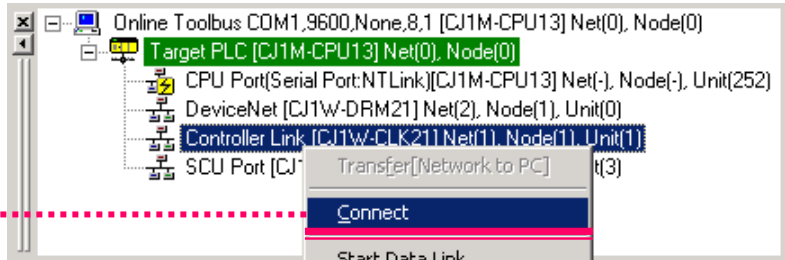


Right-click a Controller Link Unit in the online connection information window, then select [Connect]



- (2) Next, upload the Controller Link network configuration information.

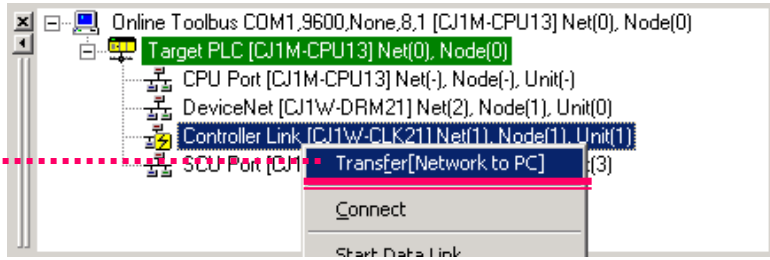

Select [Transfer [Network to PC]]

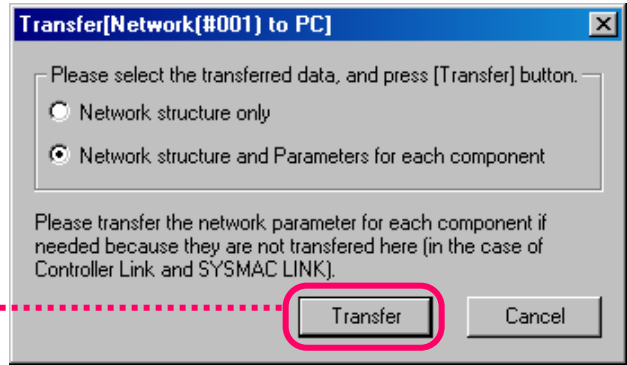


Click [Transfer]






(3) After the transfer is confirmed, connected devices on the current Controller Link network are displayed as shown below.

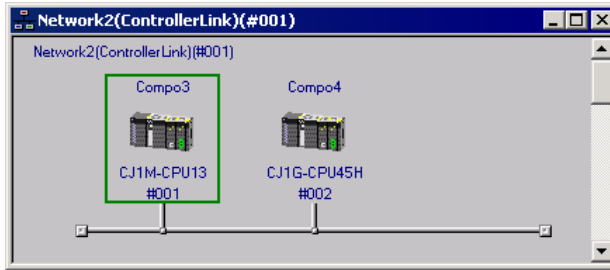


In this example, although three PLCs are actually connected through the Controller Link, in this start-up example explanation assume that only two PLCs are displayed. (One PLC did not join the communications due to incorrect Routing Table settings)





(4) Check the Routing Table and configure it correctly.  
See "Confirming the Routing Table is not Configured" for configuration details.


(5) Re-upload the Controller Link network configuration information.

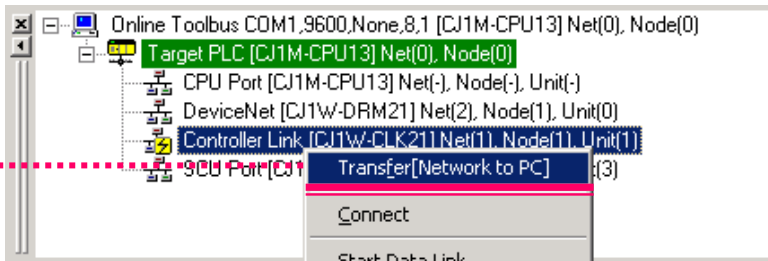


Select [Transfer [Network to PC]]

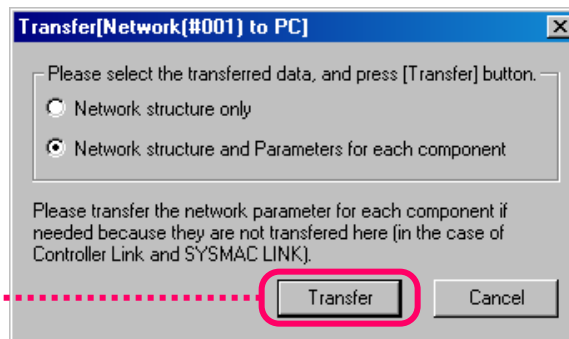

Click [Transfer]



(6) Send the network configuration from the network to the personal computer.

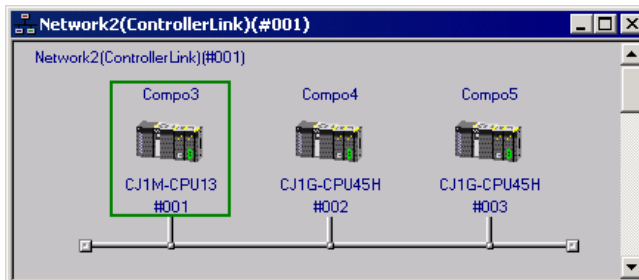



## CompoWay/F Start-Up

Remove CompoWay/F communications errors and establish communications.


- ⇒ Check CompoWay/F configuration through CX-Integrator.
- ⇒ Configure serial communications Unit parameters.
- ⇒ Configure temperature controller communications.

This example explains the start-up of a serial communications Unit with two temperature controllers (E5CN) connected via CompoWay/F.


- Two temperature controllers (E5CN) are connected to serial communications Unit (CS1W-SCU41-V1) port no. 1 via RS485. Communication Unit numbers are #001 and #002.
- Communication settings of the serial communications Unit and the two temperature controllers are unmatched.
- Communication settings between the two temperature controllers are unmatched as well.

(1) Connect to PLC online, then connect to a CPU Unit through the online connection information window.

Right-click an SCU port in the online connection information window, then select [Connect]

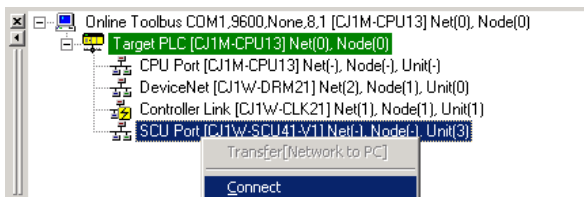


Select SCU port (140)

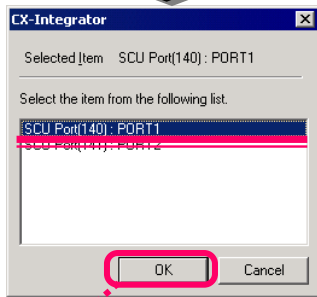

Click **OK**


Select CompoWay/F

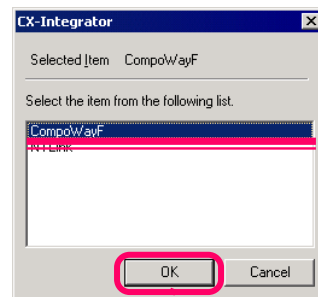


Click **OK**

(2) Upload the CompoWay/F network configuration information.

Right-click an SCU port in the online connection information window, then select [Transfer [Network to PC]]

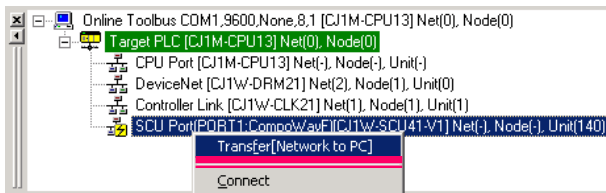


Click [Yes] in the message dialog box

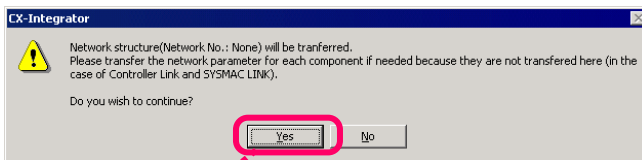

Click **Yes**


Select [Selection], enter 1 for minimum and 2 for maximum values, then click the [OK] button

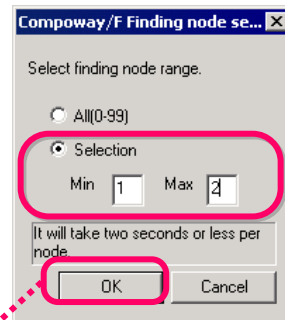


Click **OK**



Click [OK]

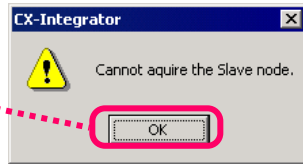


This dialog box is displayed because communication is not established between the serial communications Unit and temperature controllers.



Then click the [OK] button in the dialog box indicating completion of transmission


(3) Adjust the serial communications board parameters settings to those of the CompoWay/F.

Right-click a Target PLC in the online connection information window, then select [Mode Setting].  
 (a) Select [Program] for operation mode  
 (b) Click [Set]  
 (c) Click [Close] after changing

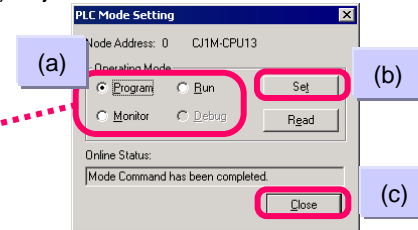



The [Network Structure] window shows a CPU Unit (CJ1M-CPU13) that has a serial communications Unit, but neither of the two temperature controllers.

Place the cursor on CJ1M-CPU in the [Network Structure] window and double-click

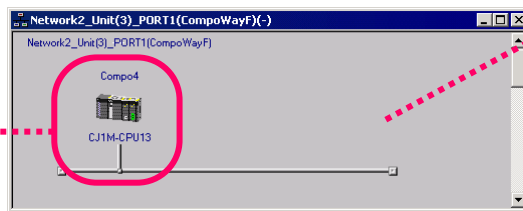

Configure [Port1: Port settings] to [Manual] and [Port1: Serial communications mode] to [Serial Gateway]. Check other settings as well, and change if necessary.


From the [Display Parameter] pull-down menu, select [Port1: Serial Gateway Settings]

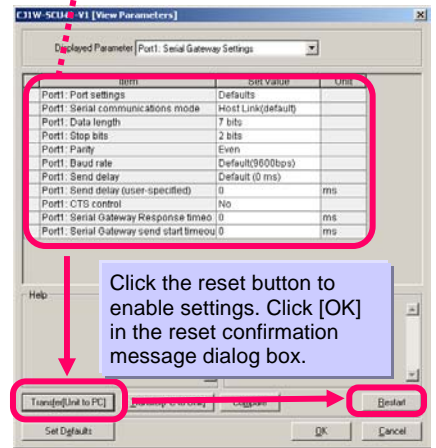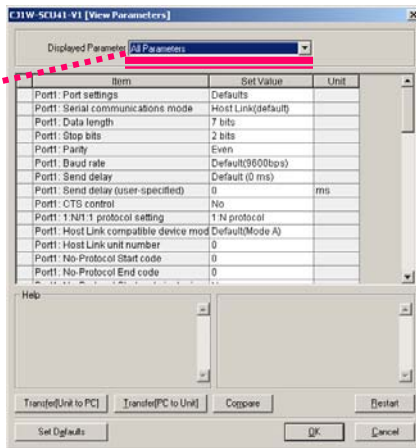


Click the reset button to enable settings. Click [OK] in the reset confirmation message dialog box.

Click [OK] in the [Edit Parameters] dialog box and close the dialog box

Confirm that settings are correct, then select the [Transfer [PC to Unit]] button. Click [OK] in the transmission confirmation message dialog box.

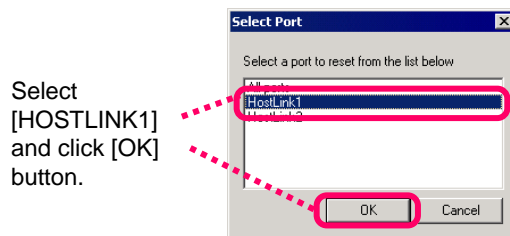

Select [HOSTLINK1] and click [OK] button.




Click [OK]

Perform the step (2) in the previous page

(4) Re-upload the network configuration information of CompoWay/F. Perform the step (2) from the previous page.

Click [OK] button in a dialog box indicating completion of transmission


Only the Units for which connection is established are displayed in the [Network Structure] window, as shown on the next page.

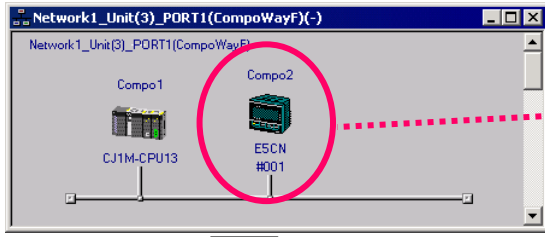

The [Network Structure] window shows only the Units for which connection is established, and Units with incorrect communications setting are not displayed.

Check the temperature controller that is not displayed properly and configure it correctly


- (5) Check the settings of the temperature controller that is not displayed in the [Network Structure] window (baud rate, data length, stop bit, parity, Unit number), configure it correctly, then re-upload (Perform step (2) from two pages ago). The [Network Structure] window is updated.

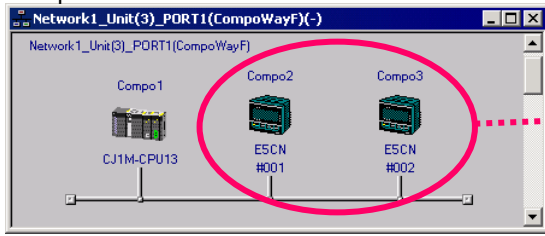

Now the correctly configured Unit is displayed and you can confirm that communications settings are correct.

Perform step (2) from two pages ago


- (6) Move the cursor on E5CN of communications Unit number #002, then select [Start Special Application] > [Start with Setting Inherited].

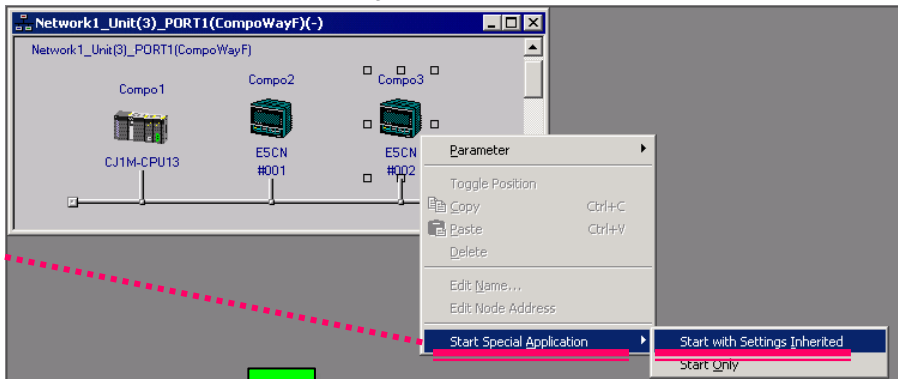

Right-click on the communications Unit number #002 icon in the [Network Structure] window, then select [Start Special Application] > [Start with Setting Inherited]

- (6) Dedicated Support Software CX-Thermo is started with the same model and setting as that of the temperature controller. After parameter settings are finished, download the settings to the E5CN of communications Unit number #002.

After parameter settings are finished, select [Communications] > [Download to Device], then select either [Download all], [Download Changed Parameters], or [Download Changed from Default]

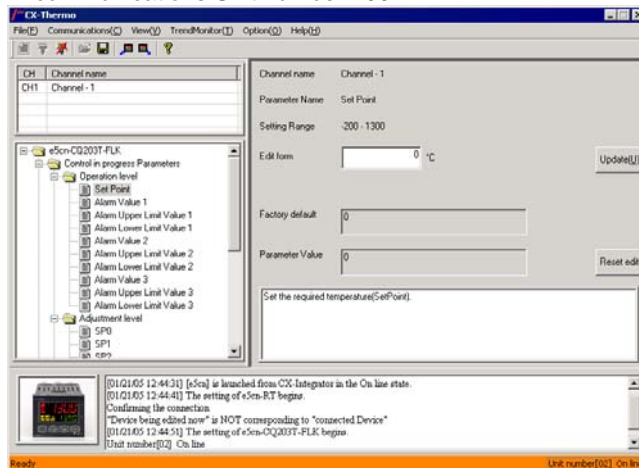





## Saving System Configuration (1)

Save the system configuration for inspection after delivery.

- (1) Connect online to a PLC on a network.  
The online connection information window is displayed.

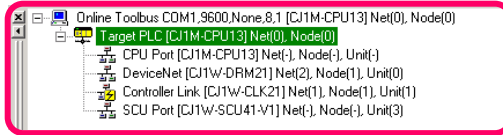

All communications Units and ports of a connected PLC are automatically displayed in the online connection information window. From this window, connect to each network and save the configuration to a project file.




- (2) Send the network Structure of DeviceNet to the personal computer.  
Connect to DeviceNet from the online connection information window. After connection is established, send the network Structure of DeviceNet to the personal computer.

Move the cursor on the DeviceNet and right-click

Select [Connect]


Select [Transfer [Network to PC]]

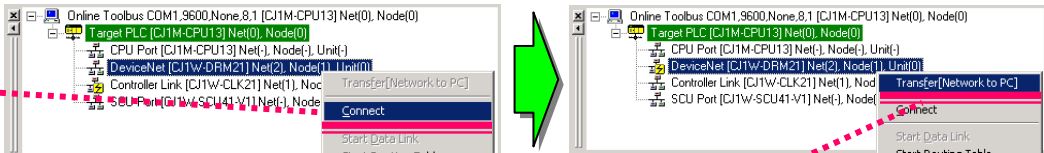


- (3) Send the network configuration of NT Link to the personal computer.  
Select the connection menu on the CPU port, then select upper link port and NT Link. Next, select the transmission menu on the CPU port.

Select [Connect]

Select [Transfer [Network to PC]]

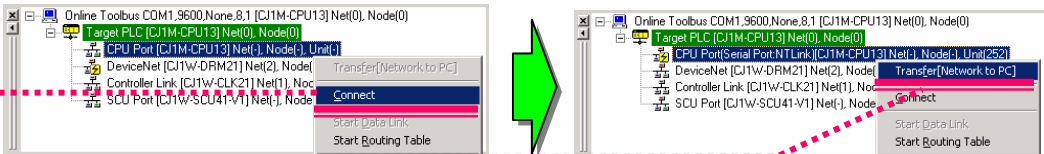


Select [Serial Port] > [NT Link]

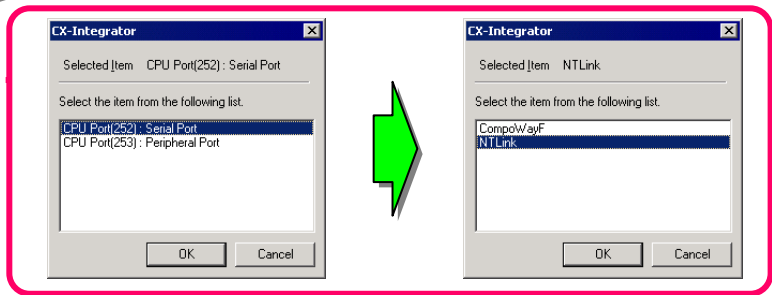

- (4) Send the Controller Link network configuration to the personal computer.  
Connect to the Controller Link network. After connection is established, send the network configuration to the personal computer.

Select [Connect]

Select [Transfer [Network to PC]]

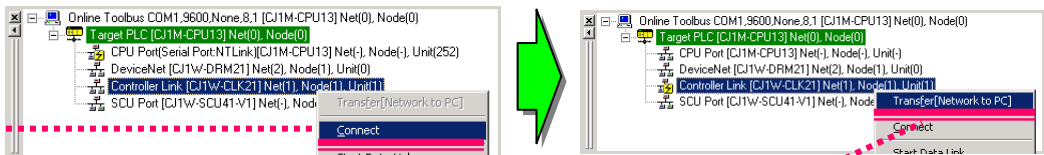




## Saving System Configuration (2)


(5) Connect to a PLC on the Controller Link network.

Select a remote PLC on the Controller Link network configuration screen (a PLC without a square symbol) to switch the connection destination to the PLC.  
Destination PLC communication device configuration is displayed in the online connection information window.


Select [Change connection to this PLC]

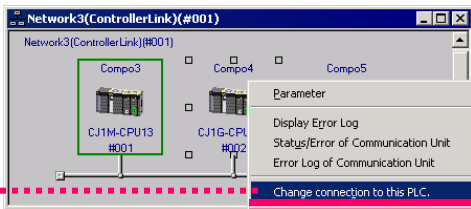

A Green frame is displayed on the specified remote PLC.

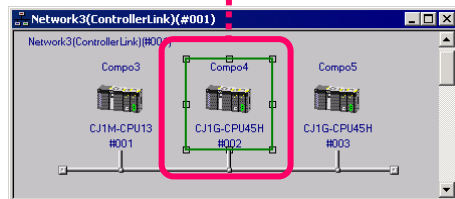


All communications Units and ports are also displayed in the online connection information window.

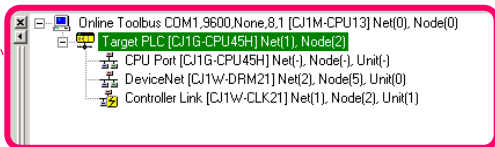


(6) Send the DeviceNet network configuration on the remote PLC.

Connect to DeviceNet from the online connection information window and send the network configuration to the personal computer.

Select [Connect]

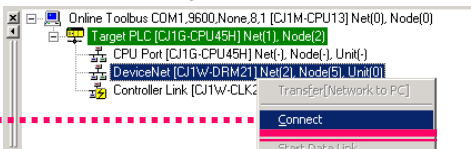


Select [Transfer [Network to PC]]

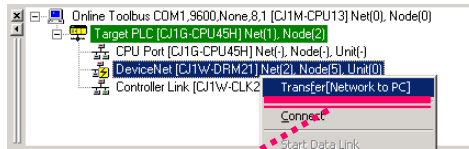


(7) Send the DeviceNet network configuration on another remote PLC.

Repeat the steps from (6) and (7). After transmission, all the networks sent to the workspace are displayed.

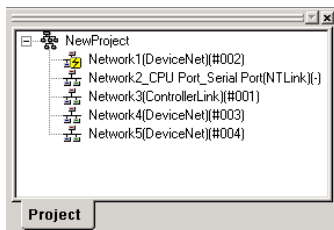

(8) Save all the configurations.

Select [Save As...]

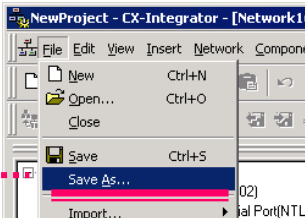




## System Configuration Verification (1)

Confirm that the System has the same wiring and settings as before disassembly.  
 ⇒ CX-Integrator verification is complete.

(1) Connect online to a PLC on a network.

The online connection information window is displayed.



All communications Units and ports of a connected PLC are automatically displayed in the online connection information window.






(2) Verify the DeviceNet network configuration.


Connect to a target DeviceNet from the workspace and verify the network Structure.

Select [Connect]

Select [Compare]

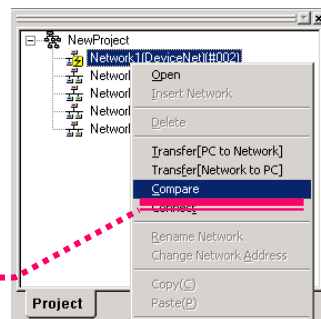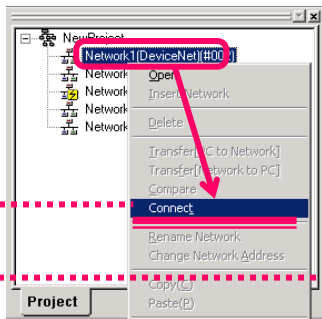


(3) Any error found in the configuration verification will be displayed in the verification result dialog box.

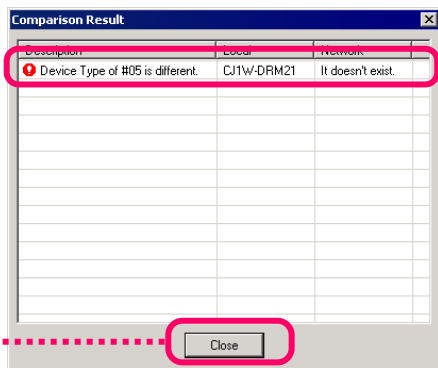


If you find a Slave that is not on the network, you may have incorrect wiring in the network.

Click [Close]



(4) After solving the error, verify the configuration again.

Click [OK]



A message is displayed indicating verification matching and now it can be confirmed that the configuration is the same as that before disassembly.



## System Configuration Verification (2)

- (5) Verify the NT Link network.  
 Connect to the NT Link from the workspace and verify the network configuration.  
 Confirm that the same verification matching message is displayed as in step (4).

Select [Connect]  
 Select [Compare]

- (6) Verify the Controller Link network.  
 Connect to DeviceNet from the online connection information window and verify the network Structure.  
 Confirm that the same verification matching message is displayed as in step (4).

Select [Connect]  
 Select [Compare]

- (7) Connect to a PLC on the Controller Link network.  
 Connect to a remote PLC using the same procedure as the step (5) for saving a System configuration.  
 Use steps from (2) to (4) to verify the DeviceNet network.

Select [Change connection to this PLC]

Select [Connect]

Select [Compare]



- (8) Verify the DeviceNet configuration on another remote PLC.  
 Use the same procedure as step (2) for Network "N4" to verify the network Structure.

## Controller Link Diagnosis



Confirm that the Controller Link connection is correct with an upper level System.  
 ⇒ Diagnosis result check OK

- (1) Connect to PLC online, then connect to Controller Link Unit through the online connection information window.

Right-click a Controller Link Unit under Target PLC in the online connection information window, then select [Connect]

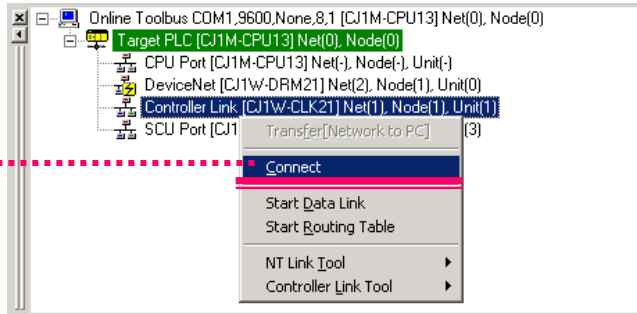

- (2) Next, select the Controller Link network tool.

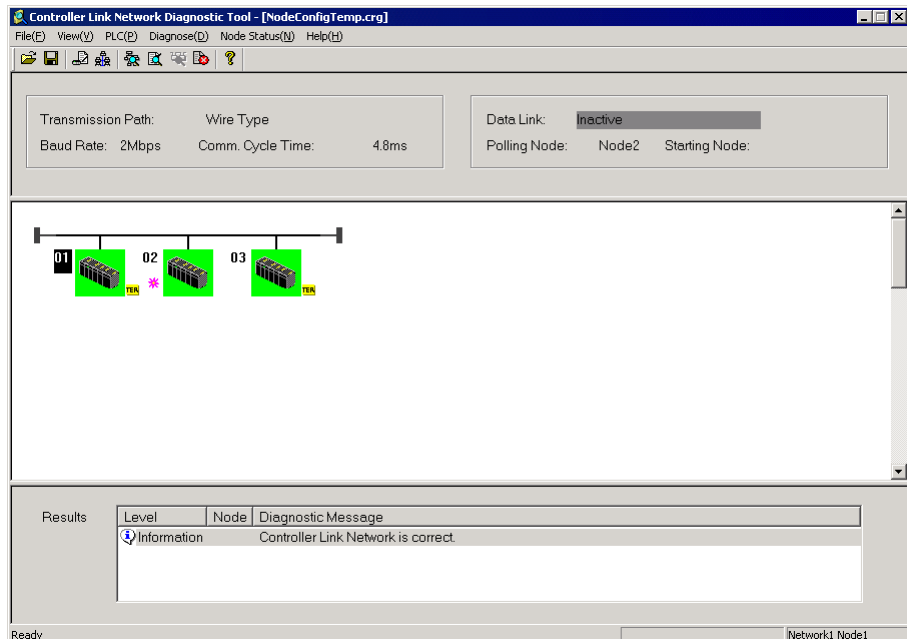
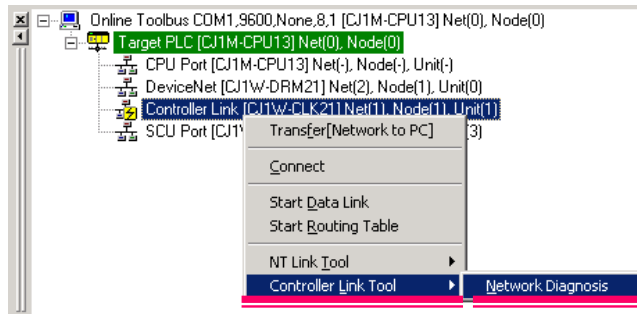


## Checking CompoNet Network



Remove CompoNet communications errors and establish communications. Check the Slave status monitor from Master Unit.

Right-click a CompoNet Master Unit under a connection target PLC in the online connection information window, then select [Connect]


- (1) Connect to PLC online, then connect to a CompoNet through the online connection information window.

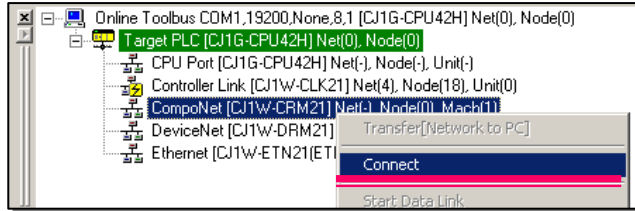

- (2) Transfer the CompoNet network configuration to the personal computer.

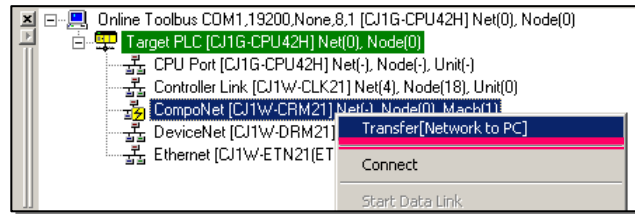

- (3) Select [Master only (including parameters)], then click [Transfer] button.


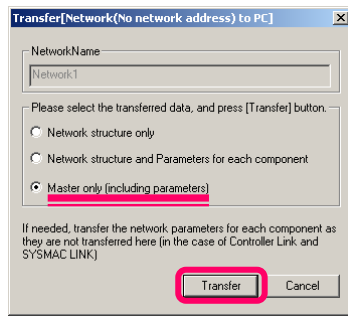


The Master Unit is displayed in the network configuration window.




Right-click on the Master Unit icon and select [Monitor] to display the device monitor screen. Select [Status] tab

(4) Monitor a component.

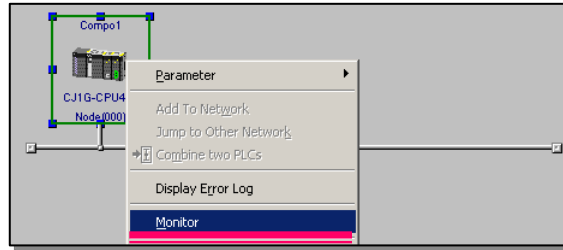


The monitor window is displayed.



(5) Click [Slave Status] tab to check the status of Slave Units.

If any unit is missing or communication errors are detected, check the wiring and DIP switch settings of the applicable units to solve the problems.

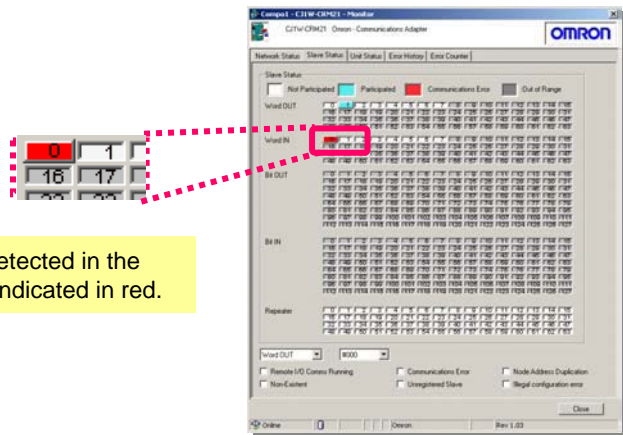

An error is detected in the Slave Units indicated in red.



(6) Repeat the steps (2) and (3) to confirm that the CompoNet network is functioning properly.



## Starting CX-Drive via DeviceNet

Setup Drives on DeviceNet and start CX-Drive on CX-Integrator window.  
An example of 3G3MV-PDRT2 is shown below.

When opening a stored data file after starting the dedicated tool, select [Start Only]. If [Start with Setting Inherited] is selected, new data is created.



Right-click on 3G3MV-PDRT2 and select [Start Special Application]




Select [Start with Setting Inherited]




CX-Drive starts and Inverter property settings are shown

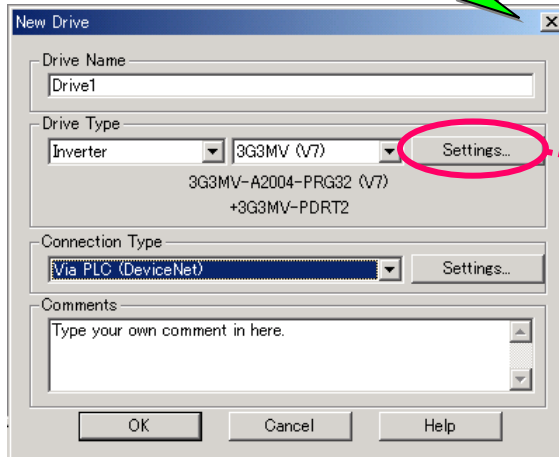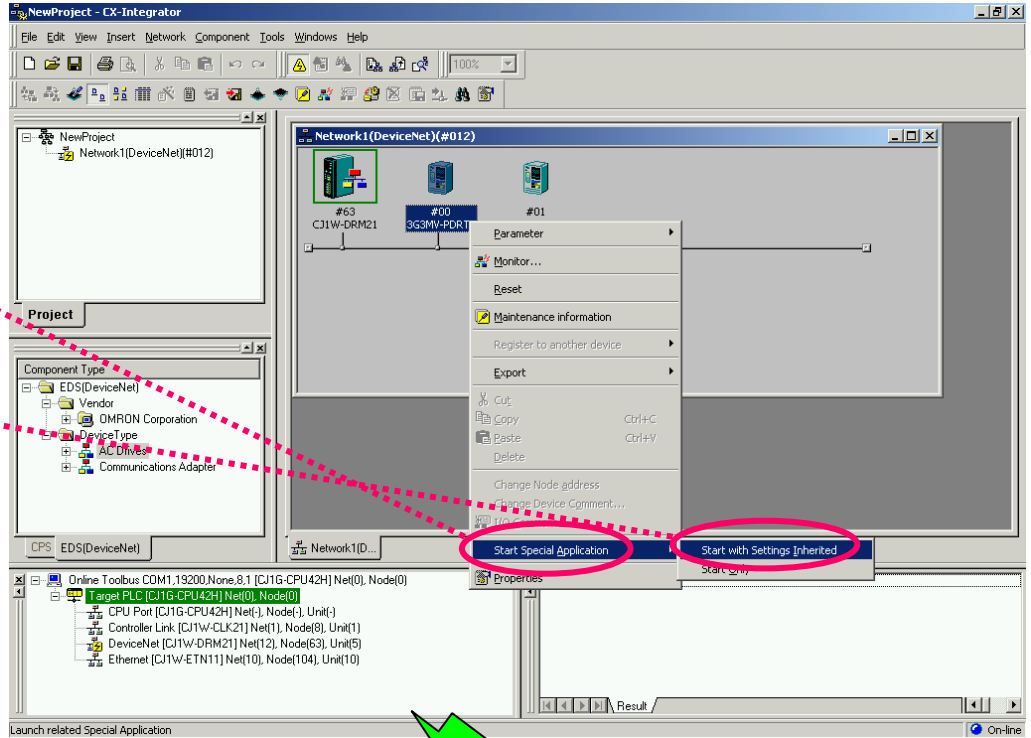

Select Settings to set detailed Inverter specifications.



Save data

Click  and save the data.

If more than one drive setting data is edited, drive data is saved by drive type and a total overview is saved in a work file.

## Connecting a Servo or Inverter to a Personal Computer Serially.



From the [Start] menu, select [Programs] > [OMRON] > [CX-One] > [CX-Drive] > [CX-Drive] to start CX-Drive when you connect Servo or Inverter with serial connection to your computer.

Select [File] > [New] to create new data if the drive specifications are known. If the drive is already connected, select [Driver] > [Autodetect] to detect the model and specification of this connected drive.

Select [Settings]





Set communication  
Specifications

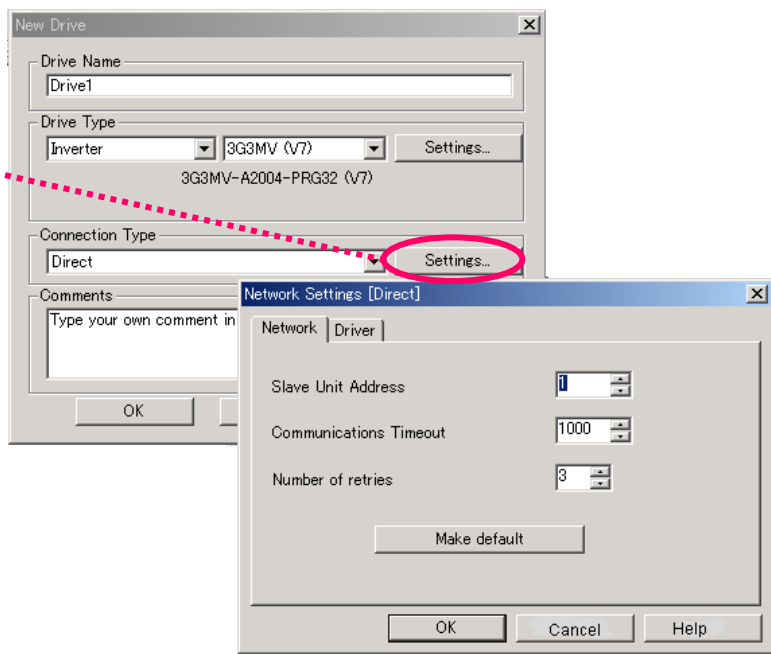


Or, select [Driver] > [Autodetect] to detect the connected drive specification.

To execute  
Autodetect, select  
[Settings] and define  
the search conditions

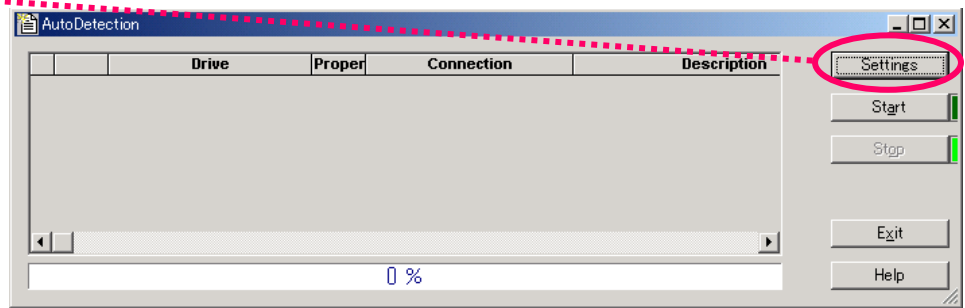

Save data

Click  and save the data.

Memo

**OMRON Corporation Industrial Automation Company**

Tokyo, JAPAN

Contact: [www.ia.omron.com](http://www.ia.omron.com)

**Regional Headquarters**

**OMRON EUROPE B.V.**

Wegalaan 67-69-2132 JD Hoofddorp  
The Netherlands

Tel: (31)2356-81-300/Fax: (31)2356-81-388

**OMRON ELECTRONICS LLC**

One Commerce Drive Schaumburg,  
IL 60173-5302 U.S.A.

Tel: (1) 847-843-7900/Fax: (1) 847-843-7787

**OMRON ASIA PACIFIC PTE. LTD.**

No. 438A Alexandra Road # 05-05/08 (Lobby 2),  
Alexandra Technopark,

Singapore 119967

Tel: (65) 6835-3011/Fax: (65) 6835-2711

**OMRON (CHINA) CO., LTD.**

Room 2211, Bank of China Tower,  
200 Yin Cheng Zhong Road,

PuDong New Area, Shanghai, 200120, China

Tel: (86) 21-5037-2222/Fax: (86) 21-5037-2200

**Authorized Distributor:**

© OMRON Corporation 2008-2013 All Rights Reserved.  
In the interest of product improvement,  
specifications are subject to change without notice.

Printed in Japan

**Cat. No. R145-E1-04**